

## **OIL ANALYSIS REPORT**

Sample Rating Trend

ISO

# KAESER 7585285

Component

Compressor

KAESER SIGMA (OEM) M-460 (--- QTS)

### **DIAGNOSIS**

### Recommendation

The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil.

### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Jan 2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC06133298		
Sample Date		Client Info		22 Jan 2024		
Machine Age	hrs	Client Info		2555		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	<1		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	<1		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	3		
Lead	ppm	ASTM D5185m	>10	<1		
Copper	ppm	ASTM D5185m	>50	31		
Tin	ppm	ASTM D5185m	>10	<1		
Vanadium	ppm	ASTM D5185m	/10	<1		
Cadmium	ppm	ASTM D5185m		<1		
	ρρ		11 11 11		111	1111
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m	0	0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	100	5		
Calcium	ppm	ASTM D5185m	0	4		
Phosphorus	ppm	ASTM D5185m	0	3		
Zinc	ppm	ASTM D5185m	0	38		
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		2		
Potassium	ppm	ASTM D5185m	>20	3		
Water	%	ASTM D6304	>0.05	0.008		
ppm Water	ppm	ASTM D6304	>500	85		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		12683		
Particles >6µm		ASTM D7647	>1300	<u></u> 5610		
Particles >14µm		ASTM D7647	>80	<b>499</b>		
Particles >21µm		ASTM D7647	>20	<u> </u>		
Particles >38µm		ASTM D7647	>4	4		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>^</u> 21/20/16		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
. LOID DEGITION		111001100	mmbbasc	Carront	Thistory I	motory


Acid Number (AN)

mg KOH/g ASTM D8045 1.0

0.23



# **OIL ANALYSIS REPORT**

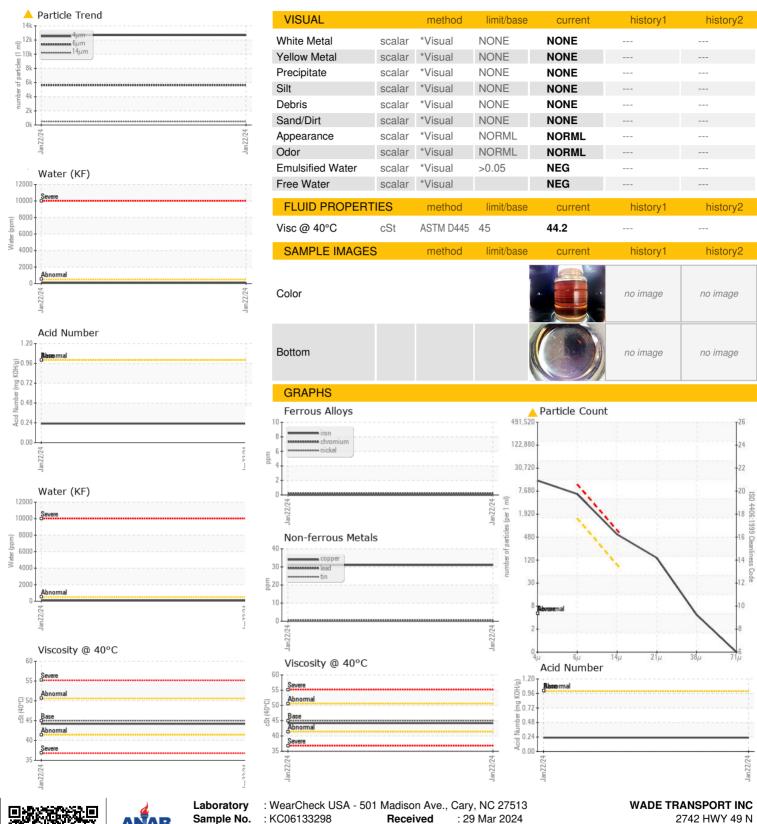



Certificate L2367

Sample No. Lab Number

: 06133298

**Unique Number** : 10952763 Test Package : IND 2

Received : 29 Mar 2024 : 01 Apr 2024 **Tested** 

: 03 Apr 2024 - Jonathan Hester Diagnosed

COLLINS, MS US 39428

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: