

OIL ANALYSIS REPORT



ISO

KAESER AS 25 8883535 (S/N 1755)

Compressor

KAESER SIGMA (OEM) S-460 (--- QTS)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC06133301		
Sample Date		Client Info		19 Jan 2024		
Machine Age	hrs	Client Info		4007		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	<1		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	<1		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	3		
Lead	ppm	ASTM D5185m	>10	<1		
Copper	ppm		>50	15		
Tin	ppm	ASTM D5185m	>10	<1		
Vanadium	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		<1		
ADDITIVES		method	limit/base	current	history1	history2
Boron	nnm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	90	8		
	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese Magnesium	ppm	ASTM D5185m	90	4		
Calcium	ppm ppm		2	3		
		ASTM D5185m	2	۲ ۱		
Phosphorus Zinc	ppm	ASTM D5185m		10		
	ppm			10		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		0		
Potassium	ppm	ASTM D5185m	>20	1		
Water	%	ASTM D6304		0.009		
ppm Water	ppm	ASTM D6304	>500	97		
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		7679		
Particles >6µm		ASTM D7647	>1300	<u> </u>		
Particles >14µm		ASTM D7647	>80	A 710		
Particles >21µm		ASTM D7647	>20	<u> </u>		
Particles >38µm		ASTM D7647	>4	<u> </u>		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	20/19/17		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.36		



8 71

E Gk

<u>응</u> 51

Te 41 31

2k

0

12000

1000

800 (maa)

600 Water 400

200

0.50

(B/HOX Ê0.3

E 0.20

Pio 0.1

0.00

10000

600 Water (

4000

200

52

5

48

(D=04) 44 Ba

42

40

38

Abnorma

E

Water (KF)

Abnormal


LE


an,

Water (KF)

Built for a lifetime

-14µm



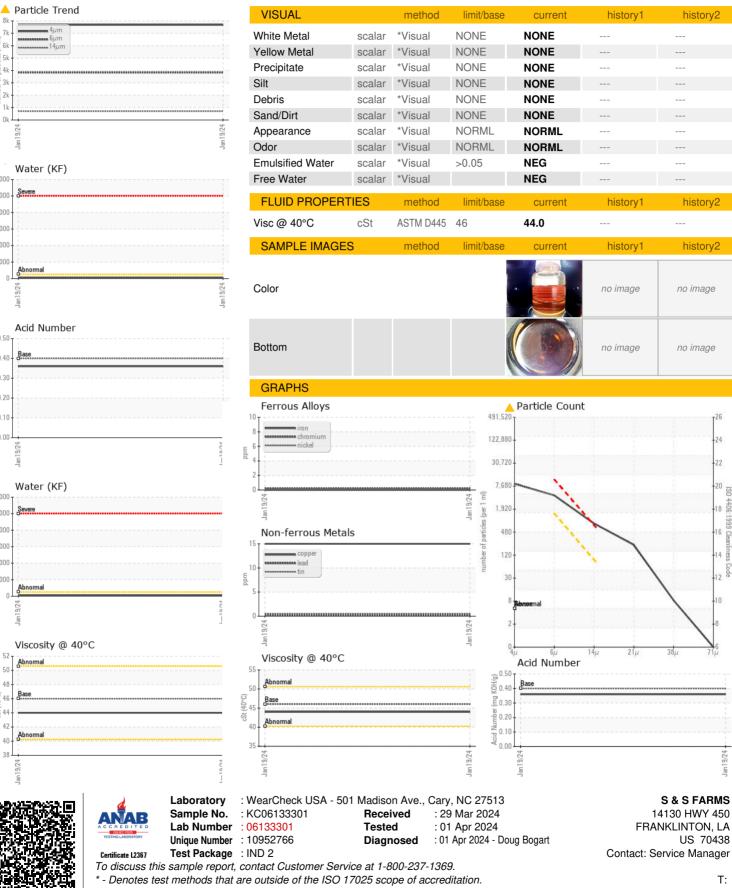

F:

Contact/Location: Service Manager - SSFFRA