




# OIL ANALYSIS REPORT

Sample Rating Trend

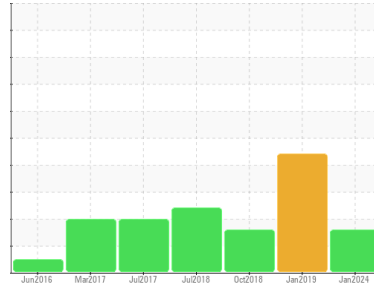

ISO



Machine Id  
**KAESER ASD 30 4376672 (S/N 1101)**

Component  
**Compressor**

Fluid  
**KAESER SIGMA (OEM) M-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>KC06133304</b>	KC75853	KC82060
Sample Date	Client Info		<b>18 Jan 2024</b>	10 Jan 2019	30 Oct 2018
Machine Age	hrs	Client Info	<b>35907</b>	22142	21233
Oil Age	hrs	Client Info	<b>0</b>	6369	0
Oil Changed	Client Info		<b>N/A</b>	Not Changd	Not Changd
Sample Status			<b>ABNORMAL</b>	ABNORMAL	ABNORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<1	<1	<1
Chromium	ppm	ASTM D5185m >10	<1	0	0
Nickel	ppm	ASTM D5185m >3	0	<1	<1
Titanium	ppm	ASTM D5185m >3	<1	0	0
Silver	ppm	ASTM D5185m >2	0	<1	0
Aluminum	ppm	ASTM D5185m >10	3	<1	0
Lead	ppm	ASTM D5185m >10	<1	<1	2
Copper	ppm	ASTM D5185m >50	2	2	3
Tin	ppm	ASTM D5185m >10	<1	0	0
Antimony	ppm	ASTM D5185m	---	0	0
Vanadium	ppm	ASTM D5185m	<1	0	0
Cadmium	ppm	ASTM D5185m	<1	<1	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	0	<1	<1
Barium	ppm	ASTM D5185m 90	<1	0	5
Molybdenum	ppm	ASTM D5185m 0	0	<1	0
Manganese	ppm	ASTM D5185m	<1	<1	<1
Magnesium	ppm	ASTM D5185m 100	31	40	60
Calcium	ppm	ASTM D5185m 0	4	1	1
Phosphorus	ppm	ASTM D5185m 0	0	3	2
Zinc	ppm	ASTM D5185m 0	66	30	30

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<1	<1	1
Sodium	ppm	ASTM D5185m	37	16	14
Potassium	ppm	ASTM D5185m >20	9	3	3
Water	%	ASTM D6304 >0.05	<b>0.020</b>	▲ 0.139	0.020
ppm Water	ppm	ASTM D6304 >500	<b>209</b>	▲ 1390	200






## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>80941</b>	---	25286
Particles >6µm	ASTM D7647	>1300	▲ <b>16363</b>	---	▲ 7266
Particles >14µm	ASTM D7647	>80	▲ <b>596</b>	---	▲ 713
Particles >21µm	ASTM D7647	>20	▲ <b>119</b>	---	▲ 231
Particles >38µm	ASTM D7647	>4	<b>2</b>	---	▲ 12
Particles >71µm	ASTM D7647	>3	<b>0</b>	---	0
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ <b>24/21/16</b>	---	▲ 20/17

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	<b>0.28</b>	0.367	0.336

# OIL ANALYSIS REPORT

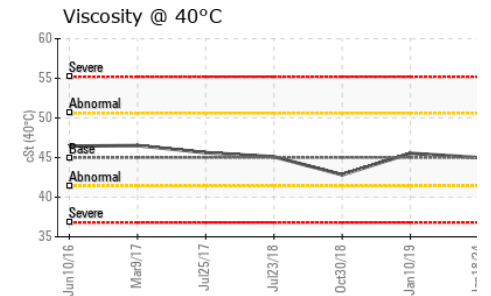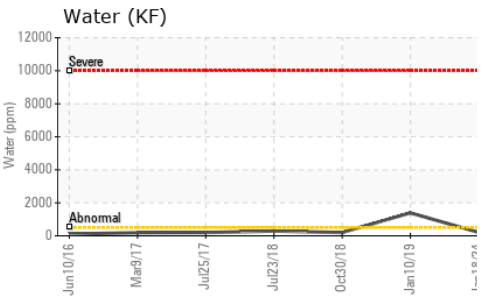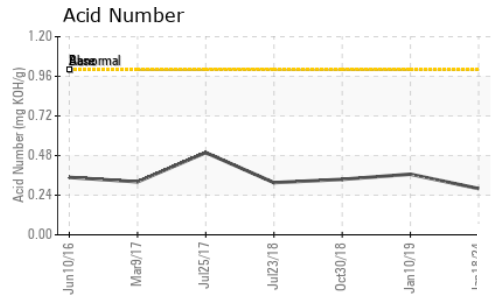
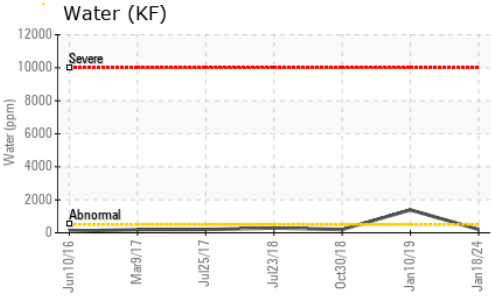
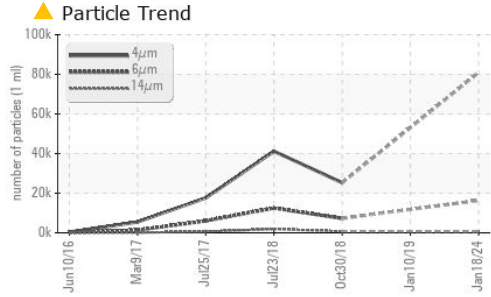


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	0.2%
Free Water	scalar	*Visual		NEG	1.0

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 45	45.0	45.54	42.83

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

## GRAPHS

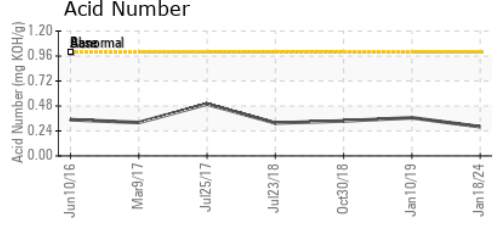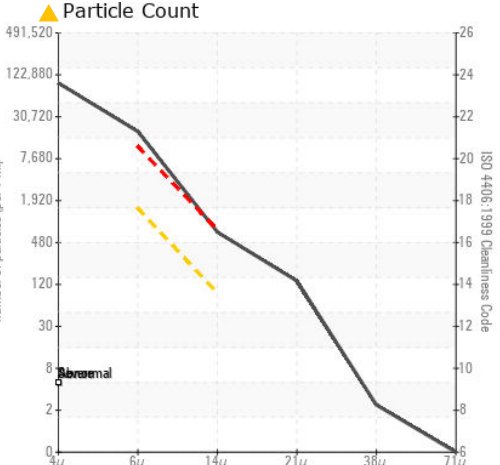

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KC06133304  
**Lab Number** : 06133304  
**Unique Number** : 10952769  
**Test Package** : IND 2  
**Received** : 29 Mar 2024  
**Tested** : 01 Apr 2024  
**Diagnosed** : 01 Apr 2024 - Doug Bogart

**NEW ORLEANS PUBLIC BELT RAILROAD**  
 4822 TCHOUPITOU LAS ST  
 NEW ORLEANS, LA  
 US 70115  
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)