




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**



Machine Id  
**ATLAS COPCO NEW ATLAS 3 (S/N APF197116)**  
Component  
**Compressor**  
Fluid  
**USPI AIR 46 (--- GAL)**

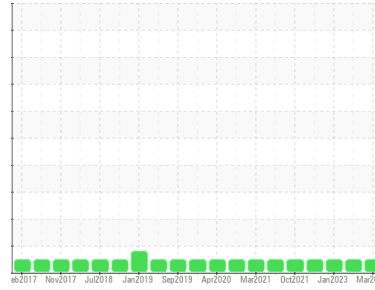

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>USPR000765</b>	USPM30645	USPM26305
Sample Date	Client Info		<b>30 Mar 2024</b>	03 Jan 2024	19 Jan 2023
Machine Age	hrs	Client Info	<b>0</b>	0	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>0</b>	0	<1
Chromium	ppm	ASTM D5185m >10	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >25	<b>3</b>	0	0
Lead	ppm	ASTM D5185m >25	<b>&lt;1</b>	0	0
Copper	ppm	ASTM D5185m >50	<b>&lt;1</b>	<1	0
Tin	ppm	ASTM D5185m >15	<b>&lt;1</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 0	<b>&lt;1</b>	0	1
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	<1	0
Magnesium	ppm	ASTM D5185m 0	<b>&lt;1</b>	<1	0
Calcium	ppm	ASTM D5185m 0	<b>0</b>	<1	0
Phosphorus	ppm	ASTM D5185m 1	<b>1</b>	1	2
Zinc	ppm	ASTM D5185m 0	<b>7</b>	6	2
Sulfur	ppm	ASTM D5185m 0	<b>0</b>	0	14

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>&lt;1</b>	0	<1
Sodium	ppm	ASTM D5185m	<b>0</b>	0	0
Potassium	ppm	ASTM D5185m >20	<b>1</b>	0	0
Water	%	ASTM D6304 >0.2	<b>0.029</b>	0.045	0.030
ppm Water	ppm	ASTM D6304 >2000	<b>299</b>	452	309.5

## FLUID CLEANLINESS






	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	<b>3803</b>	2849	452
Particles >6µm	ASTM D7647	>2500	<b>1454</b>	801	95
Particles >14µm	ASTM D7647	>320	<b>104</b>	59	9
Particles >21µm	ASTM D7647	>80	<b>27</b>	20	2
Particles >38µm	ASTM D7647	>20	<b>0</b>	0	0
Particles >71µm	ASTM D7647	>4	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>20/18/15	<b>19/18/14</b>	19/17/13	16/14/10

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.05	<b>0.19</b>	0.18	0.17




# OIL ANALYSIS REPORT

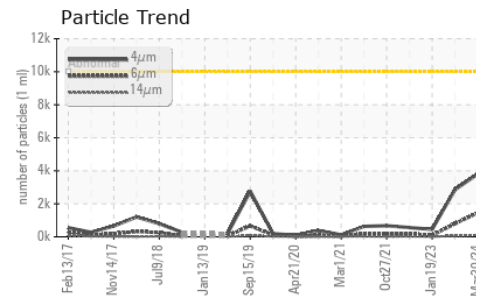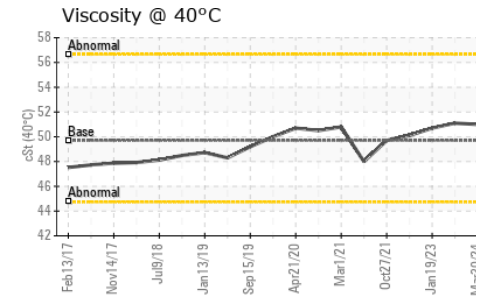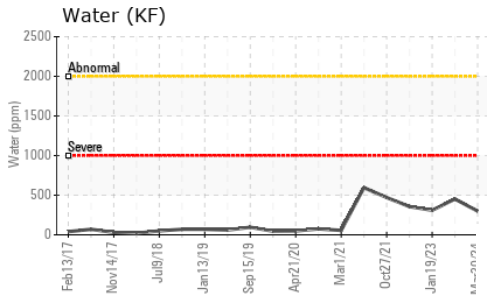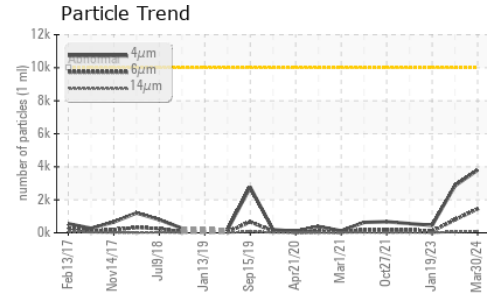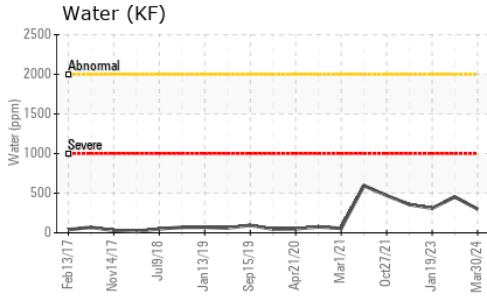






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	49.7	51.0	51.1

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

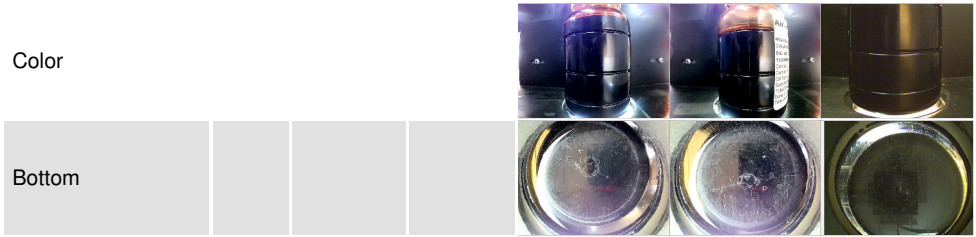

## GRAPHS

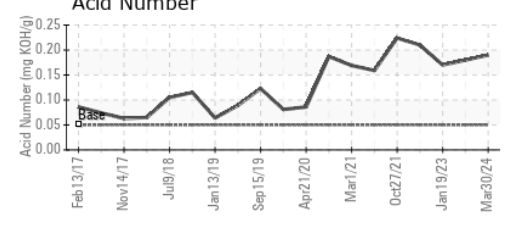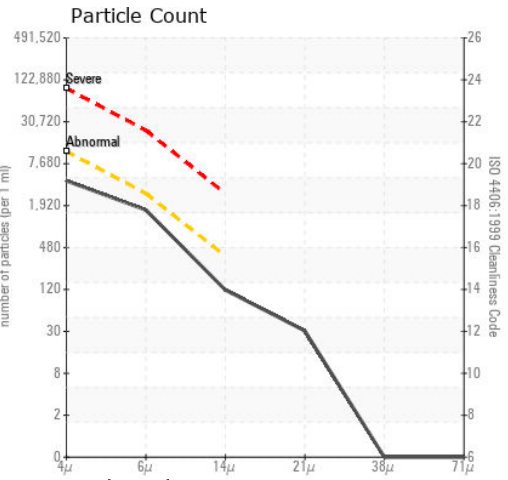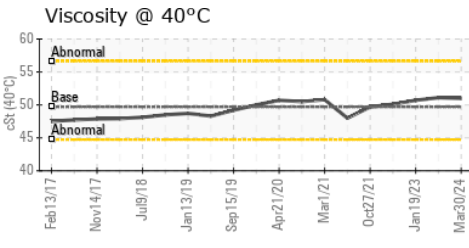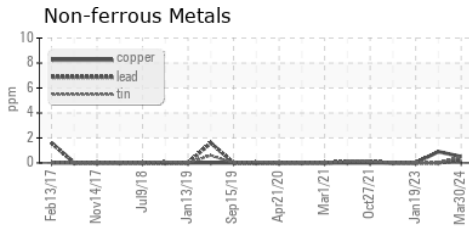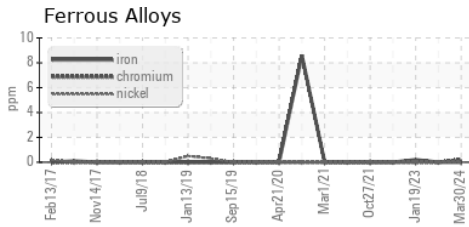

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : USPR000765 **Received** : 29 Mar 2024  
**Lab Number** : 06133326 **Tested** : 01 Apr 2024  
**Unique Number** : 10952791 **Diagnosed** : 01 Apr 2024 - Doug Bogart  
**Test Package** : IND 2

**TYSON FM-Perry-USP**  
 Perry, IA  
 US 50220  
 Contact: SCOTT UHL  
 scott.uhl@tyson.com  
 T:  
 F:

Certificate L2367  
 To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)