




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

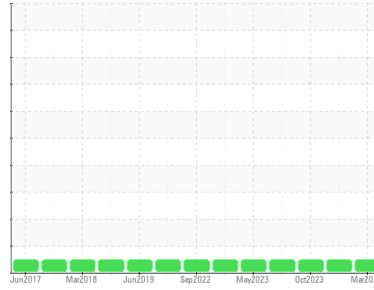

Machine Id  
**KR-GF-100352 (S/N 15081)**

Component  
**4 Air Compressor**

Fluid  
**USPI 5000 AIR 46 (25 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>USPM36937</b>	USPM30570	USPM31043
Sample Date	Client Info		<b>30 Mar 2024</b>	10 Jan 2024	15 Oct 2023
Machine Age	mths	Client Info	<b>0</b>	0	0
Oil Age	mths	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m >4	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m >4	<b>&lt;1</b>	0	0
Titanium	ppm	ASTM D5185m	<b>0</b>	<1	0
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >10	<b>&lt;1</b>	0	0
Lead	ppm	ASTM D5185m >20	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >40	<b>0</b>	<1	<1
Tin	ppm	ASTM D5185m >5	<b>0</b>	<1	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	<1	0
Manganese	ppm	ASTM D5185m	<b>0</b>	0	<1
Magnesium	ppm	ASTM D5185m	<b>0</b>	<1	0
Calcium	ppm	ASTM D5185m	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m	<b>0</b>	0	0
Zinc	ppm	ASTM D5185m	<b>0</b>	0	0
Sulfur	ppm	ASTM D5185m	<b>0</b>	0	190

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>&lt;1</b>	<1	<1
Sodium	ppm	ASTM D5185m	<b>0</b>	0	<1
Potassium	ppm	ASTM D5185m >20	<b>&lt;1</b>	1	0
Water	%	ASTM D6304 >0.6	<b>0.003</b>	0.005	0.003
ppm Water	ppm	ASTM D6304 >6000	<b>31</b>	60	37.2

## FLUID CLEANLINESS






	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	<b>589</b>	502	114
Particles >6µm	ASTM D7647	>2500	<b>200</b>	190	42
Particles >14µm	ASTM D7647	>640	<b>35</b>	20	6
Particles >21µm	ASTM D7647	>160	<b>8</b>	6	2
Particles >38µm	ASTM D7647	>40	<b>0</b>	0	0
Particles >71µm	ASTM D7647	>10	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>20/18/16	<b>16/15/12</b>	16/15/11	14/13/10

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>0.34</b>	0.29	0.24




# OIL ANALYSIS REPORT

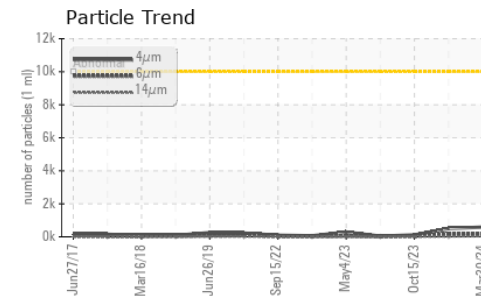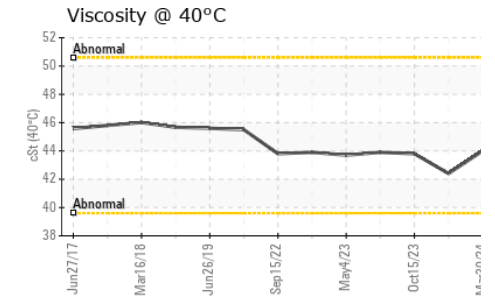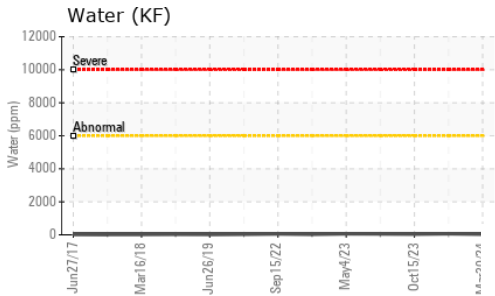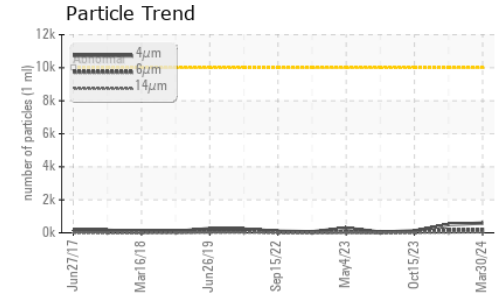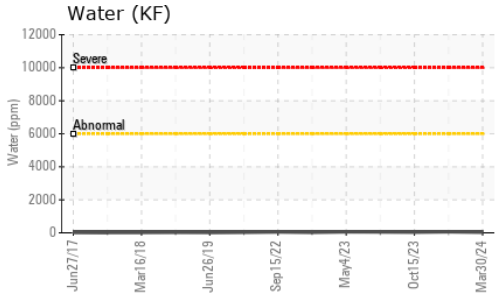






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.6	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	<b>44.0</b>	42.4	43.8

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

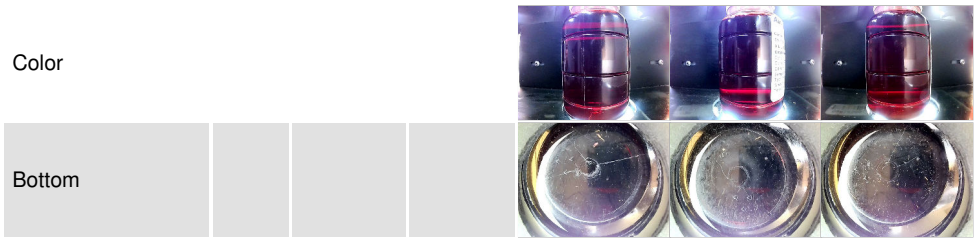

## GRAPHS

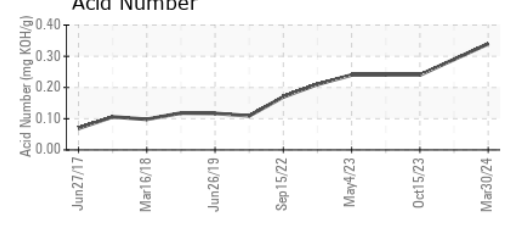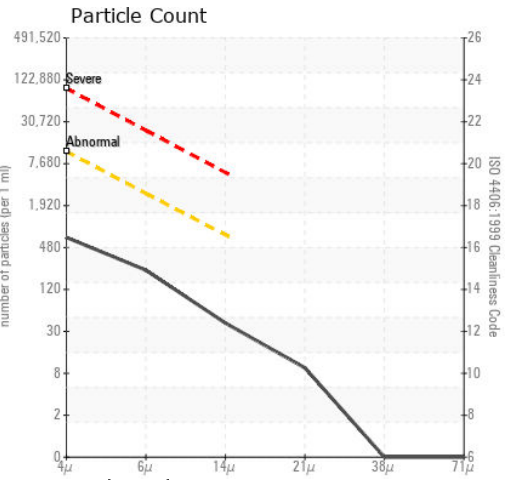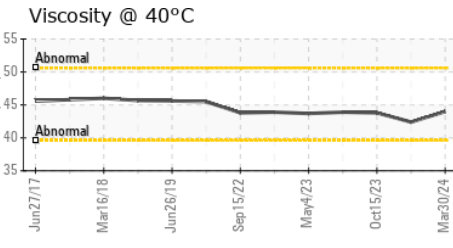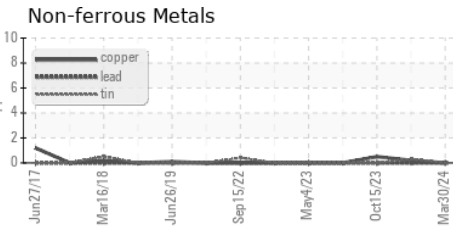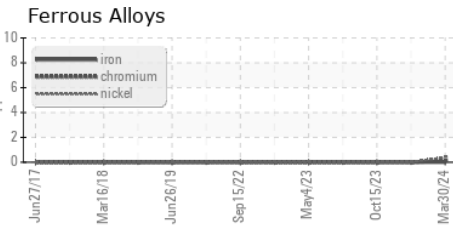

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : USPM36937  
**Lab Number** : **06133346**  
**Unique Number** : 10952811  
**Test Package** : IND 2  
**Received** : 29 Mar 2024  
**Tested** : 01 Apr 2024  
**Diagnosed** : 01 Apr 2024 - Doug Bogart

**KraftHeinz - Kirksville - Plant 8333 USP**  
 2504 INDUSTRIAL RD  
 KIRKSVILLE, MO  
 US 63501  
 Contact: THOMAS BARRETT  
 thomas.barrett@kraftheinz.com  
 T:  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)