


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



Machine Id L7B (S/N C1616000531)
Vacuum Pump

USPI VAC 100 (--- QTS)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Dec2021 Ma	r2022 Sep2022 Jan2023	May2023 Jul2023 Oct2023 Jan20	124 Mar2024	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USPM36933	USPM30572	USPM31022
Sample Date		Client Info		30 Mar 2024	10 Jan 2024	15 Oct 2023
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>20	2	2	1
Chromium	ppm	ASTM D5185m	>20	<1	0	0
Nickel	ppm	ASTM D5185m	>20	<1	0	0
Titanium	ppm	ASTM D5185m		0	<1	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>20	<1	0	<1
Lead	ppm	ASTM D5185m	>20	0	0	0
Copper	ppm	ASTM D5185m	>20	0	<1	<1
Tin	ppm	ASTM D5185m	>20	<1	<1	<1
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	0
Barium	ppm	ASTM D5185m	0	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	<1	0
Manganese	ppm	ASTM D5185m		0	0	<1
Magnesium	ppm	ASTM D5185m	0	0	0	0
Calcium	ppm	ASTM D5185m	0	0	<1	0
Phosphorus	ppm	ASTM D5185m	1800	1529	1496	1470
Zinc	ppm	ASTM D5185m	0	0	0	0
Sulfur	ppm	ASTM D5185m	0	0	0	3
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	7	7	7
Sodium	ppm	ASTM D5185m		<1	0	0
Potassium	ppm	ASTM D5185m	>20	2	1	<1
Water	%	ASTM D6304	>.1	0.026	0.029	0.049
ppm Water	ppm	ASTM D6304	>1000	270	296	490.1
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	2408	901	
Particles >6µm		ASTM D7647	>2500	637	258	
Particles >14µm		ASTM D7647	>640	42	14	
Particles >21µm		ASTM D7647	>160	11	5	
Particles >38µm		ASTM D7647	>40	1	2	
Particles >71µm		ASTM D7647	>10	0	1	
Oil Cleanliness		ISO 4406 (c)	>20/18/16	18/16/13	17/15/11	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.05	0.089	0.08	0.085



OIL ANALYSIS REPORT

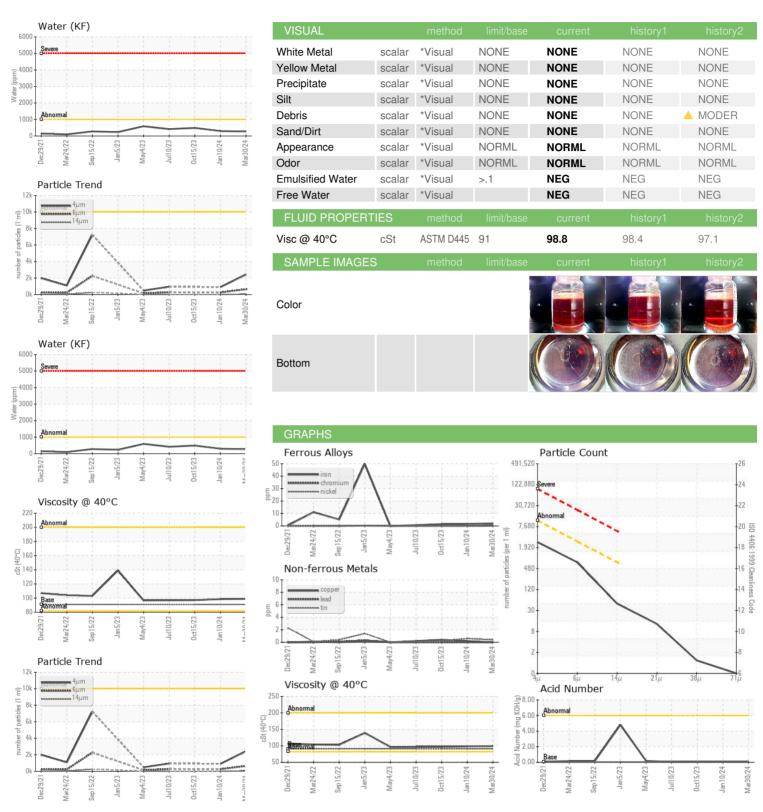





Certificate 12367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513 Sample No. Lab Number

: 06133350 Unique Number : 10952815 Test Package : IND 2

: USPM36933 Received **Tested**

: 05 Apr 2024 Diagnosed

: 05 Apr 2024 - Doug Bogart

: 29 Mar 2024

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

KraftHeinz - Kirksville - Plant 8333 USP

2504 INDUSTRIAL RD KIRKSVILLE, MO

US 63501 Contact: LARRY WISKIRCHEN

larry.wiskirchen@kraftfoods.com T: (660)627-1031