




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

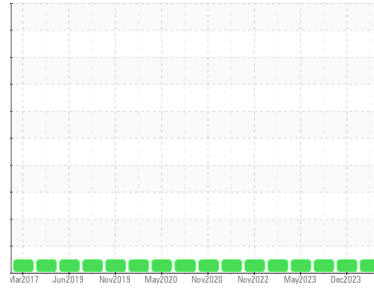

Machine Id  
**VACUUM 10B (S/N FM362035)**

Component  
**Pump**

Fluid  
**USPI VAC 100 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>USPM36947</b>	USPM31807	USPM29713
Sample Date	Client Info		<b>25 Mar 2024</b>	18 Dec 2023	12 Sep 2023
Machine Age	hrs	Client Info	<b>0</b>	0	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >90	<b>0</b>	1	1
Chromium	ppm	ASTM D5185m >5	<b>&lt;1</b>	<1	0
Nickel	ppm	ASTM D5185m >5	<b>&lt;1</b>	0	0
Titanium	ppm	ASTM D5185m >3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >3	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >7	<b>&lt;1</b>	0	0
Lead	ppm	ASTM D5185m >12	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >30	<b>0</b>	0	0
Tin	ppm	ASTM D5185m >9	<b>&lt;1</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	<1
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	<1

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 0	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	0	<1
Magnesium	ppm	ASTM D5185m 0	<b>0</b>	0	0
Calcium	ppm	ASTM D5185m 0	<b>0</b>	<1	0
Phosphorus	ppm	ASTM D5185m 1800	<b>465</b>	502	484
Zinc	ppm	ASTM D5185m 0	<b>0</b>	0	0
Sulfur	ppm	ASTM D5185m 0	<b>0</b>	0	6

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >60	<b>14</b>	14	15
Sodium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Potassium	ppm	ASTM D5185m >20	<b>2</b>	<1	3
Water	%	ASTM D6304 >.1	<b>0.004</b>	0.007	0.015
ppm Water	ppm	ASTM D6304 >1000	<b>49</b>	77	155.4

## FLUID CLEANLINESS






	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>5000	<b>402</b>	355	399
Particles >6µm	ASTM D7647	>1300	<b>56</b>	98	159
Particles >14µm	ASTM D7647	>160	<b>8</b>	9	22
Particles >21µm	ASTM D7647	>40	<b>3</b>	2	7
Particles >38µm	ASTM D7647	>10	<b>0</b>	0	0
Particles >71µm	ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>19/17/14	<b>16/13/10</b>	16/14/10	16/14/12

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.05	<b>0.15</b>	0.10	0.083




# OIL ANALYSIS REPORT

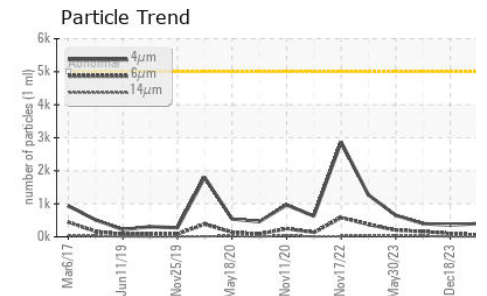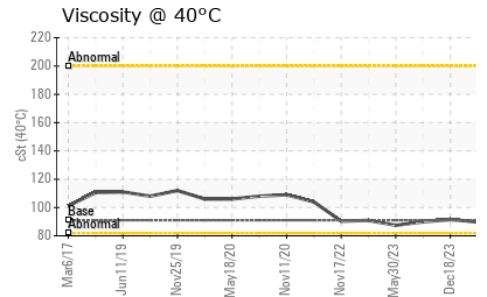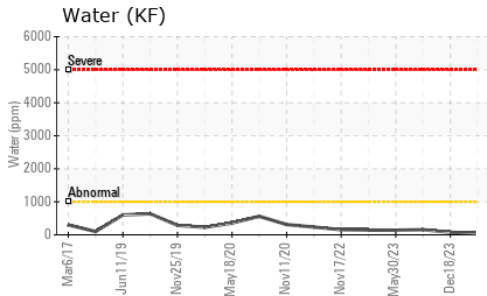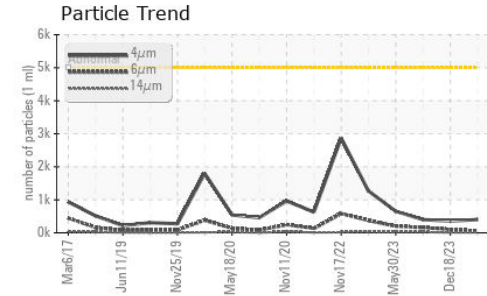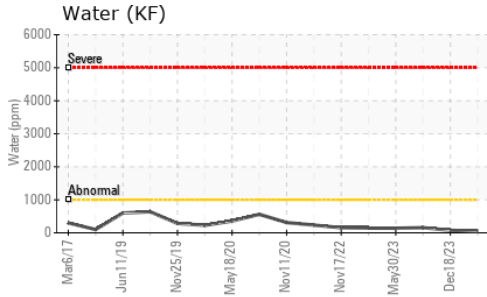






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 91	89.8	91.6	89.9

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

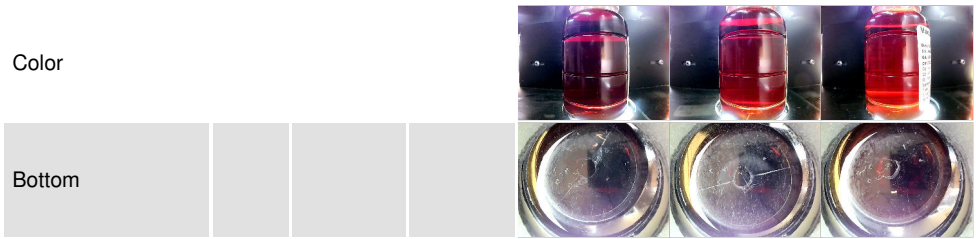

## GRAPHS

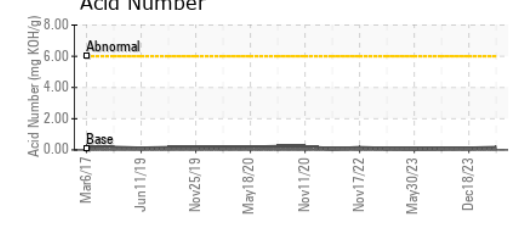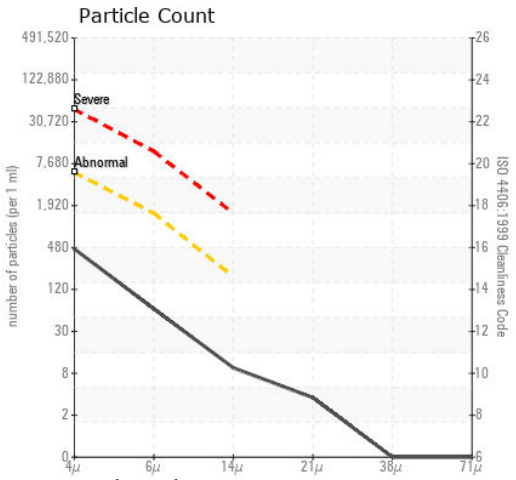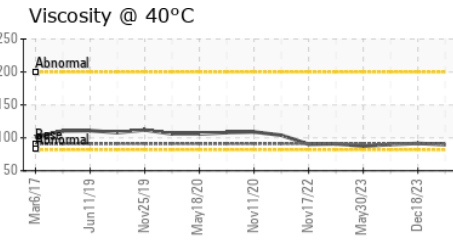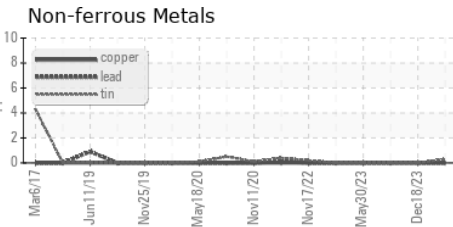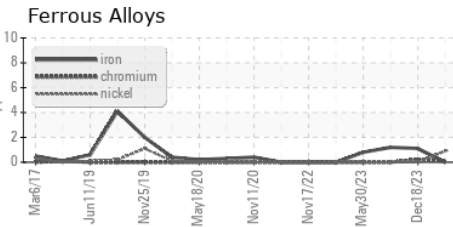

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : USPM36947  
**Lab Number** : 06133359  
**Unique Number** : 10952824  
**Test Package** : IND 2  
**Received** : 29 Mar 2024  
**Tested** : 01 Apr 2024  
**Diagnosed** : 01 Apr 2024 - Doug Bogart

**CARGILL MEAT**  
 DODGE CITY, KS  
 US  
 Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: