


# **OIL ANALYSIS REPORT**

## Sample Rating Trend



**NORMAL** 



# KR-FA-007006 - COMP 7 (S/N 63560)

**Refrigeration Compressor** 

USPI 1009-68 SC (--- GAL)

### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


		Aar2018 Nova	018 Jun2019 Oct2019	Jul2021 Sep2022 Jul2023	Jan2024	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USP0008251	USP0005273	USP0001176
Sample Date		Client Info		30 Mar 2024	10 Jan 2024	15 Oct 2023
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	0	0	0
Chromium	ppm	ASTM D5185m	>2	<1	0	0
Nickel	ppm	ASTM D5185m		<1	0	<1
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>3	<1	0	0
Lead	ppm	ASTM D5185m	>2	0	0	<1
Copper	ppm	ASTM D5185m	>8	0	0	0
Tin	ppm	ASTM D5185m	>4	<1	0	<1
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m		0	0	0
Calcium	ppm	ASTM D5185m		0	0	0
Phosphorus	ppm	ASTM D5185m		0	0	0
Zinc	ppm	ASTM D5185m		0	0	<1
Sulfur	ppm	ASTM D5185m	50	0	0	0
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	15	13	16
Sodium	ppm	ASTM D5185m		<1	0	0
Potassium	ppm	ASTM D5185m	>20	<1	0	<1
Water	%	ASTM D6304	>0.01	0.004	0.003	0.001
ppm Water	ppm	ASTM D6304		41	28	11.8
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	1399	989	379
Particles >6µm		ASTM D7647	>2500	261	229	101
Particles >14µm		ASTM D7647	>640	15	20	8
Particles >21µm		ASTM D7647	>160	4	4	2
Particles >38µm		ASTM D7647	>40	0	1	0
Particles >71µm		ASTM D7647	>10	0	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/16	18/15/11	17/15/11	16/14/10
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	0.005	0.028	0.015	0.012





## **OIL ANALYSIS REPORT**




Par 300k T	ticle T	rend					
250k -	4µ 6µ 14j	m m um					
200k		1					
7 1000		1					
100k		1	Λ				
150k 100k 50k Abr	Ottoral Advisory	Jun26/19	0c427/19	Jul21/21	Sep15/22	Jul10/23	Jan10/24








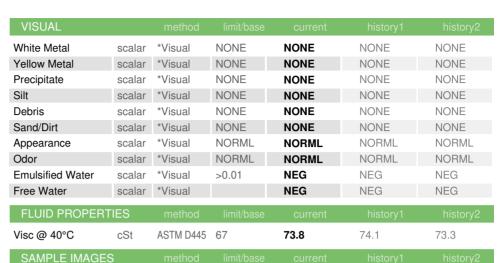

Color





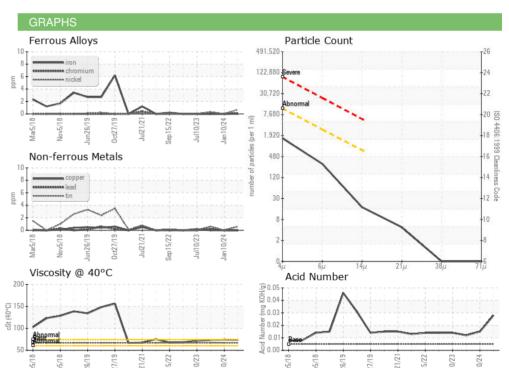





Certificate L2367

Laboratory Sample No. Lab Number

: USP0008251 : 06133422 Unique Number: 10952887 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 29 Mar 2024 : 01 Apr 2024 **Tested** 

: 01 Apr 2024 - Doug Bogart Diagnosed

KraftHeinz - Kirksville - Plant 8333 USP

2504 INDUSTRIAL RD KIRKSVILLE, MO US 63501

Contact: THOMAS BARRETT thomas.barrett@kraftheinz.com

To discuss this sample report, contact Customer Service at 1-800-237-1369. \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: