




OIL ANALYSIS REPORT

Sample Rating Trend

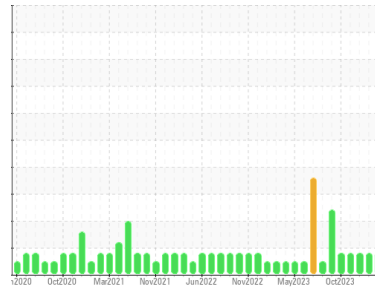

WEAR



Machine Id
P-1301A

Component
Pump

Fluid
ROYAL PURPLE SYNFILM GT 150 (3 GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

The copper level is abnormal. All other component wear rates are normal.

Contamination

The water content is negligible. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		RP0042947	RP0042958	RP0042451
Sample Date	Client Info		22 Mar 2024	01 Mar 2024	12 Feb 2024
Machine Age	hrs	Client Info	81925	81825	18253
Oil Age	hrs	Client Info	18603	18503	17931
Oil Changed	Client Info		Not Chngd	Not Chngd	Not Chngd
Sample Status			ABNORMAL	ABNORMAL	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >90	15	16	15
Chromium	ppm	ASTM D5185m >5	<1	<1	<1
Nickel	ppm	ASTM D5185m >5	<1	0	0
Titanium	ppm	ASTM D5185m >3	0	0	0
Silver	ppm	ASTM D5185m >3	0	0	0
Aluminum	ppm	ASTM D5185m >7	<1	2	<1
Lead	ppm	ASTM D5185m >12	0	<1	0
Copper	ppm	ASTM D5185m >30	▲ 47	▲ 48	▲ 41
Tin	ppm	ASTM D5185m >9	1	1	1
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m	0	0	0
Molybdenum	ppm	ASTM D5185m	2	3	2
Manganese	ppm	ASTM D5185m	<1	0	<1
Magnesium	ppm	ASTM D5185m	142	157	174
Calcium	ppm	ASTM D5185m	79	99	96
Phosphorus	ppm	ASTM D5185m	80	97	100
Zinc	ppm	ASTM D5185m	113	133	133

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >60	7	8	8
Sodium	ppm	ASTM D5185m	3	0	<1
Potassium	ppm	ASTM D5185m >20	1	<1	1
Water	%	ASTM D6304 >.1	0.017	0.014	0.028
ppm Water	ppm	ASTM D6304 >1000	174	145	282





FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.29	0.18	0.20

VISUAL

	method	limit/base	current	history1	history2
White Metal	scalar	*Visual NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual NONE	NONE	NONE	NONE
Silt	scalar	*Visual NONE	NONE	NONE	NONE
Debris	scalar	*Visual NONE	NONE	LIGHT	LIGHT
Sand/Dirt	scalar	*Visual NONE	NONE	NONE	NONE
Appearance	scalar	*Visual NORML	NORML	NORML	NORML
Odor	scalar	*Visual NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual >.1	NEG	NEG	NEG
Free Water	scalar	*Visual	NEG	NEG	NEG

OIL ANALYSIS REPORT

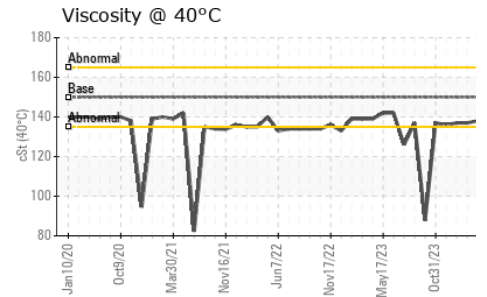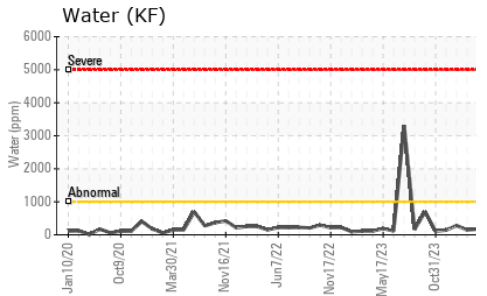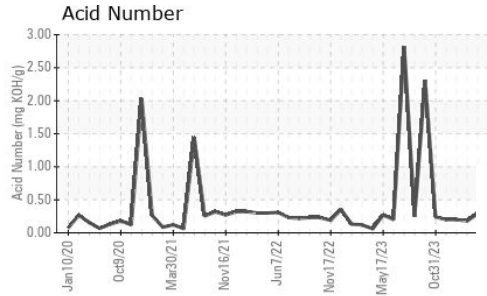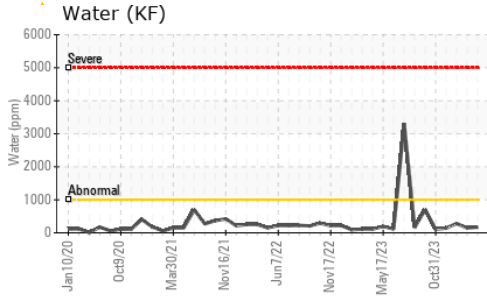

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 150	138	137	137





SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color

Bottom



GRAPHS

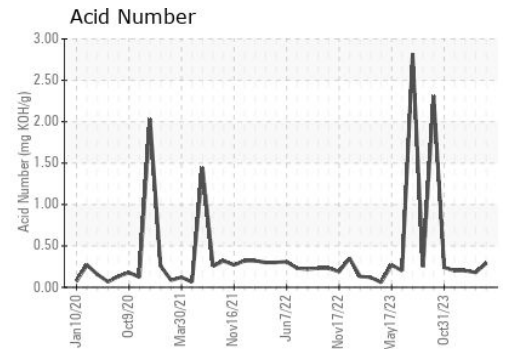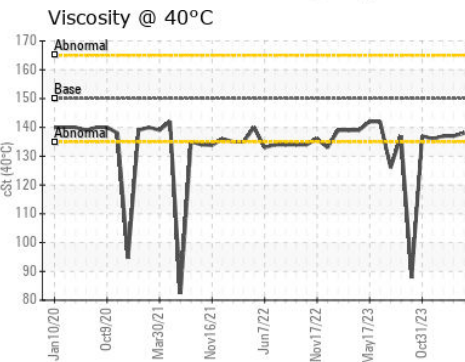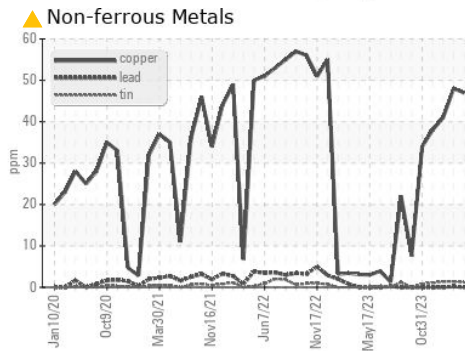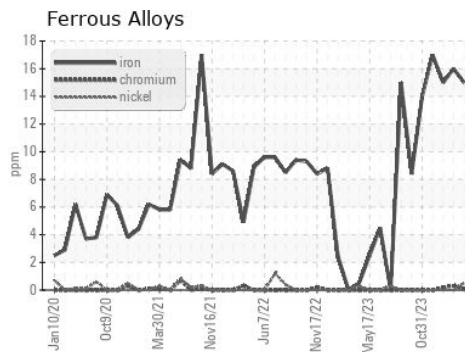

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : RP0042947
Lab Number : **06133477**
Unique Number : 10952942
Test Package : IND 2

Received : 29 Mar 2024
Tested : 01 Apr 2024
Diagnosed : 03 Apr 2024 - Jonathan Hester

TEAM SUR S.A.S.

BOGOTA,
CO
Contact: Team Sur
jconde@teamsur.com
T: (300)740-0654
F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)