OIL ANALYSIS REPORT

Area
{UNASSIGNED}
Machine Id
P-5220-A (S/N 001)
Component
Pump
Fluid
ROYAL PURPLE SYNDRAULIC 68 (1 GAL)

Sample Rating Trend

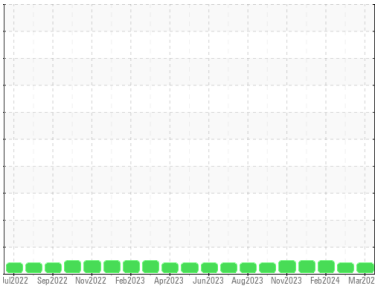

VISCOSITY

DIAGNOSIS

Recommendation
No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear
All component wear rates are normal.

Contamination
The water content is negligible. There is no indication of any contamination in the oil.

Fluid Condition
The oil viscosity is lower than normal. The AN level is acceptable for this fluid.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**RP0043763**	RP0042956	RP0039578
Sample Date		Client Info		**22 Mar 2024**	01 Mar 2024	12 Feb 2024
Machine Age	hrs	Client Info		**24351**	24326	24319
Oil Age	hrs	Client Info		**2061**	2036	2029
Oil Changed		Client Info		**Not Changd**	Not Changd	Not Changd
Sample Status				**ATTENTION**	ATTENTION	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>90	**0**	0	0
Chromium	ppm	ASTM D5185m	>5	**<1**	<1	<1
Nickel	ppm	ASTM D5185m	>5	**<1**	0	0
Titanium	ppm	ASTM D5185m	>3	**0**	0	0
Silver	ppm	ASTM D5185m	>3	**0**	0	0
Aluminum	ppm	ASTM D5185m	>7	**<1**	2	0
Lead	ppm	ASTM D5185m	>12	**0**	<1	0
Copper	ppm	ASTM D5185m	>30	**5**	5	4
Tin	ppm	ASTM D5185m	>9	**0**	0	0
Vanadium	ppm	ASTM D5185m		**0**	0	0
Cadmium	ppm	ASTM D5185m		**0**	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		**0**	0	0
Barium	ppm	ASTM D5185m		**0**	0	0
Molybdenum	ppm	ASTM D5185m		**0**	0	0
Manganese	ppm	ASTM D5185m		**0**	0	0
Magnesium	ppm	ASTM D5185m		**0**	1	2
Calcium	ppm	ASTM D5185m		**96**	116	122
Phosphorus	ppm	ASTM D5185m		**572**	581	567
Zinc	ppm	ASTM D5185m		**630**	640	713

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>60	**<1**	<1	<1
Sodium	ppm	ASTM D5185m		**<1**	0	0
Potassium	ppm	ASTM D5185m	>20	**<1**	<1	<1
Water	%	ASTM D6304	>.1	**0.007**	0.005	0.006
ppm Water	ppm	ASTM D6304	>1000	**77**	60	61

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		**0.66**	0.65	0.64

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Precipitate	scalar	*Visual	NONE	**NONE**	NONE	NONE
Silt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Debris	scalar	*Visual	NONE	**NONE**	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Appearance	scalar	*Visual	NORML	**NORML**	NORML	NORML
Odor	scalar	*Visual	NORML	**NORML**	NORML	NORML
Emulsified Water	scalar	*Visual	>.1	**NEG**	NEG	NEG
Free Water	scalar	*Visual		**NEG**	NEG	NEG

OIL ANALYSIS REPORT

Water (KF)

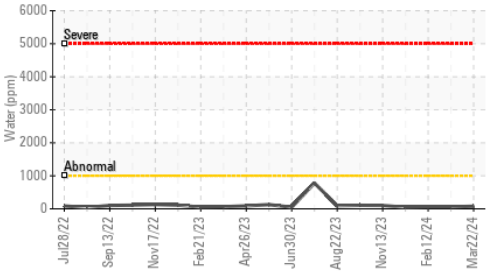

Acid Number

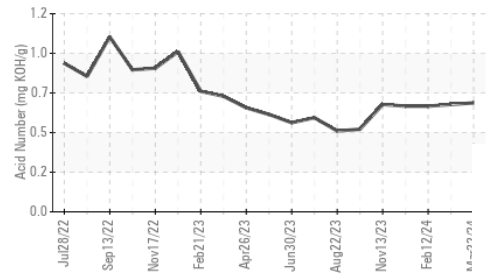

Water (KF)

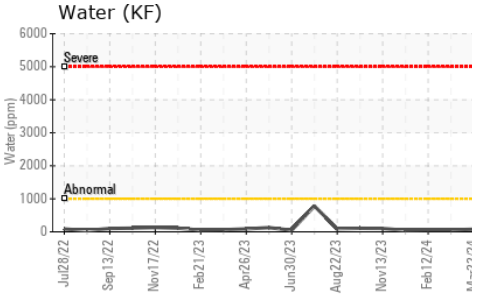

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	68.0	**53.4**	55.5	58.0

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

GRAPHS

Ferrous Alloys

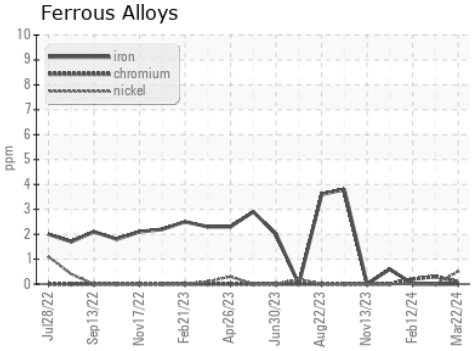

Non-ferrous Metals

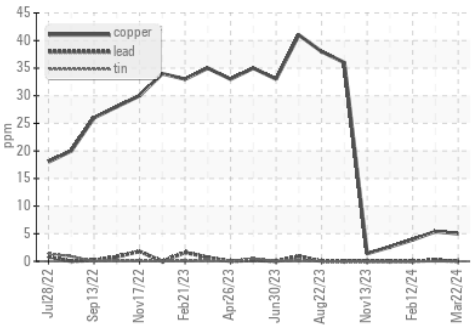

Viscosity @ 40°C

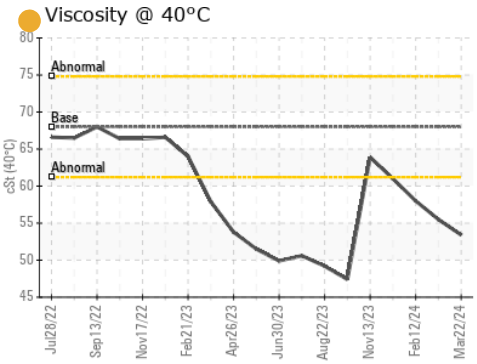

Acid Number

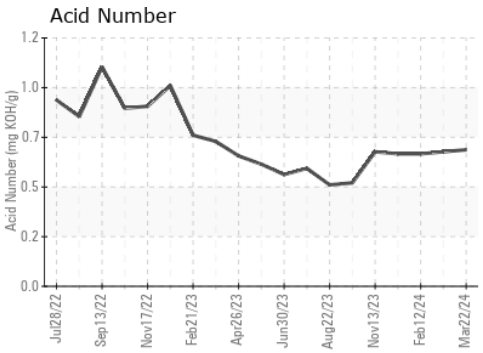

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : RP0043763
Lab Number : 06133491
Unique Number : 10952956
Test Package : IND 2

Received : 29 Mar 2024
Tested : 01 Apr 2024
Diagnosed : 03 Apr 2024 - Jonathan Hester

To discuss this sample report, contact Customer Service at 1-800-237-1369.
** - Denotes test methods that are outside of the ISO 17025 scope of accreditation.*
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

TEAM SUR S.A.S.
BOGOTA, CO
Contact: Team Sur
jconde@teamsur.com
T: (300)740-0654
F: