



OIL ANALYSIS REPORT

Sample Rating Trend



VISCOSITY



Machine Id
1369167 (S/N 01810942)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

▲ Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

There is a high amount of particulates present in the oil.

▲ Fluid Condition

The oil viscosity is higher than normal. The AN level is acceptable for this fluid.

SAMPLE INFORMATION	method	limit/base	current	history1	history2
Sample Number	Client Info		KCPA013981	---	---
Sample Date	Client Info		25 Mar 2024	---	---
Machine Age	hrs	Client Info	24275	---	---
Oil Age	hrs	Client Info	0	---	---
Oil Changed	Client Info		Changed	---	---
Sample Status			ABNORMAL	---	---

WEAR METALS	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	0	---	---
Chromium	ppm	ASTM D5185m >10	0	---	---
Nickel	ppm	ASTM D5185m >3	0	---	---
Titanium	ppm	ASTM D5185m >3	0	---	---
Silver	ppm	ASTM D5185m >2	0	---	---
Aluminum	ppm	ASTM D5185m >10	0	---	---
Lead	ppm	ASTM D5185m >10	0	---	---
Copper	ppm	ASTM D5185m >50	3	---	---
Tin	ppm	ASTM D5185m >10	0	---	---
Vanadium	ppm	ASTM D5185m	<1	---	---
Cadmium	ppm	ASTM D5185m	0	---	---






ADDITIVES	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	0	---	---
Barium	ppm	ASTM D5185m 90	0	---	---
Molybdenum	ppm	ASTM D5185m 0	0	---	---
Manganese	ppm	ASTM D5185m	0	---	---
Magnesium	ppm	ASTM D5185m 100	0	---	---
Calcium	ppm	ASTM D5185m 0	<1	---	---
Phosphorus	ppm	ASTM D5185m 0	421	---	---
Zinc	ppm	ASTM D5185m 0	11	---	---
Sulfur	ppm	ASTM D5185m 23500	4282	---	---

CONTAMINANTS	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<1	---	---
Sodium	ppm	ASTM D5185m	2	---	---
Potassium	ppm	ASTM D5185m >20	0	---	---
Water	%	ASTM D6304 >0.05	0.005	---	---
ppm Water	ppm	ASTM D6304 >500	51	---	---

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		8960	---	---
Particles >6µm	ASTM D7647	>1300	▲ 2345	---	---
Particles >14µm	ASTM D7647	>80	▲ 255	---	---
Particles >21µm	ASTM D7647	>20	▲ 70	---	---
Particles >38µm	ASTM D7647	>4	3	---	---
Particles >71µm	ASTM D7647	>3	0	---	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 20/18/15	---	---

FLUID DEGRADATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	0.25	---	---

OIL ANALYSIS REPORT

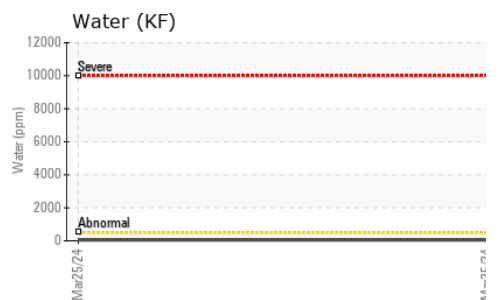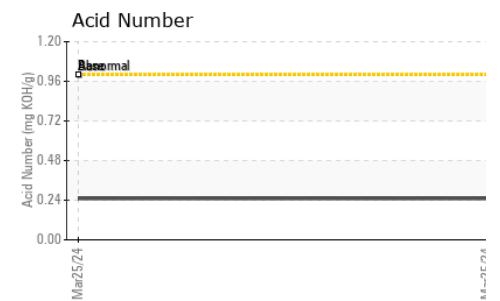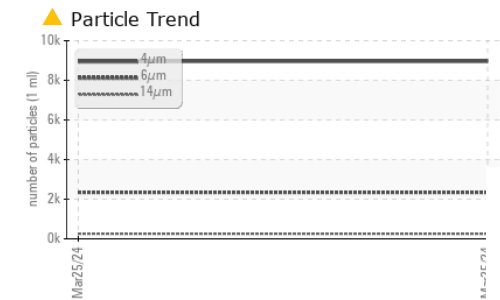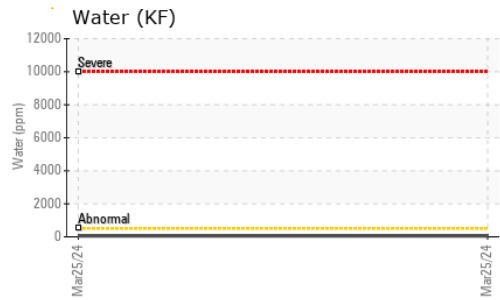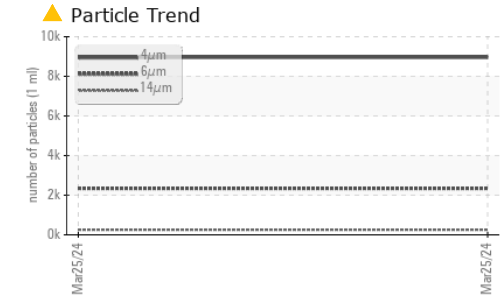



VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	▲ 61.58	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color		no image	no image
Bottom		no image	no image

GRAPHS

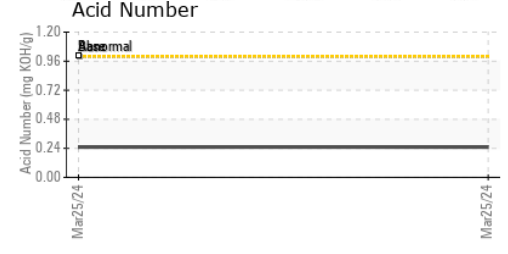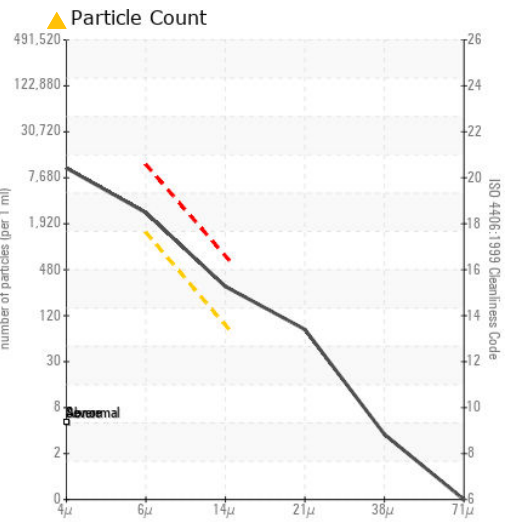

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA013981 **Received** : 29 Mar 2024
Lab Number : 06134020 **Tested** : 05 Apr 2024
Unique Number : 10953485 **Diagnosed** : 05 Apr 2024 - Jonathan Hester
Test Package : IND 2 (Additional Tests: KF, PrtCount)

WRENS CABINET
 1059 TWIN OAKS RD
 WRENS, GA
 US 30833
 Contact: Service Manager
 goofysax@gmail.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)