




Machine Id
PALATEK 08D032 - FORTERRA PIPE
 Component
Compressor
 Fluid
QUINCY QUINSYN (--- GAL)

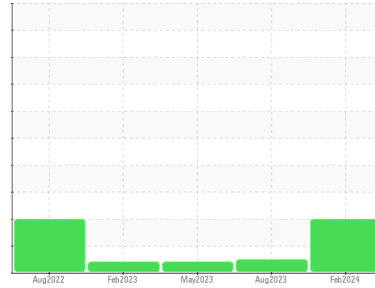

DIAGNOSIS

Recommendation
 No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.

Wear
 All component wear rates are normal.

Contamination
 Moderate concentration of visible dirt/debris present in the oil. There is a light concentration of water present in the oil.

Fluid Condition
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		TO50001852	QUC0000588	QUC0000496
Sample Date	Client Info		16 Feb 2024	17 Aug 2023	15 May 2023
Machine Age	hrs	Client Info	27949	27284	26841
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	Changed	Not Chngd
Sample Status			ABNORMAL	NORMAL	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<1	<1	0
Chromium	ppm	ASTM D5185m >10	0	0	<1
Nickel	ppm	ASTM D5185m	0	0	<1
Titanium	ppm	ASTM D5185m	0	0	<1
Silver	ppm	ASTM D5185m	0	0	0
Aluminum	ppm	ASTM D5185m >25	0	0	<1
Lead	ppm	ASTM D5185m >25	0	0	0
Copper	ppm	ASTM D5185m >50	<1	0	<1
Tin	ppm	ASTM D5185m >15	<1	0	0
Vanadium	ppm	ASTM D5185m	<1	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	2
Manganese	ppm	ASTM D5185m	0	<1	<1
Magnesium	ppm	ASTM D5185m	0	2	11
Calcium	ppm	ASTM D5185m	0	2	0
Phosphorus	ppm	ASTM D5185m	272	0	101
Zinc	ppm	ASTM D5185m	0	99	73
Sulfur	ppm	ASTM D5185m	337	1202	1016

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<1	<1	<1
Sodium	ppm	ASTM D5185m	2	15	12
Potassium	ppm	ASTM D5185m >20	0	0	1
Water	%	ASTM D6304 >0.1	▲ 0.113	0.006	0.007
ppm Water	ppm	ASTM D6304 >1000	▲ 1130	68.8	76.6





FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	---	7757	---
Particles >6µm	ASTM D7647	>2500	---	1504	---
Particles >14µm	ASTM D7647	>320	---	92	---
Particles >21µm	ASTM D7647	>80	---	29	---
Particles >38µm	ASTM D7647	>20	---	3	---
Particles >71µm	ASTM D7647	>4	---	1	---
Oil Cleanliness	ISO 4406 (c)	>20/18/15	---	20/18/14	---

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 .10	0.25	0.19	0.18


OIL ANALYSIS REPORT

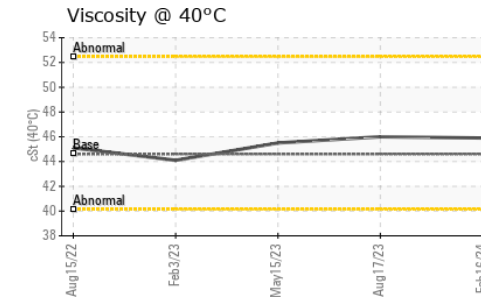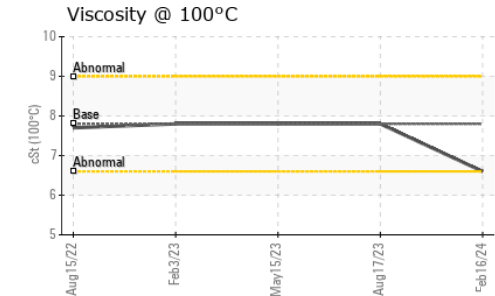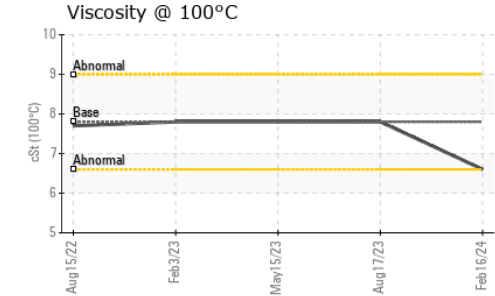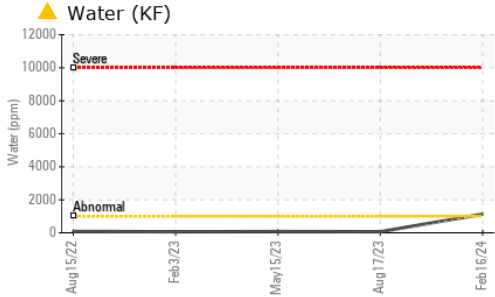





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	▲ MODER	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	0.2%	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	44.6	45.9	46.0
Visc @ 100°C	cSt	ASTM D445	7.8	6.6	7.8
Viscosity Index (VI)	Scale	ASTM D2270	132	93	139

SAMPLE IMAGES

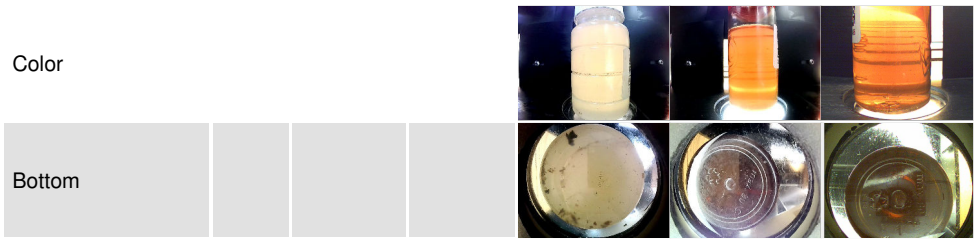

GRAPHS

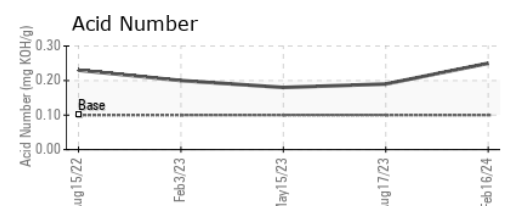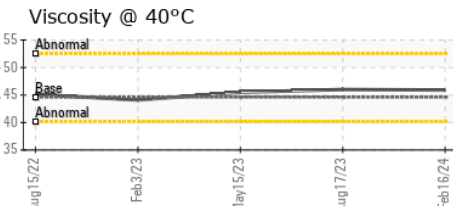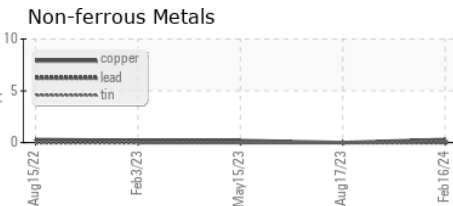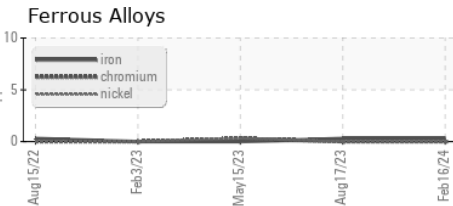

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : TO50001852 **Received** : 29 Mar 2024
Lab Number : 06134092 **Tested** : 03 Apr 2024
Unique Number : 10953557 **Diagnosed** : 03 Apr 2024 - Don Baldrige
Test Package : IND 2 (Additional Tests: KF, KV100, PrtCount, VI)

QUALITY COMPRESSOR
 4428 CR 616
 ALVARADO, TX
 US 76009
 Contact: SEAN
 SEAN@QCOMPRESSOR.COM
 T: (817)822-1333
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)