




# OIL ANALYSIS REPORT

Sample Rating Trend

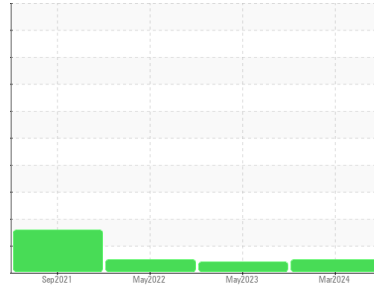

**NORMAL**



Machine Id  
**Westchester des 10 doosan lightowers 495832uiadg79**

Component  
**Diesel Engine**

Fluid  
**DIESEL ENGINE OIL SAE 15W40 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor. Please specify the component make and model with your next sample.

### Wear

Metal levels are typical for a new component breaking in.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WC0878345</b>	WC0799900	WC0651449
Sample Date	Client Info			<b>20 Mar 2024</b>	02 May 2023	03 May 2022
Machine Age	hrs	Client Info		<b>621</b>	595	594
Oil Age	hrs	Client Info		<b>0</b>	0	0
Oil Changed	Client Info			<b>Changed</b>	Changed	Changed
Sample Status				<b>NORMAL</b>	ATTENTION	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Fuel	WC Method	>5		<b>&lt;1.0</b>	0.4	<1.0
Water	WC Method	>0.2		<b>NEG</b>	NEG	NEG
Glycol	WC Method			<b>NEG</b>	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>100	<b>5</b>	<1	5
Chromium	ppm	ASTM D5185m	>20	<b>0</b>	<1	<1
Nickel	ppm	ASTM D5185m	>4	<b>0</b>	<1	0
Titanium	ppm	ASTM D5185m		<b>0</b>	<1	0
Silver	ppm	ASTM D5185m	>3	<b>0</b>	0	<1
Aluminum	ppm	ASTM D5185m	>20	<b>&lt;1</b>	<1	2
Lead	ppm	ASTM D5185m	>40	<b>0</b>	7	<1
Copper	ppm	ASTM D5185m	>330	<b>0</b>	<1	5
Tin	ppm	ASTM D5185m	>15	<b>0</b>	<1	0
Antimony	ppm	ASTM D5185m		<b>---</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	<1	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	250	<b>5</b>	22	68
Barium	ppm	ASTM D5185m	10	<b>0</b>	0	1
Molybdenum	ppm	ASTM D5185m	100	<b>65</b>	49	46
Manganese	ppm	ASTM D5185m		<b>0</b>	<1	2
Magnesium	ppm	ASTM D5185m	450	<b>1058</b>	589	427
Calcium	ppm	ASTM D5185m	3000	<b>1213</b>	1392	1901
Phosphorus	ppm	ASTM D5185m	1150	<b>1100</b>	907	753
Zinc	ppm	ASTM D5185m	1350	<b>1294</b>	1133	916
Sulfur	ppm	ASTM D5185m	4250	<b>4258</b>	3531	2836



CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>6</b>	8	22
Sodium	ppm	ASTM D5185m	>158	<b>0</b>	1	2
Potassium	ppm	ASTM D5185m	>20	<b>1</b>	7	0

INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	>3	<b>0</b>	0	0.1
Nitration	Abs/cm	*ASTM D7624	>20	<b>4.6</b>	4.3	4.7
Sulfation	Abs/.1mm	*ASTM D7415	>30	<b>17.3</b>	15.3	20.7

FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	>25	<b>13.2</b>	10.1	17.7
Base Number (BN)	mg KOH/g	ASTM D2896	8.5	<b>9.9</b>	8.3	10.5











# OIL ANALYSIS REPORT

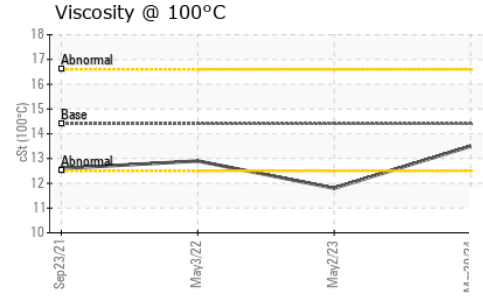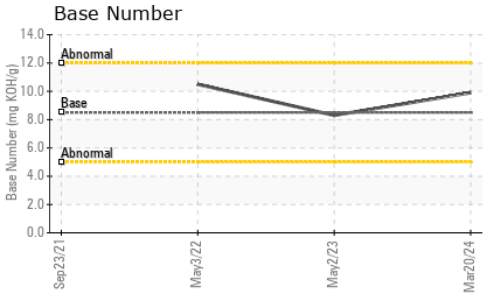

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 100°C	cSt	ASTM D445	14.4	13.5	11.8	12.9

### GRAPHS

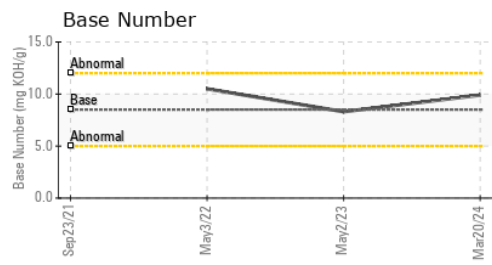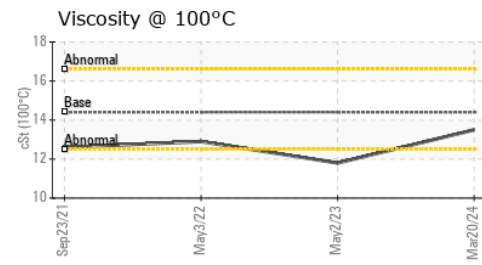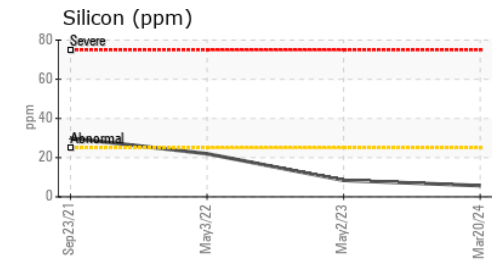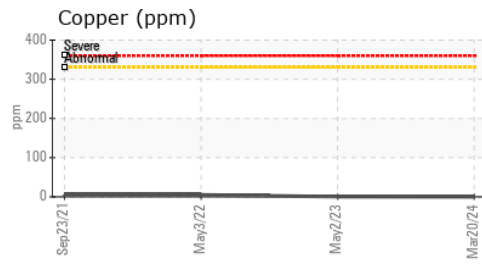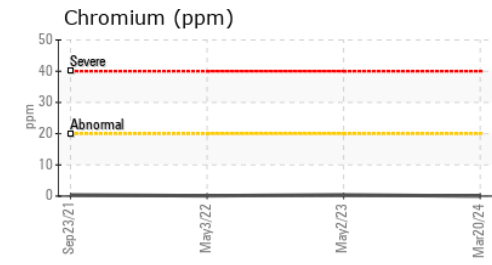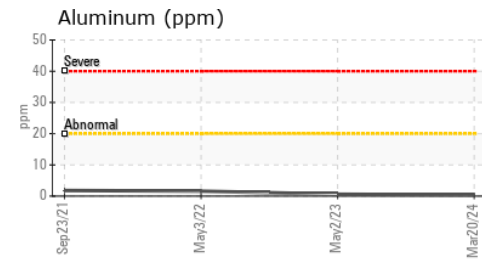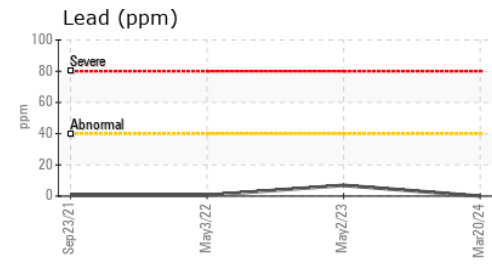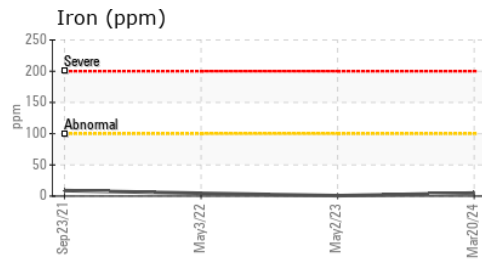

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0878345      **Received** : 01 Apr 2024  
**Lab Number** : 06134609      **Tested** : 02 Apr 2024  
**Unique Number** : 10954074      **Diagnosed** : 02 Apr 2024 - Wes Davis  
**Test Package** : MOB 1 ( Additional Tests: TBN )

**GEN TECH LTD**  
 3017 RT 9W  
 NEW WINDSOR, NY  
 US 12553  
 Contact: JOE SAYEGH  
 joe@gentechltd.com  
 T: (845)568-0500  
 F: (845)568-3073

Certificate L2367  
 To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)