




OIL ANALYSIS REPORT

Sample Rating Trend

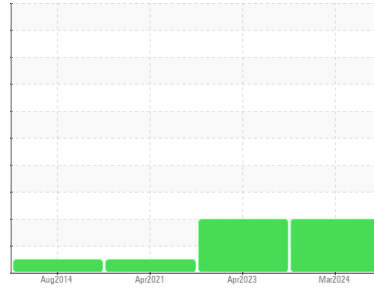

ISO



Machine Id
KAESER DS 171 1428029 (S/N 1750007)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

| method | limit/base | current | history1 | history2 |
|---------------|-------------|--------------------|-------------|-------------|
| Sample Number | Client Info | KC122632 | KC102035 | KC86378 |
| Sample Date | Client Info | 18 Mar 2024 | 25 Apr 2023 | 21 Apr 2021 |
| Machine Age | hrs | 90877 | 87875 | 80707 |
| Oil Age | hrs | 0 | 7000 | 7000 |
| Oil Changed | Client Info | N/A | Changed | Changed |
| Sample Status | | ABNORMAL | ABNORMAL | NORMAL |

WEAR METALS

| method | limit/base | current | history1 | history2 | |
|----------|------------|-----------------|--------------|----------|----|
| Iron | ppm | ASTM D5185m >50 | <1 | 0 | <1 |
| Chromium | ppm | ASTM D5185m >10 | 0 | 0 | 0 |
| Nickel | ppm | ASTM D5185m >3 | <1 | 0 | 0 |
| Titanium | ppm | ASTM D5185m >3 | 0 | 0 | 0 |
| Silver | ppm | ASTM D5185m >2 | 0 | 0 | <1 |
| Aluminum | ppm | ASTM D5185m >10 | 0 | <1 | 0 |
| Lead | ppm | ASTM D5185m >10 | 0 | 0 | 0 |
| Copper | ppm | ASTM D5185m >50 | 2 | 9 | 4 |
| Tin | ppm | ASTM D5185m >10 | 0 | 0 | <1 |
| Antimony | ppm | ASTM D5185m | --- | --- | 1 |
| Vanadium | ppm | ASTM D5185m | <1 | 0 | 0 |
| Cadmium | ppm | ASTM D5185m | 0 | 0 | 0 |

ADDITIVES

| method | limit/base | current | history1 | history2 | |
|------------|------------|----------------|--------------|----------|----|
| Boron | ppm | ASTM D5185m | 0 | 0 | <1 |
| Barium | ppm | ASTM D5185m 90 | 6 | 0 | 2 |
| Molybdenum | ppm | ASTM D5185m | 0 | 0 | 0 |
| Manganese | ppm | ASTM D5185m | <1 | <1 | <1 |
| Magnesium | ppm | ASTM D5185m 90 | 41 | 3 | 22 |
| Calcium | ppm | ASTM D5185m 2 | 0 | 0 | 0 |
| Phosphorus | ppm | ASTM D5185m | 0 | 0 | 5 |
| Zinc | ppm | ASTM D5185m | 8 | 11 | 33 |

CONTAMINANTS

| method | limit/base | current | history1 | history2 | |
|-----------|------------|------------------|--------------|----------|-------|
| Silicon | ppm | ASTM D5185m >25 | <1 | 0 | <1 |
| Sodium | ppm | ASTM D5185m | 17 | 1 | 8 |
| Potassium | ppm | ASTM D5185m >20 | 5 | 0 | 1 |
| Water | % | ASTM D6304 >0.05 | 0.013 | 0.006 | 0.021 |
| ppm Water | ppm | ASTM D6304 >500 | 140 | 63.3 | 217.8 |






FLUID CLEANLINESS

| method | limit/base | current | history1 | history2 |
|-----------------|------------------------|-------------------|------------|----------|
| Particles >4µm | ASTM D7647 | 9689 | 17665 | 1848 |
| Particles >6µm | ASTM D7647 >1300 | ▲ 3740 | ▲ 6039 | 317 |
| Particles >14µm | ASTM D7647 >80 | ▲ 376 | ▲ 456 | 17 |
| Particles >21µm | ASTM D7647 >20 | ▲ 100 | ▲ 128 | 5 |
| Particles >38µm | ASTM D7647 >4 | ▲ 6 | ▲ 5 | 0 |
| Particles >71µm | ASTM D7647 >3 | 0 | 1 | 0 |
| Oil Cleanliness | ISO 4406 (c) >--/17/13 | ▲ 20/19/16 | ▲ 21/20/16 | 15/11 |

FLUID DEGRADATION

| method | limit/base | current | history1 | history2 | |
|------------------|------------|----------------|-------------|----------|-------|
| Acid Number (AN) | mg KOH/g | ASTM D8045 0.4 | 0.40 | 0.47 | 0.381 |

OIL ANALYSIS REPORT

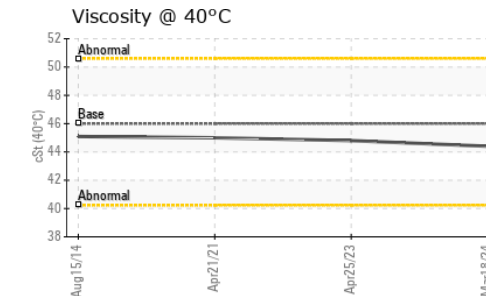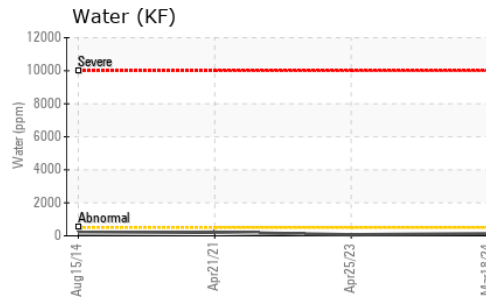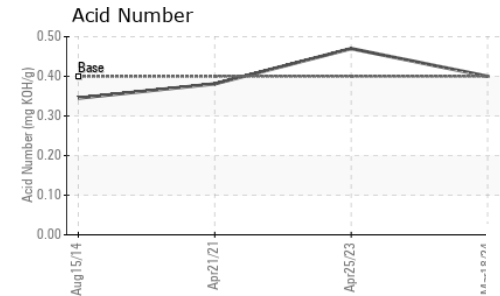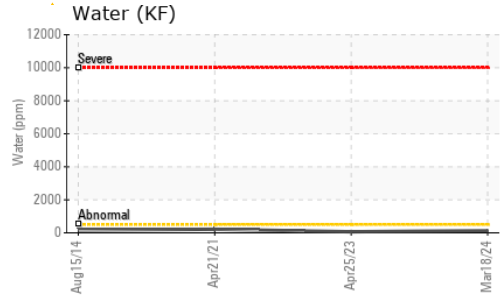
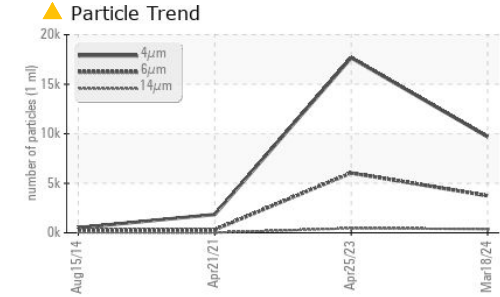


| PARAMETER | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| White Metal | scalar | *Visual | NONE | NONE | NONE |
| Yellow Metal | scalar | *Visual | NONE | NONE | NONE |
| Precipitate | scalar | *Visual | NONE | NONE | NONE |
| Silt | scalar | *Visual | NONE | NONE | NONE |
| Debris | scalar | *Visual | NONE | LIGHT | NONE |
| Sand/Dirt | scalar | *Visual | NONE | NONE | NONE |
| Appearance | scalar | *Visual | NORML | NORML | NORML |
| Odor | scalar | *Visual | NORML | NORML | NORML |
| Emulsified Water | scalar | *Visual | >0.05 | NEG | NEG |
| Free Water | scalar | *Visual | | NEG | NEG |

| FLUID PROPERTIES | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| Visc @ 40°C | cSt | ASTM D445 | 46 | 44.8 | 45.0 |

| SAMPLE IMAGES | method | limit/base | current | history1 | history2 |
|---------------|--------|------------|---------|----------|----------|
| Color | | | | | |
| Bottom | | | | | |

GRAPHS

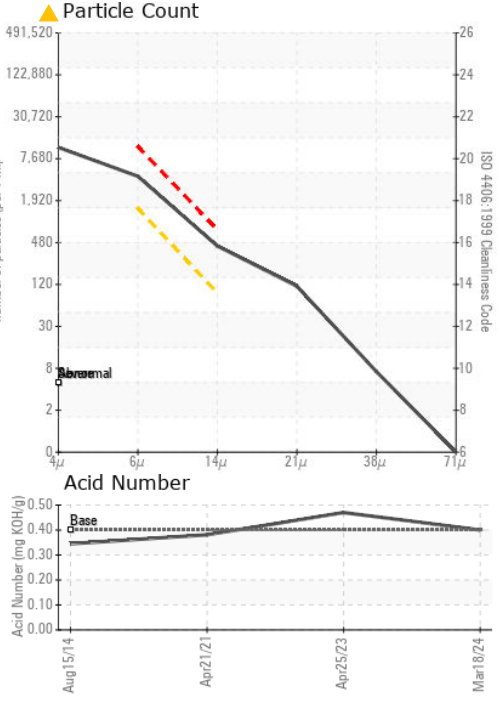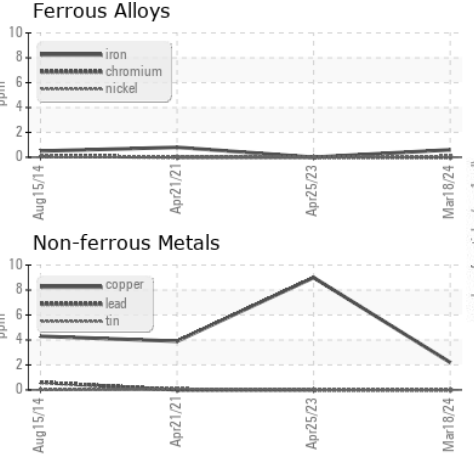

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC122632
Lab Number : 06134889
Unique Number : 10954354
Test Package : IND 2
Received : 01 Apr 2024
Tested : 02 Apr 2024
Diagnosed : 03 Apr 2024 - Don Baldrige

NORTH AMERICAN HOGANAS
 101 BRIDGE ST
 JOHNSTOWN, PA
 US 15902
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)