


OIL ANALYSIS REPORT

Sample Rating Trend



ISO

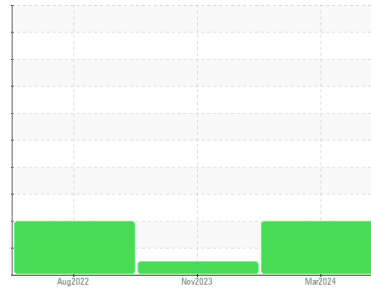

Machine Id
8379922 (S/N 1332)

Component
Compressor

Fluid
KAESER SIGMA (OEM) S-460 (--- QTS)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	KC125839	KC125739	KC97082
Sample Date	Client Info	22 Mar 2024	03 Nov 2023	25 Aug 2022
Machine Age	hrs	15974	13560	3501
Oil Age	hrs	0	0	3501
Oil Changed	Client Info	N/A	N/A	Changed
Sample Status		ABNORMAL	NORMAL	ABNORMAL

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	0	0	<1
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m >3	<1	0	0
Titanium	ppm	ASTM D5185m >3	0	<1	0
Silver	ppm	ASTM D5185m >2	0	0	0
Aluminum	ppm	ASTM D5185m >10	<1	0	<1
Lead	ppm	ASTM D5185m >10	0	0	0
Copper	ppm	ASTM D5185m >50	3	13	12
Tin	ppm	ASTM D5185m >10	0	0	0
Vanadium	ppm	ASTM D5185m	<1	<1	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m 90	65	0	<1
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	0	0	<1
Magnesium	ppm	ASTM D5185m 90	66	0	26
Calcium	ppm	ASTM D5185m 2	2	0	0
Phosphorus	ppm	ASTM D5185m	0	0	2
Zinc	ppm	ASTM D5185m	0	0	30

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	4	3	<1
Sodium	ppm	ASTM D5185m	28	1	11
Potassium	ppm	ASTM D5185m >20	10	0	8
Water	%	ASTM D6304 >0.05	0.012	0.004	0.020
ppm Water	ppm	ASTM D6304 >500	122	46.7	207.1






FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	81365	1774	12140
Particles >6µm	ASTM D7647 >1300	▲ 28624	640	▲ 6358
Particles >14µm	ASTM D7647 >80	▲ 1658	43	▲ 1455
Particles >21µm	ASTM D7647 >20	▲ 301	10	▲ 447
Particles >38µm	ASTM D7647 >4	▲ 8	0	▲ 45
Particles >71µm	ASTM D7647 >3	0	0	2
Oil Cleanliness	ISO 4406 (c) >--/17/13	▲ 24/22/18	18/16/13	▲ 21/20/18

FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.47	0.38	0.36


OIL ANALYSIS REPORT

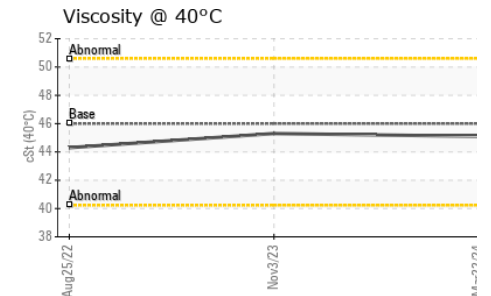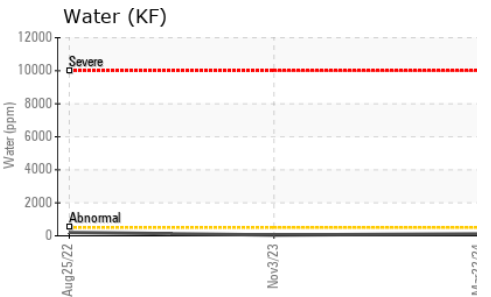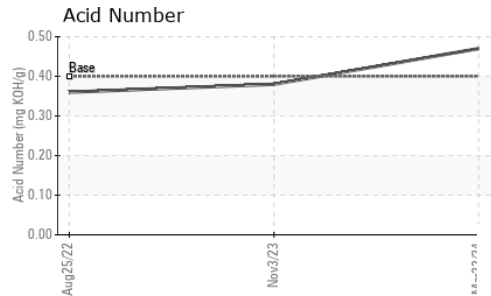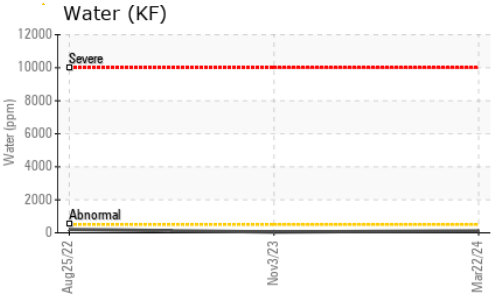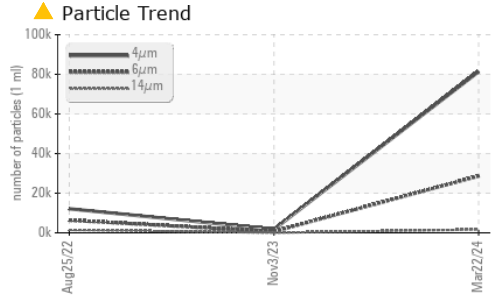






PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	45.1	45.3

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

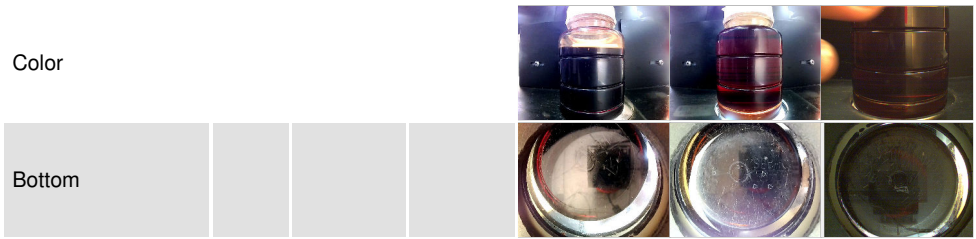

GRAPHS

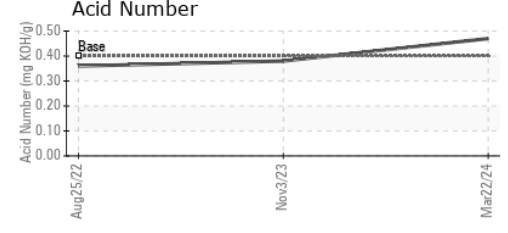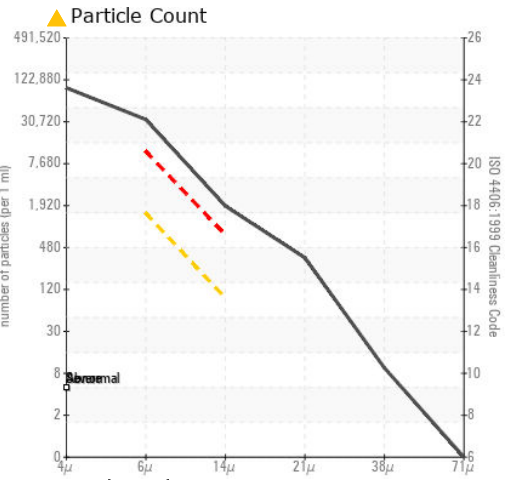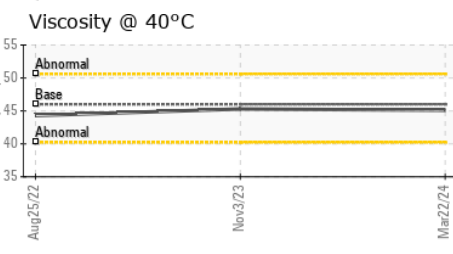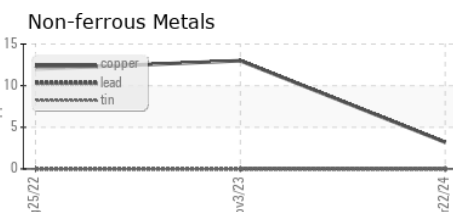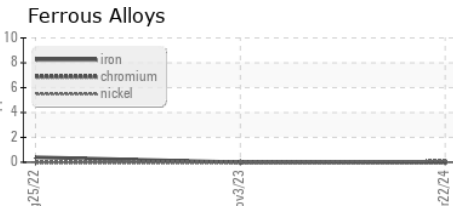

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC125839
Lab Number : **06134892**
Unique Number : 10954357
Test Package : IND 2
Received : 01 Apr 2024
Tested : 02 Apr 2024
Diagnosed : 03 Apr 2024 - Don Baldrige

PROGRESSIVE FOAM
 1 SOUTHERN GATEWAY DR
 GNADENHUTTEN, OH
 US 44629
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)