




# OIL ANALYSIS REPORT

Sample Rating Trend

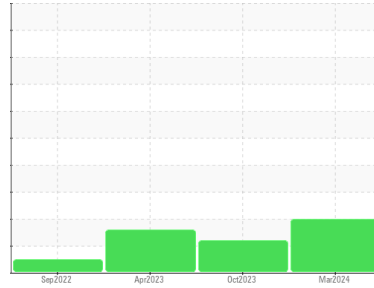

ISO



Machine Id  
**KAESER SK 15 A/C 7236502 (S/N 1490)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) S-460 (10 GAL)**

## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KC125857</b>	KC123170	KC107938
Sample Date	Client Info			<b>26 Mar 2024</b>	12 Oct 2023	25 Apr 2023
Machine Age	hrs	Client Info		<b>2847</b>	2428	2152
Oil Age	hrs	Client Info		<b>0</b>	0	253
Oil Changed	Client Info			<b>N/A</b>	N/A	Not Changd
Sample Status				<b>ABNORMAL</b>	ABNORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>10	<b>0</b>	0	<1
Lead	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>&lt;1</b>	0	<1
Tin	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m	90	<b>60</b>	4	0
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>0</b>	0	<1
Magnesium	ppm	ASTM D5185m	90	<b>79</b>	65	67
Calcium	ppm	ASTM D5185m	2	<b>1</b>	0	0
Phosphorus	ppm	ASTM D5185m		<b>0</b>	1	0
Zinc	ppm	ASTM D5185m		<b>0</b>	10	0


CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>2</b>	0	0
Sodium	ppm	ASTM D5185m		<b>12</b>	13	16
Potassium	ppm	ASTM D5185m	>20	<b>3</b>	3	0
Water	%	ASTM D6304	>0.05	<b>0.013</b>	0.021	0.020
ppm Water	ppm	ASTM D6304	>500	<b>140</b>	219.8	207.0

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>6351</b>	6757	8338
Particles >6µm		ASTM D7647	>1300	<b>▲ 3298</b>	▲ 2714	▲ 2786
Particles >14µm		ASTM D7647	>80	<b>▲ 895</b>	▲ 95	▲ 276
Particles >21µm		ASTM D7647	>20	<b>▲ 299</b>	18	▲ 78
Particles >38µm		ASTM D7647	>4	<b>▲ 5</b>	1	3
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	<b>▲ 20/19/17</b>	▲ 20/19/14	▲ 20/19/15


FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	<b>0.34</b>	0.38	0.39

# OIL ANALYSIS REPORT


## Particle Trend

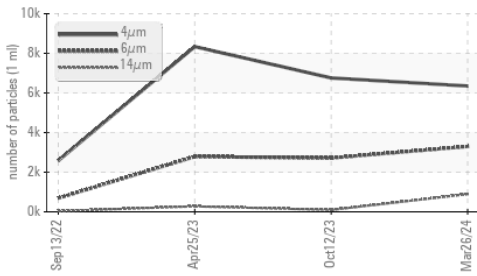


## Water (KF)

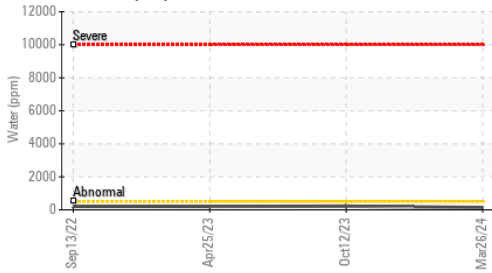


## Acid Number

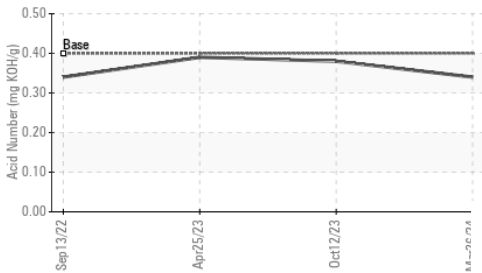

## Water (KF)

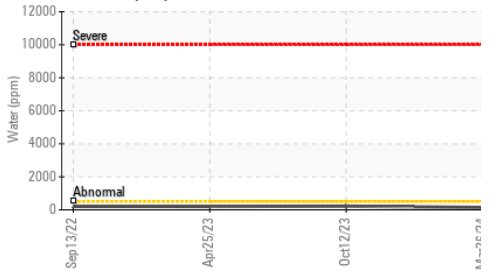

## Viscosity @ 40°C

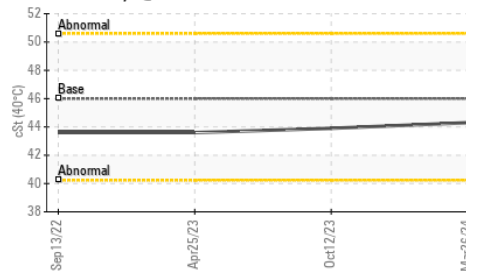


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	44.3	43.9	43.6

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------


Color

Bottom

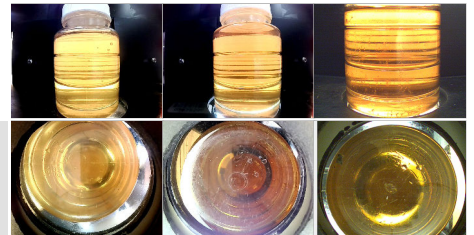


## GRAPHS


### Ferrous Alloys

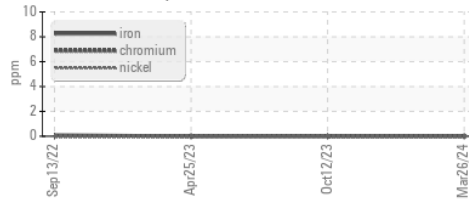


### Non-ferrous Metals

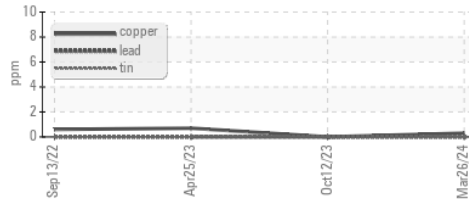


### Viscosity @ 40°C

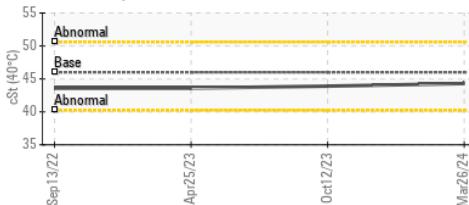

### Particle Count

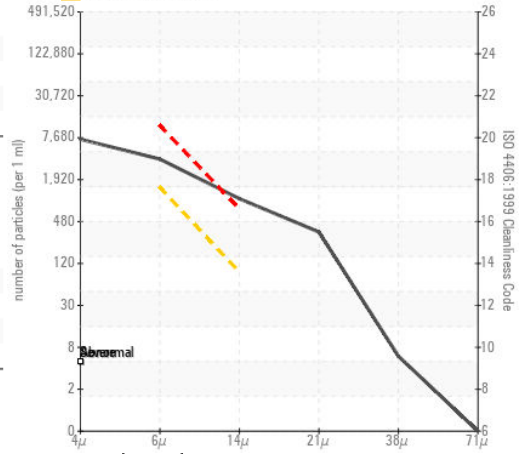

### Acid Number

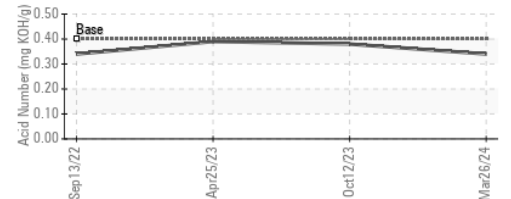

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : KC125857

Lab Number : 06134907

Unique Number : 10954372

Test Package : IND 2

Received : 01 Apr 2024

Tested : 02 Apr 2024

Diagnosed : 03 Apr 2024 - Don Baldrige

SOLMET

2716 SHEPLER CHURCH AVE

CANTON, OH

US 44706

Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: