




# OIL ANALYSIS REPORT

Sample Rating Trend

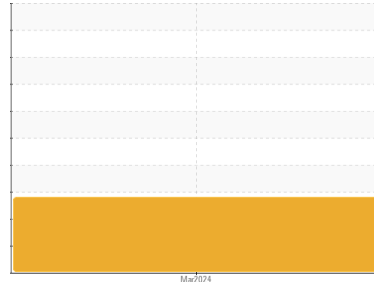

ISO



Machine Id  
**P-555**

Component  
**Pump**

Fluid  
**MOBIL SHC 626 (--- GAL)**

## DIAGNOSIS

### ▲ Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### ▲ Contamination

There is a high amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>USP0008205</b>	---	---
Sample Date	Client Info	<b>13 Mar 2024</b>	---	---
Machine Age	hrs Client Info	<b>0</b>	---	---
Oil Age	hrs Client Info	<b>0</b>	---	---
Oil Changed	Client Info	<b>N/A</b>	---	---
Sample Status		<b>ABNORMAL</b>	---	---

## WEAR METALS

method	limit/base	current	history1	history2
Iron ppm	ASTM D5185m >75	<b>11</b>	---	---
Chromium ppm	ASTM D5185m >5	<b>&lt;1</b>	---	---
Nickel ppm	ASTM D5185m	<b>0</b>	---	---
Titanium ppm	ASTM D5185m	<b>0</b>	---	---
Silver ppm	ASTM D5185m	<b>0</b>	---	---
Aluminum ppm	ASTM D5185m >5	<b>0</b>	---	---
Lead ppm	ASTM D5185m >10	<b>0</b>	---	---
Copper ppm	ASTM D5185m >15	<b>0</b>	---	---
Tin ppm	ASTM D5185m	<b>0</b>	---	---
Vanadium ppm	ASTM D5185m	<b>0</b>	---	---
Cadmium ppm	ASTM D5185m	<b>0</b>	---	---

## ADDITIVES

method	limit/base	current	history1	history2
Boron ppm	ASTM D5185m	<b>0</b>	---	---
Barium ppm	ASTM D5185m	<b>0</b>	---	---
Molybdenum ppm	ASTM D5185m	<b>0</b>	---	---
Manganese ppm	ASTM D5185m	<b>&lt;1</b>	---	---
Magnesium ppm	ASTM D5185m	<b>0</b>	---	---
Calcium ppm	ASTM D5185m	<b>5</b>	---	---
Phosphorus ppm	ASTM D5185m	<b>452</b>	---	---
Zinc ppm	ASTM D5185m	<b>4</b>	---	---
Sulfur ppm	ASTM D5185m	<b>18</b>	---	---

## CONTAMINANTS

method	limit/base	current	history1	history2
Silicon ppm	ASTM D5185m >20	<b>12</b>	---	---
Sodium ppm	ASTM D5185m	<b>0</b>	---	---
Potassium ppm	ASTM D5185m >20	<b>0</b>	---	---
Water %	ASTM D6304 >.1	<b>0.004</b>	---	---
ppm Water ppm	ASTM D6304 >1000	<b>49</b>	---	---

## FLUID CLEANLINESS






method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >5000	<b>▲ 150414</b>	---	---
Particles >6µm	ASTM D7647 >1300	<b>▲ 30975</b>	---	---
Particles >14µm	ASTM D7647 >160	<b>▲ 2438</b>	---	---
Particles >21µm	ASTM D7647 >40	<b>▲ 811</b>	---	---
Particles >38µm	ASTM D7647 >10	<b>▲ 69</b>	---	---
Particles >71µm	ASTM D7647 >3	<b>▲ 11</b>	---	---
Oil Cleanliness	ISO 4406 (c) >19/17/14	<b>▲ 24/22/18</b>	---	---

## FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN) mg KOH/g	ASTM D8045	<b>0.55</b>	---	---



# OIL ANALYSIS REPORT

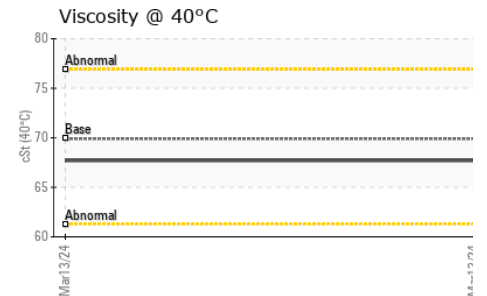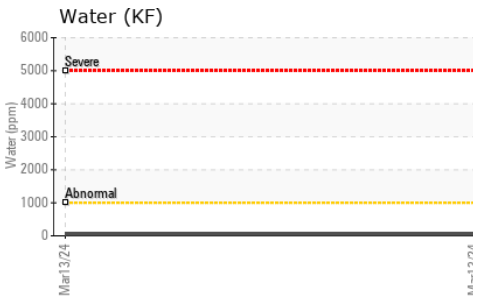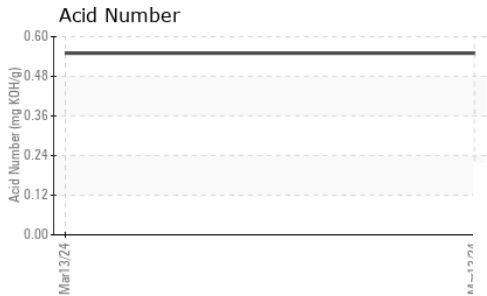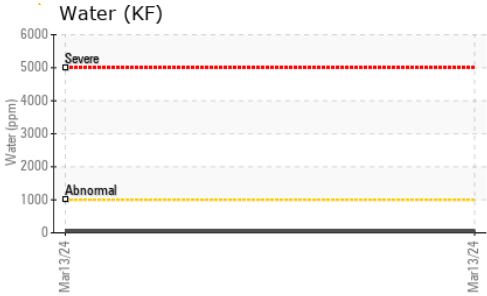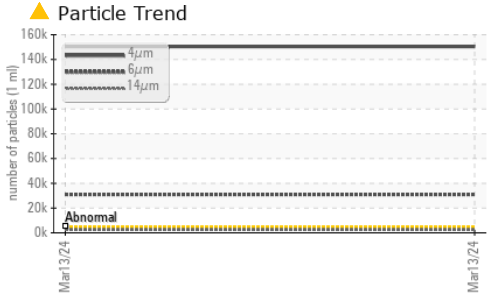





VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---
Precipitate	scalar	*Visual	NONE	NONE	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	LIGHT	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>.1	NEG	---	---
Free Water	scalar	*Visual		NEG	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	69.9	67.7	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color		no image	no image
Bottom		no image	no image

### GRAPHS

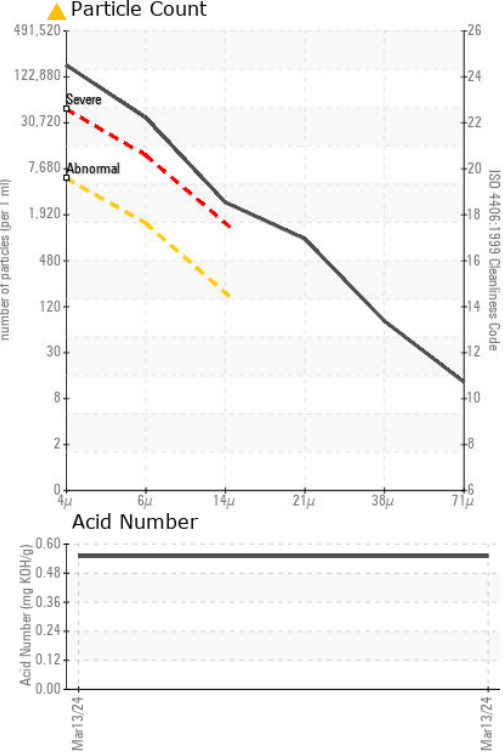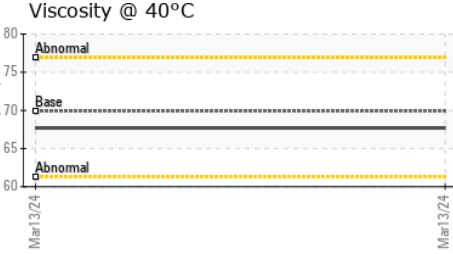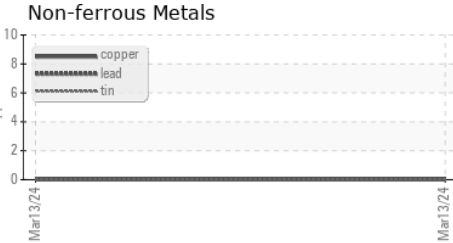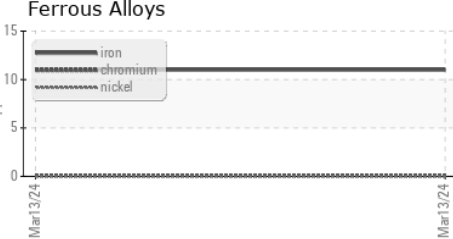

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : USP0008205      **Received** : 01 Apr 2024  
**Lab Number** : 06134995      **Tested** : 02 Apr 2024  
**Unique Number** : 10954460      **Diagnosed** : 03 Apr 2024 - Doug Bogart  
**Test Package** : IND 2

**POET BIOPROCESSING**  
 3638 FIR AVE  
 HANLONTOWN, IA  
 US 50444  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)