




# OIL ANALYSIS REPORT

Sample Rating Trend

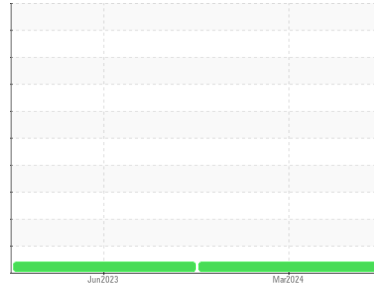

VIS DEBRIS



Machine Id  
**C-805**  
 Component  
**Gearbox**  
 Fluid  
**MOBIL SHC 630 (--- GAL)**

## DIAGNOSIS

### ▲ Recommendation

We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.

### Wear

All component wear rates are normal.

### ▲ Contamination

Moderate concentration of visible dirt/debris present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>USP0008207</b>	USP243149	---
Sample Date	Client Info		<b>19 Mar 2024</b>	05 Jun 2023	---
Machine Age	hrs	Client Info	<b>0</b>	0	---
Oil Age	hrs	Client Info	<b>0</b>	0	---
Oil Changed	Client Info		<b>N/A</b>	N/A	---
Sample Status			<b>ABNORMAL</b>	ABNORMAL	---

## WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m	>200	<b>49</b>	52	---
Chromium	ppm	ASTM D5185m	>15	<b>&lt;1</b>	<1	---
Nickel	ppm	ASTM D5185m	>15	<b>0</b>	0	---
Titanium	ppm	ASTM D5185m		<b>0</b>	0	---
Silver	ppm	ASTM D5185m		<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m	>25	<b>&lt;1</b>	0	---
Lead	ppm	ASTM D5185m	>100	<b>0</b>	0	---
Copper	ppm	ASTM D5185m	>200	<b>0</b>	<1	---
Tin	ppm	ASTM D5185m	>25	<b>0</b>	<1	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	---

## ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m		<b>0</b>	0	---
Barium	ppm	ASTM D5185m		<b>0</b>	0	---
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	---
Manganese	ppm	ASTM D5185m		<b>1</b>	1	---
Magnesium	ppm	ASTM D5185m		<b>&lt;1</b>	<1	---
Calcium	ppm	ASTM D5185m		<b>4</b>	4	---
Phosphorus	ppm	ASTM D5185m		<b>542</b>	579	---
Zinc	ppm	ASTM D5185m		<b>46</b>	48	---
Sulfur	ppm	ASTM D5185m		<b>17443</b>	19358	---

## CONTAMINANTS




	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>50	<b>25</b>	25	---
Sodium	ppm	ASTM D5185m		<b>2</b>	3	---
Potassium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	<1	---
Water	%	ASTM D6304	>0.2	<b>0.002</b>	0.006	---
ppm Water	ppm	ASTM D6304	>2000	<b>22</b>	63.0	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>2.47</b>	2.61	---




# OIL ANALYSIS REPORT

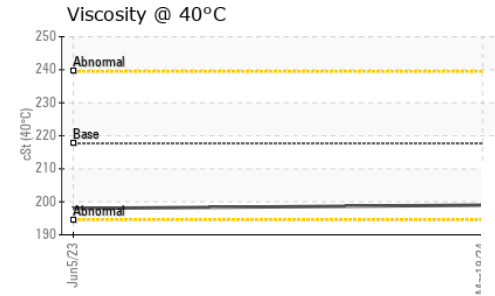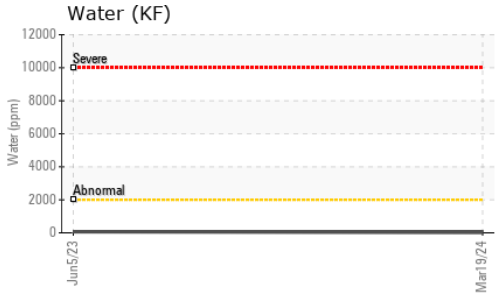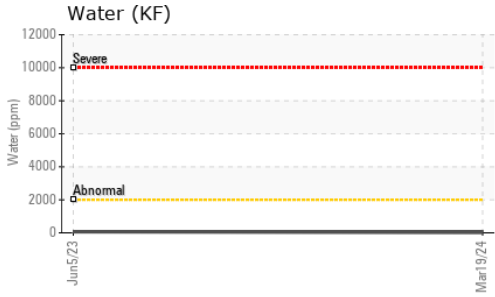





VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	LIGHT	---
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	NONE	---
Debris	scalar	*Visual	NONE	▲ MODER	▲ MODER	---
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG	---
Free Water	scalar	*Visual		NEG	NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	217.7	199	198	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

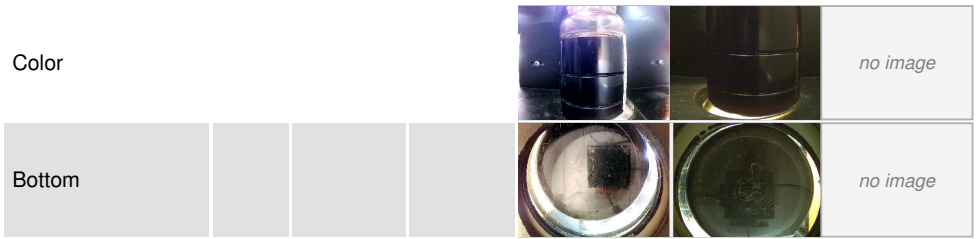

## GRAPHS

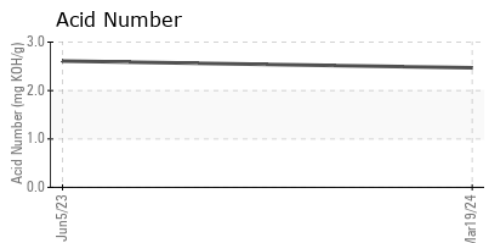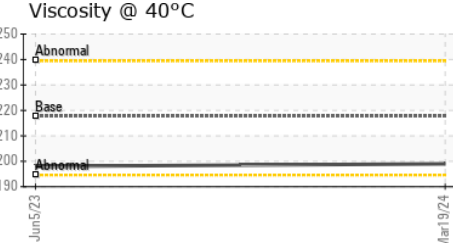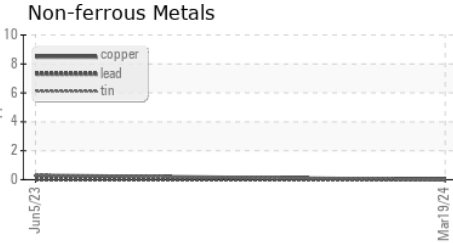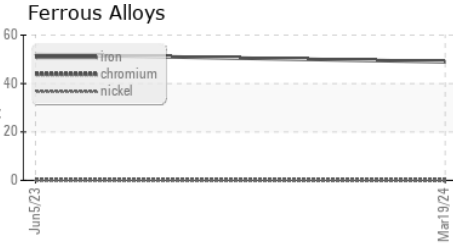

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : USP0008207      **Received** : 01 Apr 2024  
**Lab Number** : 06135017      **Tested** : 03 Apr 2024  
**Unique Number** : 10954482      **Diagnosed** : 03 Apr 2024 - Doug Bogart  
**Test Package** : IND 2

**POET BIOPROCESSING**  
 3638 FIR AVE  
 HANLONTOWN, IA  
 US 50444  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: