


OIL ANALYSIS REPORT

INGERSOLL RAND MOX1000832 - CRAIN

Component Compressor

Area CFG-546





DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


				Mar2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UCH06135080		
Sample Date		Client Info		15 Mar 2024		
Machine Age	hrs	Client Info		19566		
Oil Age	hrs	Client Info		4000		
Oil Changed		Client Info		Changed		
Sample Status				NORMAL		
CONTAMINATIO	Ν	method	limit/base	current	history1	history2
Water		WC Method	>0.1	NEG		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	<1		
Nickel	ppm	ASTM D5185m		0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>25	0		
Lead	ppm	ASTM D5185m	>25	0		
Copper	ppm	ASTM D5185m	>50	0		
Tin	ppm	ASTM D5185m	>15	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	0	2		
Molybdenum	ppm	ASTM D5185m	0	0		
Manganese	ppm	ASTM D5185m	0	<1		
Magnesium	ppm	ASTM D5185m	1.2	0		
Calcium	ppm	ASTM D5185m	0	<1		
Phosphorus	ppm	ASTM D5185m	295	115		
Zinc	ppm	ASTM D5185m	0	0		
Sulfur	ppm	ASTM D5185m	253	666		
CONTAMINANTS	6	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0		
Sodium	ppm	ASTM D5185m		1		
Potassium	ppm	ASTM D5185m	>20	2		
FLUID DEGRADA	NOITA	method	limit/base	current	history1	history2
A 1151 1 (ASC)	1/01::	4.0TH D.04 :-		0.00		

Acid Number (AN) mg KOH/g ASTM D8045 0.252

0.33




OIL ANALYSIS REPORT

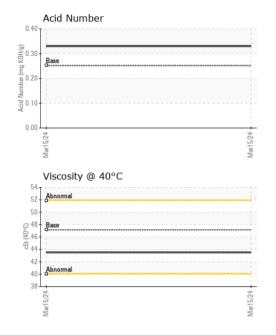



VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE		
Yellow Metal	scalar	*Visual	NONE	NONE		
Precipitate	scalar	*Visual	NONE	NONE		
Silt	scalar	*Visual	NONE	NONE		
Debris	scalar	*Visual	NONE	NONE		
Sand/Dirt	scalar	*Visual	NONE	NONE		
Appearance	scalar	*Visual	NORML	NORML		
Odor	scalar	*Visual	NORML	NORML		
Emulsified Water	scalar	*Visual	>0.1	NEG		
Free Water	scalar	*Visual		NEG		
FLUID PROPERT	IES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	47.16	43.5		
SAMPLE IMAGES	5	method	limit/base	current	history1	history2


		•	•
Color	a.	no image	no image
Bottom		no image	no image
GRAPHS			

Ferrous Alloys













Certificate L2367

Laboratory Sample No.

Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : UCH06135080 Lab Number : 06135080 Unique Number : 10954545

Received **Tested**

: 02 Apr 2024 Diagnosed

: 03 Apr 2024 - Sean Felton

: 01 Apr 2024

CISCO AIR SYSTEMS 214 27TH ST SACRAMENTO, CA

US 95816 Contact: BARRY FRKOVICH

barryfrkovich@ciscoair.com T: (916)444-2525

Contact/Location: BARRY FRKOVICH - UCCISSAC

To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: x: