

Area


**PALASYN 45**

Machine Id

**SULLIVAN PALATEK 1205100002 - HOUSEHOLD METALS INC**

Component

**Compressor**

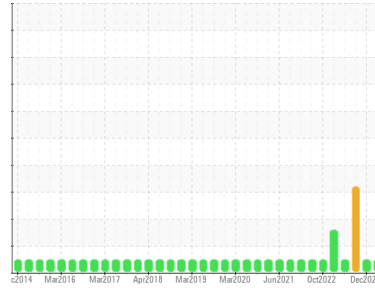

**DIAGNOSIS**

**Recommendation**

Resample at the next service interval to monitor.

**Wear**

All component wear rates are normal.

**Contamination**

There is no indication of any contamination in the oil.

**Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

**SAMPLE INFORMATION**

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>UCS06135085</b>	UCS06135071	UCS05962340
Sample Date	Client Info		<b>12 Feb 2024</b>	05 Dec 2023	21 Aug 2023
Machine Age	hrs	Client Info	<b>27438</b>	27313	26363
Oil Age	hrs	Client Info	<b>1074</b>	950	3020
Oil Changed	Client Info		<b>Not Chngd</b>	Not Chngd	Changed
Sample Status			<b>NORMAL</b>	NORMAL	ATTENTION

**CONTAMINATION**

	method	limit/base	current	history1	history2
Water	WC Method	>0.1	<b>NEG</b>	NEG	NEG

**WEAR METALS**

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>0</b>	0	1
Chromium	ppm	ASTM D5185m >10	<b>&lt;1</b>	<1	0
Nickel	ppm	ASTM D5185m	<b>0</b>	<1	0
Titanium	ppm	ASTM D5185m	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >25	<b>0</b>	0	1
Lead	ppm	ASTM D5185m >25	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >50	<b>0</b>	0	0
Tin	ppm	ASTM D5185m >15	<b>0</b>	0	<1
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

**ADDITIVES**

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0.0	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 0.0	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m 0	<b>&lt;1</b>	<1	0
Magnesium	ppm	ASTM D5185m 0.0	<b>0</b>	0	0
Calcium	ppm	ASTM D5185m 0.0	<b>&lt;1</b>	<1	0
Phosphorus	ppm	ASTM D5185m 966	<b>337</b>	362	332
Zinc	ppm	ASTM D5185m 0	<b>0</b>	0	0
Sulfur	ppm	ASTM D5185m 1309	<b>1023</b>	977	522


**CONTAMINANTS**

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>&lt;1</b>	1	<1
Sodium	ppm	ASTM D5185m	<b>1</b>	1	0
Potassium	ppm	ASTM D5185m >20	<b>1</b>	2	0

**FLUID DEGRADATION**

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.172	<b>0.16</b>	0.08	0.26


# OIL ANALYSIS REPORT

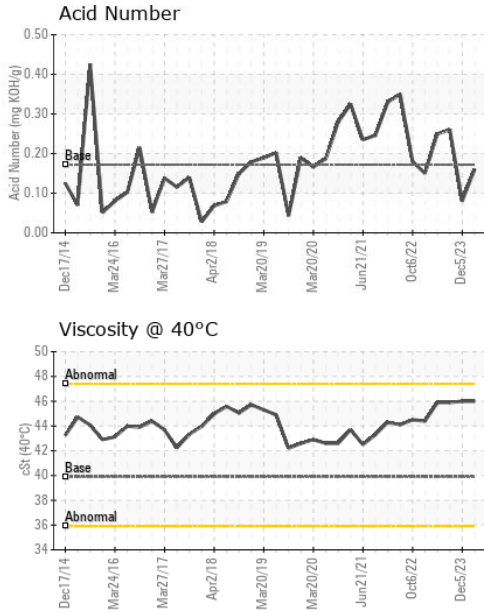





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE
Silt	scalar	*Visual	NONE	<b>NONE</b>	MODER
Debris	scalar	*Visual	NONE	<b>NONE</b>	LIGHT
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	NEG
Free Water	scalar	*Visual		<b>NEG</b>	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	39.9	<b>46.0</b>	46.0

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

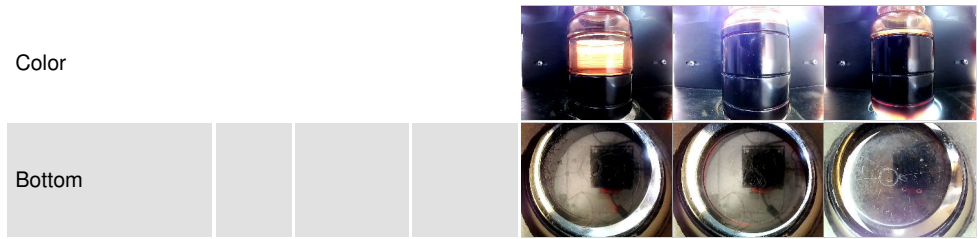

## GRAPHS

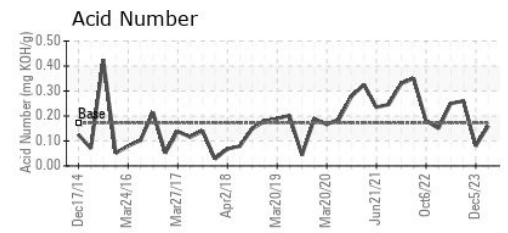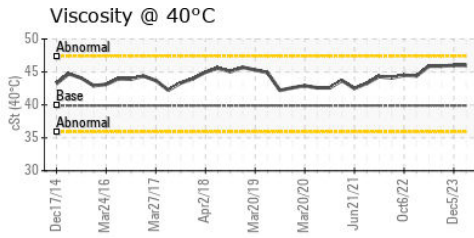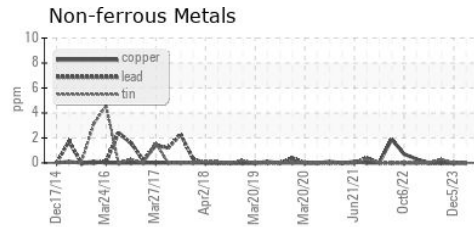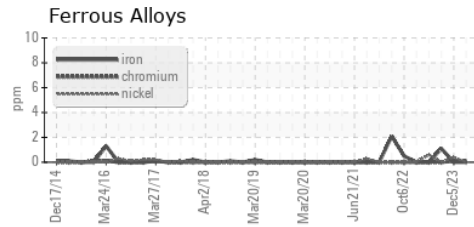

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCS06135085 **Received** : 01 Apr 2024  
**Lab Number** : **06135085** **Tested** : 02 Apr 2024  
**Unique Number** : 10954550 **Diagnosed** : 03 Apr 2024 - Sean Felton  
**Test Package** : IND 2

**STAR MAINTENANCE LTD**  
 612 LONELY RD  
 SELLERSVILLE, PA  
 US 18960  
 Contact: PAUL SEACHRIST  
 PSEACHRIST@VERIZON.NET  
 T: (216)723-0540  
 F: (216)723-1760

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)