




OIL ANALYSIS REPORT

Sample Rating Trend

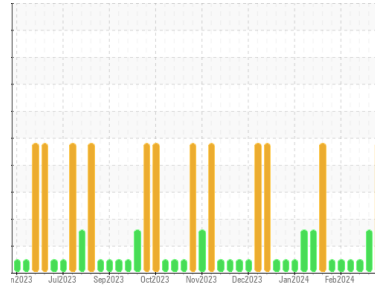

DIRT



Machine Id
SJNM02BE
 Component
Biogas Engine
 Fluid
CHEVRON HDAX 9500 GAS ENGINE OIL 40 (--- GAL)

DIAGNOSIS

▲ Recommendation

The oil change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

Elemental level of silicon (Si) above normal.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0865723	WC0865751	WC0865724
Sample Date	Client Info		28 Mar 2024	21 Mar 2024	14 Mar 2024
Machine Age	hrs	Client Info	115128	114960	114793
Oil Age	hrs	Client Info	1000	832	665
Oil Changed	Client Info		Changed	Not Changd	Not Changd
Sample Status			SEVERE	ABNORMAL	NORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>4.0	<1.0	<1.0	<1.0
Water	WC Method		NEG	NEG	NEG
Glycol	WC Method		NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >14	2	3	1
Chromium	ppm	ASTM D5185m >3	<1	0	0
Nickel	ppm	ASTM D5185m	0	<1	0
Titanium	ppm	ASTM D5185m	0	0	0
Silver	ppm	ASTM D5185m	0	0	0
Aluminum	ppm	ASTM D5185m >5	2	2	1
Lead	ppm	ASTM D5185m >8	3	5	4
Copper	ppm	ASTM D5185m >5	<1	1	<1
Tin	ppm	ASTM D5185m >3	3	4	2
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	4	4	4
Barium	ppm	ASTM D5185m	0	0	0
Molybdenum	ppm	ASTM D5185m	5	5	20
Manganese	ppm	ASTM D5185m	<1	<1	0
Magnesium	ppm	ASTM D5185m	38	30	42
Calcium	ppm	ASTM D5185m	2189	2146	2150
Phosphorus	ppm	ASTM D5185m	345	325	308
Zinc	ppm	ASTM D5185m	411	394	376
Sulfur	ppm	ASTM D5185m	2866	2815	2759

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >180	▲ 200	▲ 186	162
Sodium	ppm	ASTM D5185m >20	2	2	1
Potassium	ppm	ASTM D5185m >20	2	3	0

INFRA-RED





	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	0.1	0.1	0.1
Nitration	Abs/cm	*ASTM D7624	8.4	8.2	7.6
Sulfation	Abs/.1mm	*ASTM D7415	24.4	23.9	22.6

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	22.3	21.6	18.7
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	2.10	0.612	1.63
Base Number (BN)	mg KOH/g	ASTM D2896 5.4	3.59	3.87	3.63











OIL ANALYSIS REPORT

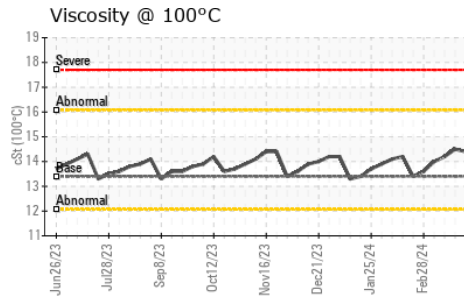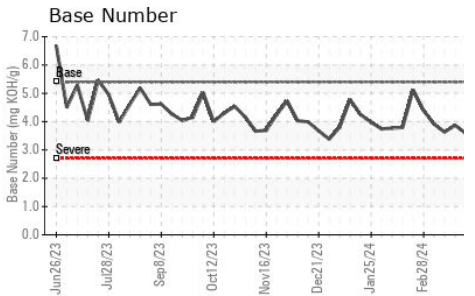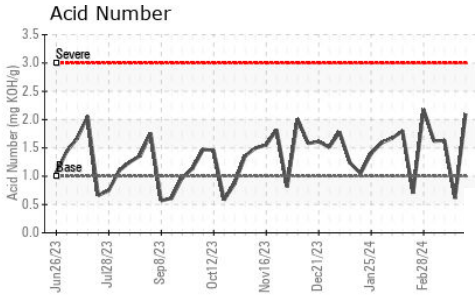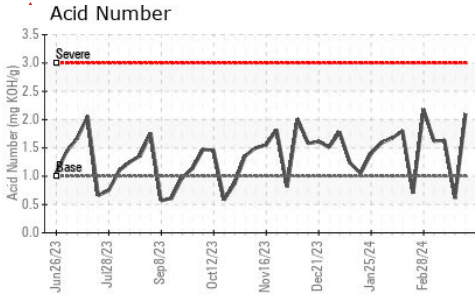

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	NEG	NEG	NEG
Free Water	scalar	*Visual	NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	13.4	14.4	14.5

GRAPHS

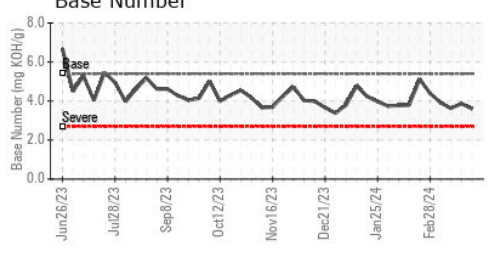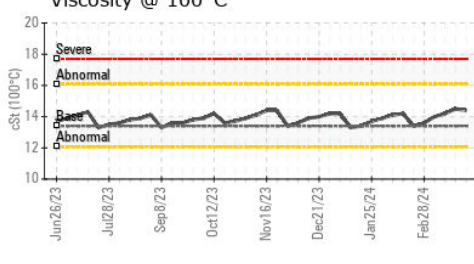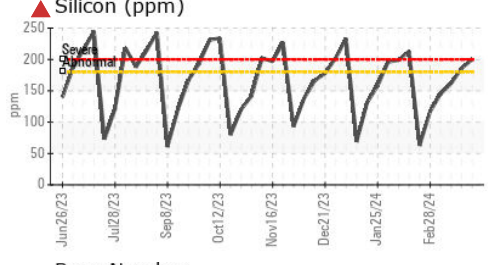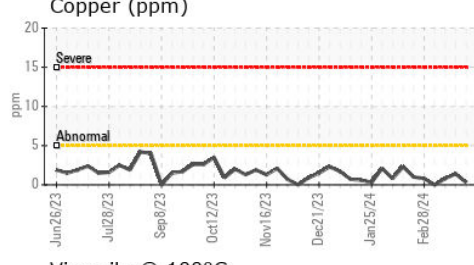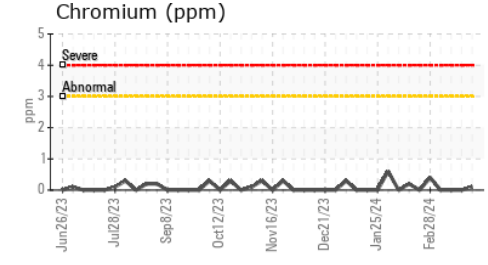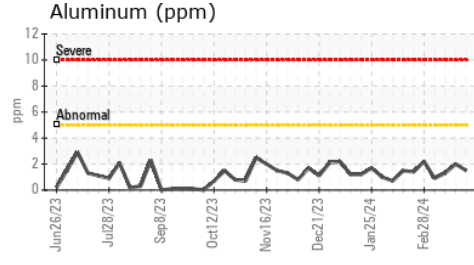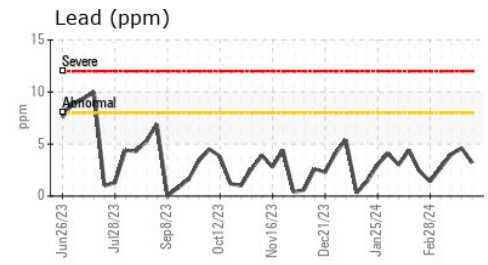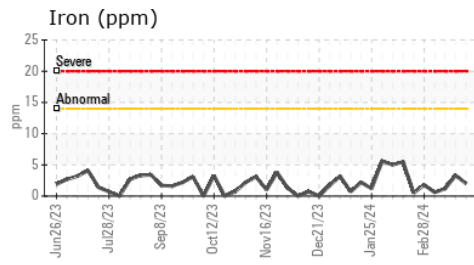

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0865723
Lab Number : 06135131
Unique Number : 10954596
Test Package : MOB 2

Received : 01 Apr 2024
Tested : 02 Apr 2024
Diagnosed : 03 Apr 2024 - Sean Felton

EDL NA Recips-South Jordan
 South Jordan Powerstation, 10473 S. Bacchus Hwy.
 South Jordan, UT
 US 84095
 Contact: Aaron Klein
 aaron.klein@edlenergy.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: