




OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL



Machine Id
EDG-1
Component
Diesel Engine
Fluid
MOBIL MOBILGARD 412 (--- GAL)

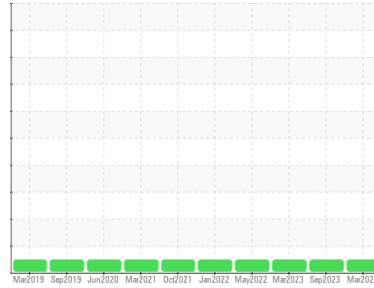

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	RP0039442	RP0038723	RP0031538
Sample Date	Client Info	31 Mar 2024	10 Sep 2023	14 Mar 2023
Machine Age	hrs Client Info	0	0	0
Oil Age	hrs Client Info	0	0	0
Oil Changed	Client Info	N/A	N/A	N/A
Sample Status		NORMAL	NORMAL	NORMAL

CONTAMINATION

method	limit/base	current	history1	history2
Fuel	WC Method >5	<1.0	<1.0	<1.0
Glycol	WC Method	NEG	NEG	NEG

WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185m >100	<1	2	2
Chromium	ppm ASTM D5185m >20	<1	0	<1
Nickel	ppm ASTM D5185m >4	0	0	0
Titanium	ppm ASTM D5185m	0	0	<1
Silver	ppm ASTM D5185m >3	0	0	0
Aluminum	ppm ASTM D5185m >20	1	<1	2
Lead	ppm ASTM D5185m >40	0	<1	<1
Copper	ppm ASTM D5185m >330	0	0	<1
Tin	ppm ASTM D5185m >15	<1	0	0
Vanadium	ppm ASTM D5185m	0	<1	0
Cadmium	ppm ASTM D5185m	0	0	0

ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185m 0	2	2	<1
Barium	ppm ASTM D5185m 0	0	0	0
Molybdenum	ppm ASTM D5185m 0	0	<1	<1
Manganese	ppm ASTM D5185m 0	<1	<1	<1
Magnesium	ppm ASTM D5185m 18	33	15	21
Calcium	ppm ASTM D5185m 6350	5773	5886	5842
Phosphorus	ppm ASTM D5185m 200	227	208	217
Zinc	ppm ASTM D5185m 380	380	351	359

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185m >25	8	10	6
Sodium	ppm ASTM D5185m	2	1	<1
Potassium	ppm ASTM D5185m >20	1	<1	<1
Water	% ASTM D6304 >0.2	NEG	0.066	0.017
ppm Water	ppm ASTM D6304 >2000	---	662.5	170.2






INFRA-RED

method	limit/base	current	history1	history2
Soot %	% *ASTM D7844 >3	0.1	0	0.1
Nitration	Abs/cm *ASTM D7624 >20	4.8	4.8	4.9
Sulfation	Abs/.1mm *ASTM D7415 >30	13.4	13.4	14.0

FLUID DEGRADATION

method	limit/base	current	history1	history2
Oxidation	Abs/.1mm *ASTM D7414 >25	3.6	3.5	3.2
Acid Number (AN)	mg KOH/g ASTM D8045 1.25	---	---	0.432
Base Number (BN)	mg KOH/g ASTM D2896 15	15.36	13.2	14.3





OIL ANALYSIS REPORT

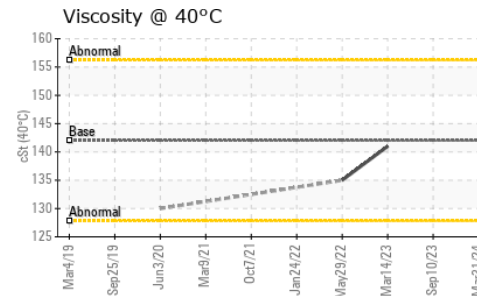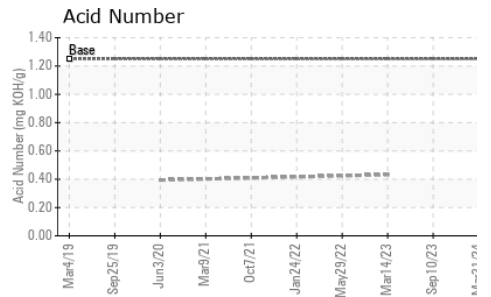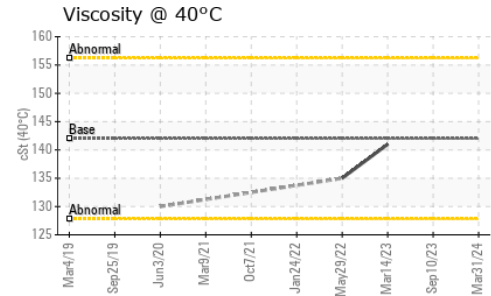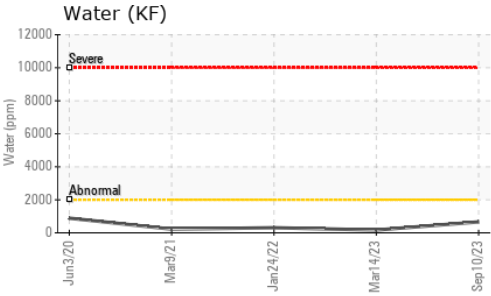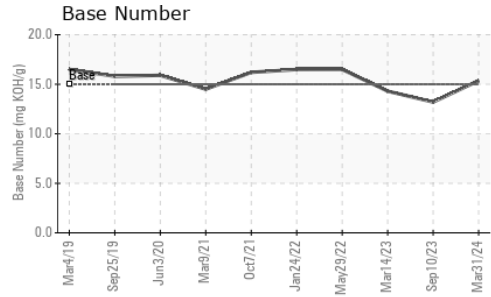

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	LIGHT
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	142	---	141
Visc @ 100°C	cSt	ASTM D445	14.5	14.0	13.76

GRAPHS

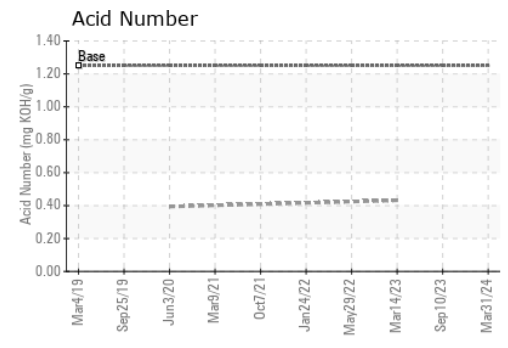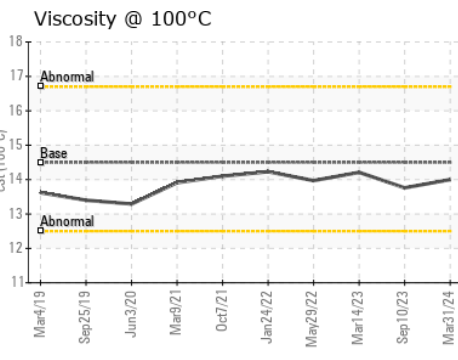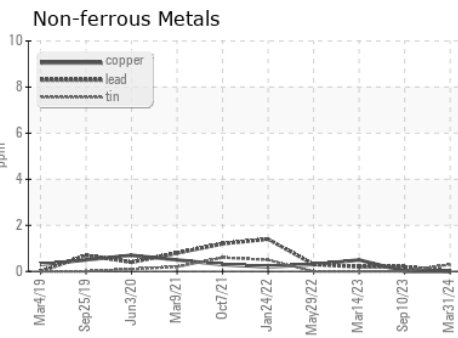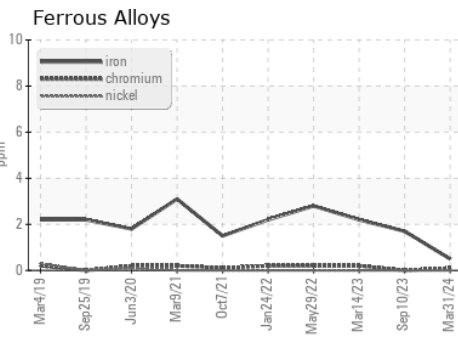

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : RP0039442
Lab Number : 06135143
Unique Number : 10954608
Test Package : IND 2 (Additional Tests: FT-IR, KV100, TBN)
Received : 01 Apr 2024
Tested : 03 Apr 2024
Diagnosed : 03 Apr 2024 - Sean Felton

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

ENGIE-MATEP
 474 BROOKLINE AVE
 BOSTON, MA
 US 02215
 Contact: ROBERT ST SAUVEUR
 robert.stsauveur@engie.com
 T: (401)651-9381
 F: