


OIL ANALYSIS REPORT

Sample Rating Trend



FUEL

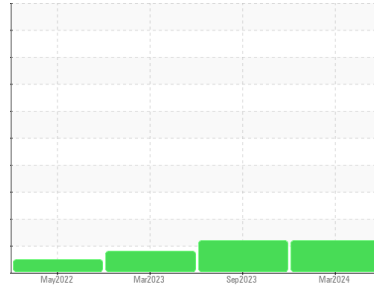

Machine Id
FP-1D
 Component
Diesel Engine
 Fluid
MOBIL MOBILGARD 412 (--- GAL)

DIAGNOSIS

Recommendation

We advise that you check the fuel injection system. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of fuel present in the oil.

Fluid Condition

Fuel is present in the oil and is lowering the viscosity. The BN result indicates that there is suitable alkalinity remaining in the oil.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	RP0039446	RP0038725	RP0031563
Sample Date	Client Info	31 Mar 2024	10 Sep 2023	14 Mar 2023
Machine Age	hrs	Client Info	0	0
Oil Age	hrs	Client Info	0	0
Oil Changed	Client Info	N/A	N/A	N/A
Sample Status		ABNORMAL	ABNORMAL	ABNORMAL

CONTAMINATION

method	limit/base	current	history1	history2
Glycol	WC Method	NEG	NEG	NEG

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >100	3	5	3
Chromium	ppm	ASTM D5185m >20	1	1	<1
Nickel	ppm	ASTM D5185m >4	0	0	0
Titanium	ppm	ASTM D5185m	<1	<1	<1
Silver	ppm	ASTM D5185m >3	0	0	0
Aluminum	ppm	ASTM D5185m >20	2	<1	2
Lead	ppm	ASTM D5185m >40	<1	2	<1
Copper	ppm	ASTM D5185m >330	<1	1	<1
Tin	ppm	ASTM D5185m >15	<1	<1	0
Vanadium	ppm	ASTM D5185m	0	<1	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m 0	0	<1	5
Barium	ppm	ASTM D5185m 0	0	0	0
Molybdenum	ppm	ASTM D5185m 0	0	<1	<1
Manganese	ppm	ASTM D5185m 0	<1	<1	<1
Magnesium	ppm	ASTM D5185m 18	20	18	19
Calcium	ppm	ASTM D5185m 6350	5522	5852	5401
Phosphorus	ppm	ASTM D5185m 200	214	216	208
Zinc	ppm	ASTM D5185m 380	356	351	332

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	15	14	6
Sodium	ppm	ASTM D5185m	3	3	1
Potassium	ppm	ASTM D5185m >20	3	1	<1
Fuel	%	ASTM D3524 >5	▲ 7.4	▲ 6.3	▲ 6.6
Water	%	ASTM D6304 >0.2	NEG	0.089	0.017
ppm Water	ppm	ASTM D6304 >2000	---	892.6	175.8






INFRA-RED

method	limit/base	current	history1	history2	
Soot %	%	*ASTM D7844 >3	0	0	0.1
Nitration	Abs/cm	*ASTM D7624 >20	5.1	5.2	4.9
Sulfation	Abs/.1mm	*ASTM D7415 >30	13.6	13.6	14.4

FLUID DEGRADATION

method	limit/base	current	history1	history2	
Oxidation	Abs/.1mm	*ASTM D7414 >25	3.9	3.5	4.2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.25	---	---	0.115
Base Number (BN)	mg KOH/g	ASTM D2896 15	14.10	14.0	13.5





OIL ANALYSIS REPORT

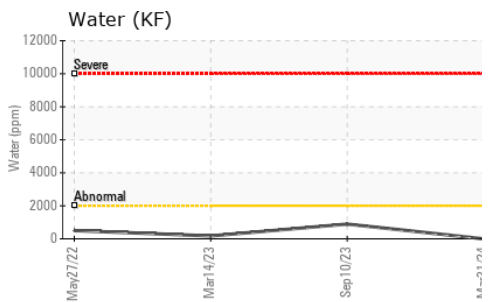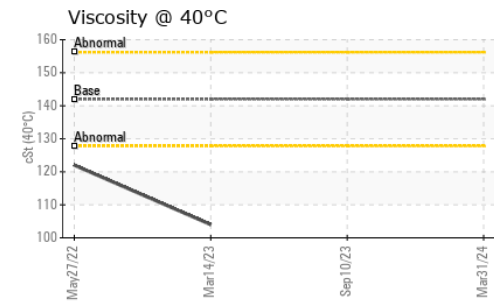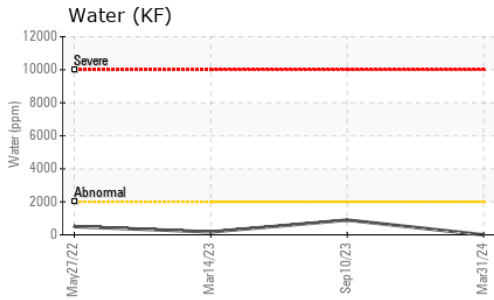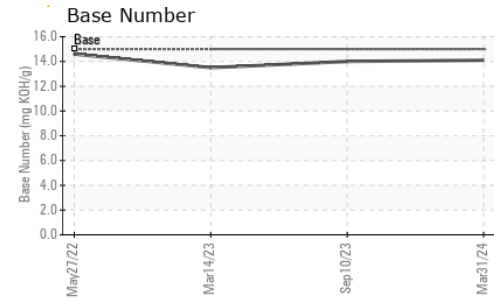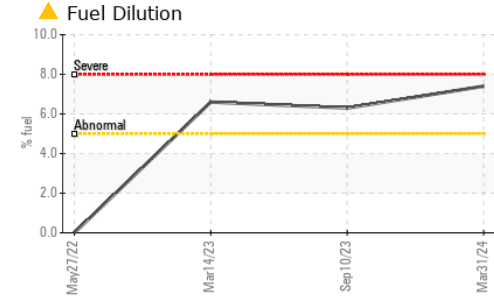

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	142	---	104
Visc @ 100°C	cSt	ASTM D445	14.5	▲ 11.6	12.35

GRAPHS

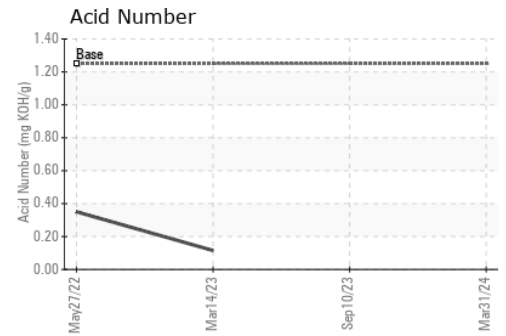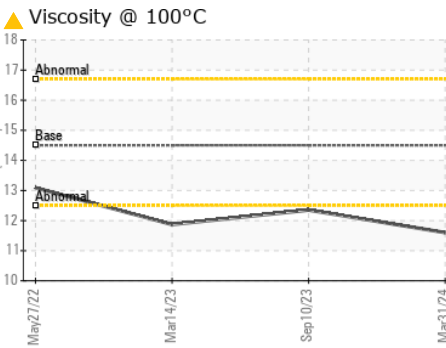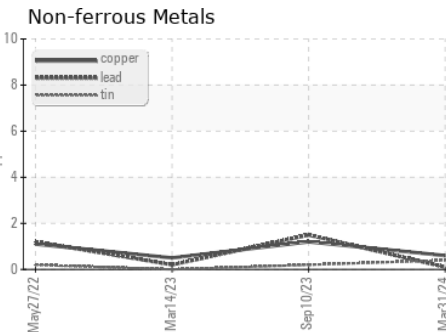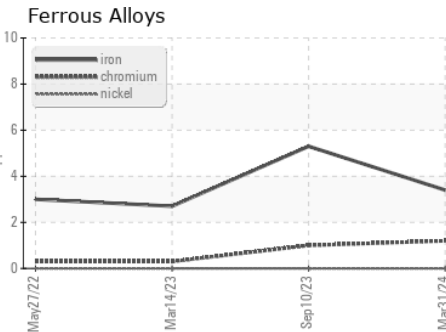

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : RP0039446 **Received** : 01 Apr 2024
Lab Number : 06135144 **Tested** : 03 Apr 2024
Unique Number : 10954609 **Diagnosed** : 03 Apr 2024 - Sean Felton
Test Package : IND 2 (Additional Tests: FT-IR, KV100, PercentFuel, TBN)

ENGIE-MATEP
 474 BROOKLINE AVE
 BOSTON, MA
 US 02215
 Contact: ROBERT ST SAUVEUR
 robert.stsauveur@engie.com
 T: (401)651-9381
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)