




# FUEL REPORT

### Sample Rating Trend

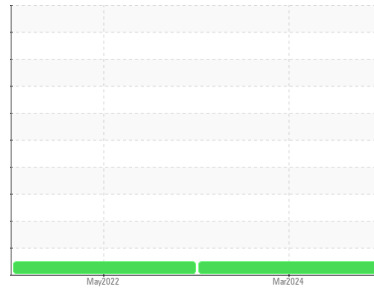

**NORMAL**



Machine Id  
**FLEET 596720 FLEET 596720**  
 Component  
**Diesel Fuel**  
 Fluid  
**No.2 DIESEL FUEL (ULTRALOW SULPHUR) (--- GAL)**

### DIAGNOSIS

#### Recommendation

This is a baseline read-out on the submitted sample.

#### Corrosion

All metal levels are normal indicating no corrosion in the system.

#### Contaminants

There is no indication of any contamination in the fuel.

#### Fuel Condition

The condition of the fuel is acceptable for the time in service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WC0878257</b>	WC0651461	---
Sample Date	Client Info			<b>20 Mar 2024</b>	05 May 2022	---
Machine Age	hrs	Client Info		<b>0</b>	0	---
Sample Status				<b>NORMAL</b>	NORMAL	---

SULFUR CONTENT		method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185m	10	<b>16</b>	0	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	<1.0	<b>&lt;1</b>	0	---
Sodium	ppm	ASTM D5185m	<0.1	<b>&lt;1</b>	<1	---
Potassium	ppm	ASTM D5185m	<0.1	<b>0</b>	0	---

HEAVY METALS		method	limit/base	current	history1	history2
Aluminum	ppm	ASTM D5185m	<0.1	<b>0</b>	2	---
Nickel	ppm	ASTM D5185m	<0.1	<b>0</b>	0	---
Lead	ppm	ASTM D5185m	<0.1	<b>0</b>	0	---
Vanadium	ppm	ASTM D5185m	<0.1	<b>0</b>	0	---
Iron	ppm	ASTM D5185m	<0.1	<b>0</b>	0	---
Calcium	ppm	ASTM D5185m	<0.1	<b>2</b>	0	---
Magnesium	ppm	ASTM D5185m	<0.1	<b>0</b>	0	---
Phosphorus	ppm	ASTM D5185m	<0.1	<b>0</b>	0	---
Zinc	ppm	ASTM D5185m	<0.1	<b>0</b>	0	---

### SAMPLE IMAGES

method	limit/base	current	history1	history2
Color				no image
Bottom				no image



# FUEL REPORT

## GRAPHS



Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0878257      **Received** : 01 Apr 2024  
**Lab Number** : 06135375      **Tested** : 04 Apr 2024  
**Unique Number** : 10954840      **Diagnosed** : 04 Apr 2024 - Jonathan Hester  
**Test Package** : MOB 1

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

**GEN TECH LTD**  
 3017 RT 9W  
 NEW WINDSOR, NY  
 US 12553  
 Contact: JOE SAYEGH  
 joe@gentechltd.com  
 T: (845)568-0500  
 F: (845)568-3073