




FUEL REPORT

Sample Rating Trend

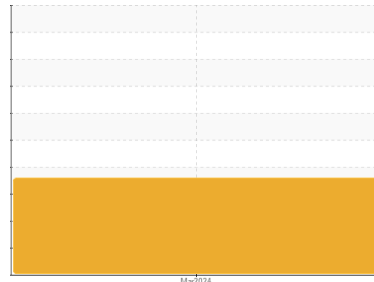

WATER



Machine Id
155996 - PG1

Component
Diesel Fuel

Fluid
No.2 DIESEL FUEL (ULTRALOW SULPHUR) (--- QTS)

DIAGNOSIS

Recommendation

We advise that you perform a filter service, and use off-line filtration to improve the cleanliness of the system fluid.

Corrosion

All metal levels are normal indicating no corrosion in the system.

Contaminants

There is a high amount of silt (particulates < 14 microns in size) present in the fuel. There is a high amount of visible silt present in the sample. There is a light concentration of water present in the fuel. There is no bacteria or fungus (yeast and/or mold) present in the sample.

Fuel Condition

Sulfur value derived by ASTM D5453 method for ULSD validation.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC06135404	---	---
Sample Date	Client Info			29 Mar 2024	---	---
Machine Age	hrs	Client Info		0	---	---
Sample Status				ABNORMAL	---	---

PHYSICAL PROPERTIES		method	limit/base	current	history1	history2
Specific Gravity		*ASTM D1298	0.839	0.842	---	---
Fuel Color	text	*Visual Screen	Yellow	Red	---	---
ASTM Color	scalar	*ASTM D1500		L5.5	---	---
Visc @ 40°C	cSt	ASTM D445	3.0	2.46	---	---
Pensky-Martens Flash Point	°C	*PMCC Calculated	52	64.4	---	---

SULFUR CONTENT		method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185m	10	197	---	---
Sulfur (UVF)	ppm	ASTM D5453		150	---	---






DISTILLATION		method	limit/base	current	history1	history2
Initial Boiling Point	°C	ASTM D86	165	172	---	---
5% Distillation Point	°C	ASTM D86		193	---	---
10% Distill Point	°C	ASTM D86	201	203	---	---
15% Distillation Point	°C	ASTM D86		210	---	---
20% Distill Point	°C	ASTM D86	216	217	---	---
30% Distill Point	°C	ASTM D86	230	231	---	---
40% Distill Point	°C	ASTM D86	243	246	---	---
50% Distill Point	°C	ASTM D86	255	259	---	---
60% Distill Point	°C	ASTM D86	267	273	---	---
70% Distill Point	°C	ASTM D86	280	287	---	---
80% Distill Point	°C	ASTM D86	295	304	---	---
85% Distillation Point	°C	ASTM D86		313	---	---
90% Distill Point	°C	ASTM D86	310	325	---	---
95% Distillation Point	°C	ASTM D86		341	---	---
Final Boiling Point	°C	ASTM D86	341	348	---	---
Distillation Residue	%	ASTM D86	3.0	1.4	---	---
Distillation Loss	%	ASTM D86	3.0	0.9	---	---

IGNITION QUALITY		method	limit/base	current	history1	history2
API Gravity		ASTM D7777	37.7	36.6	---	---
Cetane Index		ASTM D4737	<40.0	47.8	---	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	<1.0	<1	---	---
Sodium	ppm	ASTM D5185m	<0.1	2	---	---
Potassium	ppm	ASTM D5185m	<0.1	0	---	---
Water	%	ASTM D6304	<0.05	▲ 0.083	---	---
ppm Water	ppm	ASTM D6304	<500	▲ 832	---	---
% Gasoline	%	*In-House	<0.50	0.0	---	---
% Biodiesel	%	*In-House	<20.0	0.0	---	---



FUEL REPORT

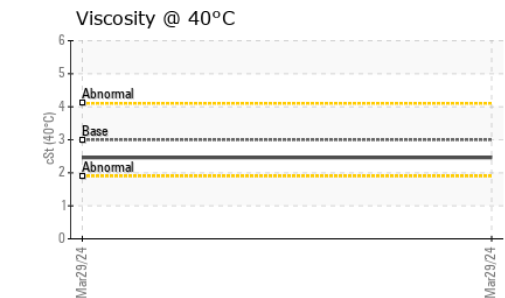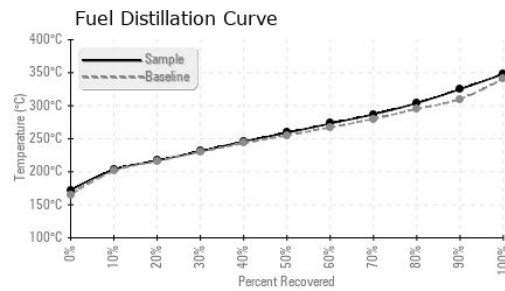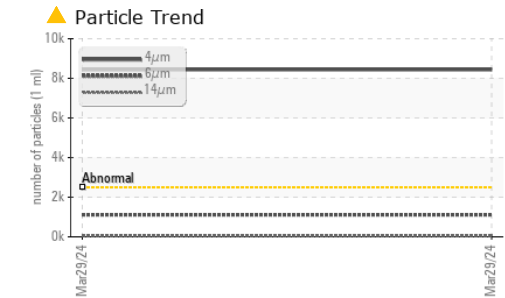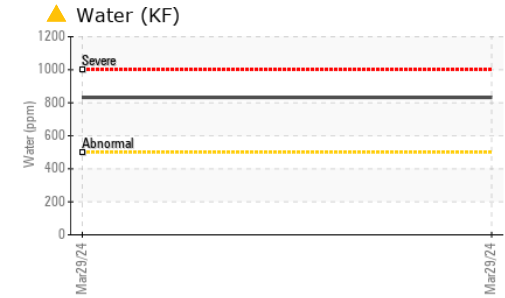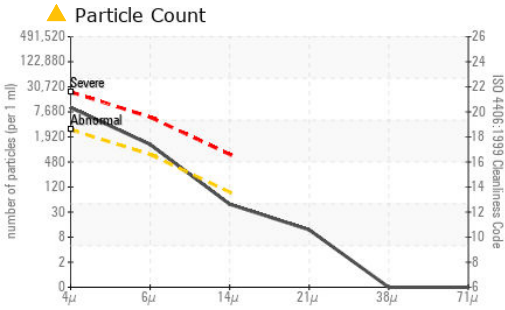

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC06135404 **Received** : 01 Apr 2024
Lab Number : 06135404 **Tested** : 11 Apr 2024
Unique Number : 10954869 **Diagnosed** : 11 Apr 2024 - Doug Bogart
Test Package : DF-2 (Additional Tests: BACTERIA, Fuel, Screen)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

COUCH OIL COMPANY
 2907 HILLSBOROUGH RD
 DURHAM, NC
 US 27705
 Contact: JESSE BROWN
 jesse@couchoilcompany.com
 T: (919)285-5408
 F:

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>2500	▲ 8439	---	---
Particles >6µm	ASTM D7647	>640	● 1111	---	---
Particles >14µm	ASTM D7647	>80	41	---	---
Particles >21µm	ASTM D7647	>20	10	---	---
Particles >38µm	ASTM D7647	>4	0	---	---
Particles >71µm	ASTM D7647	>3	0	---	---
Oil Cleanliness	ISO 4406 (c)	>18/16/13	▲ 20/17/13	---	---

MICROBIAL	method	limit/base	current	history1	history2
Bacteria	CFU/ml WC-Method	>=100000	0	---	---
Yeast	CFU/ml WC-Method	>=100000	0	---	---
Mold	Colonies WC-Method	MODER	---	---	---

HEAVY METALS	method	limit/base	current	history1	history2
Aluminum	ppm ASTM D5185m	<0.1	0	---	---
Nickel	ppm ASTM D5185m	<0.1	0	---	---
Lead	ppm ASTM D5185m	<0.1	0	---	---
Vanadium	ppm ASTM D5185m	<0.1	0	---	---
Iron	ppm ASTM D5185m	<0.1	0	---	---
Calcium	ppm ASTM D5185m	<0.1	4	---	---
Magnesium	ppm ASTM D5185m	<0.1	0	---	---
Phosphorus	ppm ASTM D5185m	<0.1	0	---	---
Zinc	ppm ASTM D5185m	<0.1	0	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image

