




OIL ANALYSIS REPORT

Sample Rating Trend

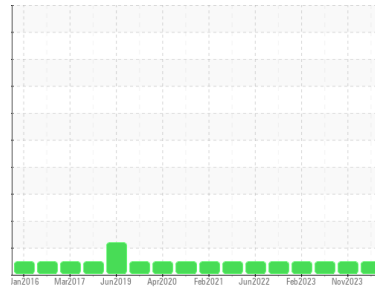

NORMAL



Area
THUNDER SPIRIT [200009532]
 Machine Id
42WEA84006 (S/N EWP00748)
 Component
Wind Turbine Gearbox
 Fluid
CASTROL OPTIGEAR SYNTHETIC X 320 (--- QTS)

DIAGNOSIS

Recommendation
 Resample at the next service interval to monitor.

Wear
 All component wear rates are normal.

Contamination
 There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable.

Fluid Condition
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		NX014493	NX014754	NX013618
Sample Date	Client Info		13 Mar 2024	27 Nov 2023	13 Jul 2023
Machine Age	hrs	Client Info	59565	57431	55464
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			NORMAL	NORMAL	NORMAL

WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184	>80	14	12	11
Iron	ppm	ASTM D5185m	>150	3	2
Chromium	ppm	ASTM D5185m	>5	<1	<1
Nickel	ppm	ASTM D5185m	>10	<1	0
Titanium	ppm	ASTM D5185m	>10	<1	<1
Silver	ppm	ASTM D5185m		0	0
Aluminum	ppm	ASTM D5185m	>10	7	7
Lead	ppm	ASTM D5185m	>20	<1	0
Copper	ppm	ASTM D5185m	>50	2	<1
Tin	ppm	ASTM D5185m	>10	<1	0
Vanadium	ppm	ASTM D5185m		<1	0
Cadmium	ppm	ASTM D5185m		<1	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0
Barium	ppm	ASTM D5185m		<1	8
Molybdenum	ppm	ASTM D5185m	1150	819	838
Manganese	ppm	ASTM D5185m		<1	0
Magnesium	ppm	ASTM D5185m		6	6
Calcium	ppm	ASTM D5185m	2000	1574	1494
Phosphorus	ppm	ASTM D5185m	400	361	364
Zinc	ppm	ASTM D5185m	0	0	0
Sulfur	ppm	ASTM D5185m	1850	2106	2069

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	12	11
Sodium	ppm	ASTM D5185m	>20	4	2
Potassium	ppm	ASTM D5185m	>20	3	2
Water	%	ASTM D6304	>0.05	0.015	0.012
ppm Water	ppm	ASTM D6304	>500	150	129

FLUID CLEANLINESS






	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		492	387	523
Particles >6µm	ASTM D7647	>2500	103	121	153
Particles >14µm	ASTM D7647	>320	14	24	23
Particles >21µm	ASTM D7647	>80	6	6	8
Particles >38µm	ASTM D7647	>20	1	0	1
Particles >71µm	ASTM D7647	>4	0	0	0
Oil Cleanliness	ISO 4406 (c)	>--/18/15	16/14/11	16/14/12	16/14/12

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.6	1.43	0.72




OIL ANALYSIS REPORT

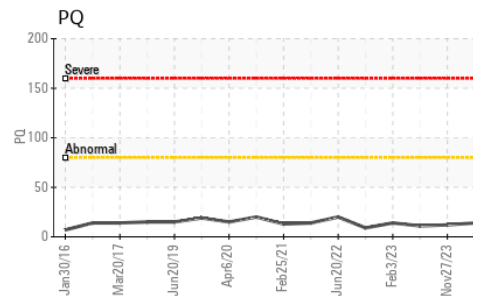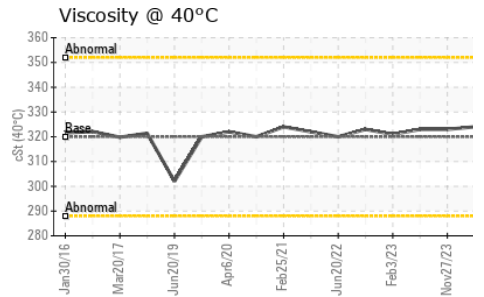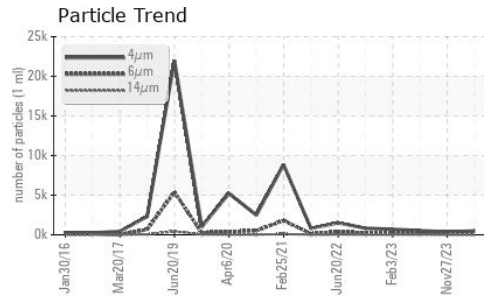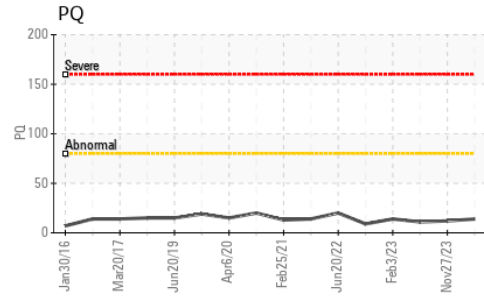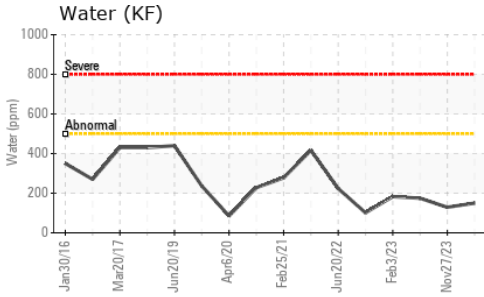






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 320	324	323	323

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

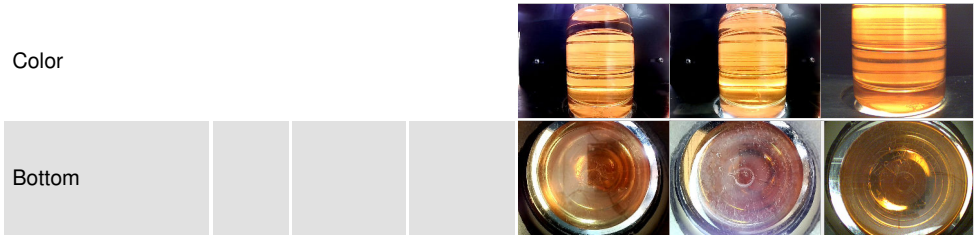

GRAPHS

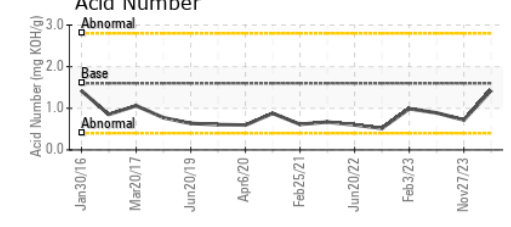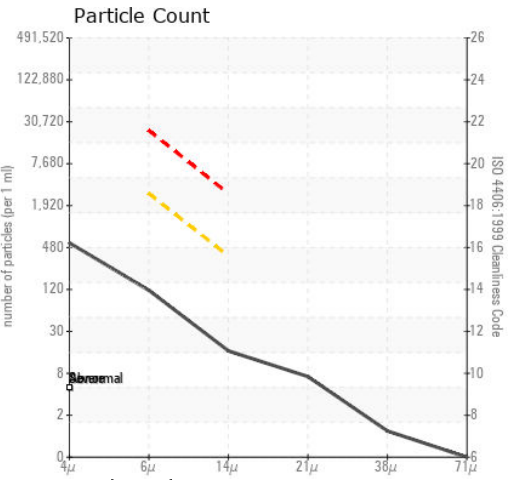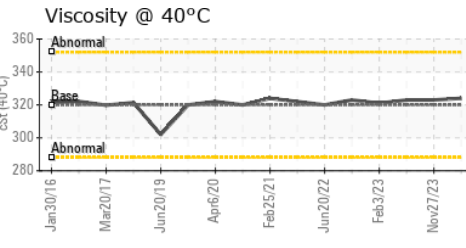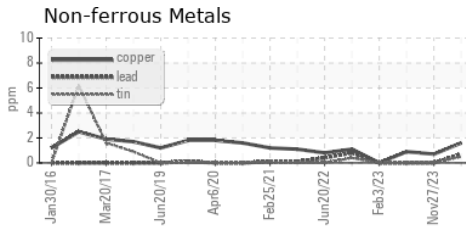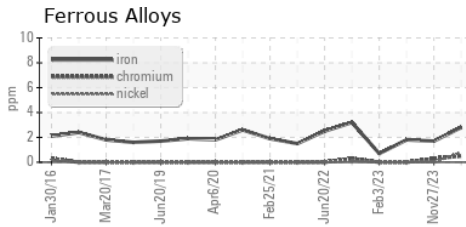

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : NX014493

Lab Number : 06135613

Unique Number : 10955078

Test Package : IND 2 (Additional Tests: KF, PQ, PrtCount)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Received : 01 Apr 2024

Tested : 03 Apr 2024

Diagnosed : 04 Apr 2024 - Don Baldrige

NORDEX USA - Chicago

300 SOUTH WACKER DRIVE, SUITE 1500

CHICAGO, IL

US 60606

Contact: DEVIN LINEHAN

DLinehan@nordex-online.com

T: (312)386-4124

F: (312)386-7102