



OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id
KAESER 8489420 (S/N 2305)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation
 No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear
 All component wear rates are normal.

Contamination
 There is a high amount of particulates present in the oil.

Fluid Condition
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION	method	limit/base	current	history1	history2
Sample Number	Client Info		KCPA015977	KCPA010773	---
Sample Date	Client Info		26 Mar 2024	16 Nov 2023	---
Machine Age	hrs	Client Info	1131	11	---
Oil Age	hrs	Client Info	1131	0	---
Oil Changed	Client Info		Not Chngd	N/A	---
Sample Status			ABNORMAL	ABNORMAL	---

WEAR METALS	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	1	<1	---
Chromium	ppm	ASTM D5185m >10	<1	0	---
Nickel	ppm	ASTM D5185m >3	<1	<1	---
Titanium	ppm	ASTM D5185m >3	<1	<1	---
Silver	ppm	ASTM D5185m >2	0	0	---
Aluminum	ppm	ASTM D5185m >10	2	2	---
Lead	ppm	ASTM D5185m >10	1	<1	---
Copper	ppm	ASTM D5185m >50	3	1	---
Tin	ppm	ASTM D5185m >10	1	<1	---
Vanadium	ppm	ASTM D5185m	<1	0	---
Cadmium	ppm	ASTM D5185m	<1	<1	---






ADDITIVES	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	0	0	---
Barium	ppm	ASTM D5185m 90	28	25	---
Molybdenum	ppm	ASTM D5185m 0	1	<1	---
Manganese	ppm	ASTM D5185m	1	<1	---
Magnesium	ppm	ASTM D5185m 100	50	22	---
Calcium	ppm	ASTM D5185m 0	7	<1	---
Phosphorus	ppm	ASTM D5185m 0	2	0	---
Zinc	ppm	ASTM D5185m 0	9	0	---
Sulfur	ppm	ASTM D5185m 23500	21693	19473	---

CONTAMINANTS	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	2	<1	---
Sodium	ppm	ASTM D5185m	17	0	---
Potassium	ppm	ASTM D5185m >20	21	6	---
Water	%	ASTM D6304 >0.05	0.017	▲ 0.109	---
ppm Water	ppm	ASTM D6304 >500	174	▲ 1090	---

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		28910	---	---
Particles >6µm	ASTM D7647 >1300		▲ 10874	---	---
Particles >14µm	ASTM D7647 >80		▲ 1329	---	---
Particles >21µm	ASTM D7647 >20		▲ 299	---	---
Particles >38µm	ASTM D7647 >4		▲ 5	---	---
Particles >71µm	ASTM D7647 >3		0	---	---
Oil Cleanliness	ISO 4406 (c) >--/17/13		▲ 22/21/18	---	---

FLUID DEGRADATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	0.27	0.24	---


OIL ANALYSIS REPORT

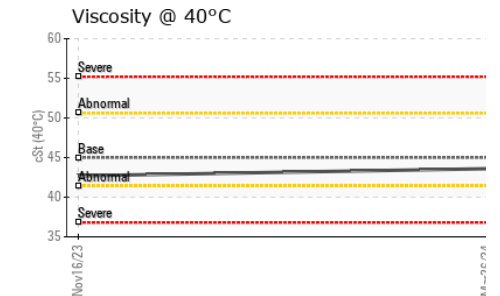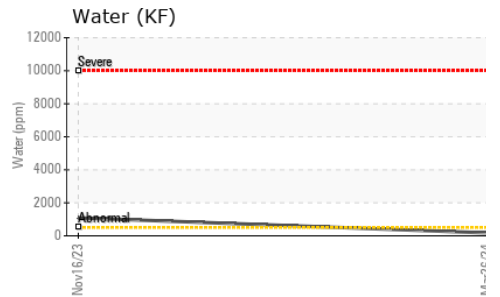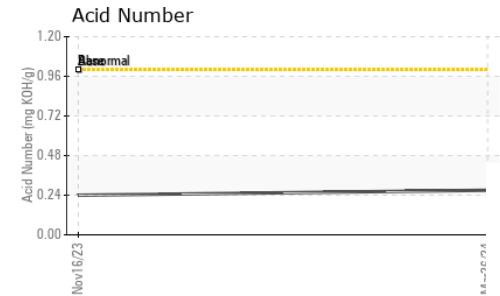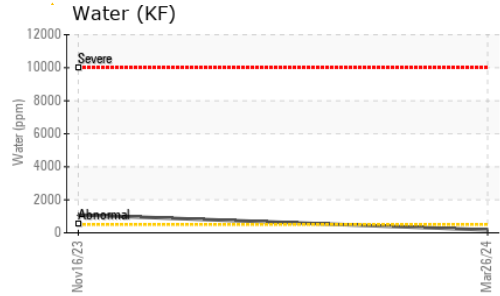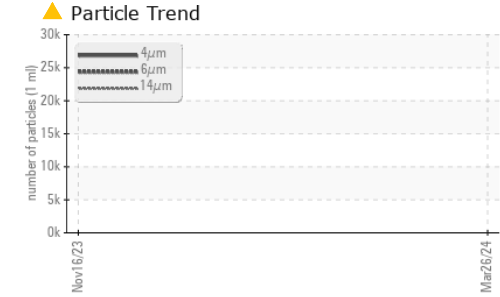





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	0.2%
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	43.6	42.7

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

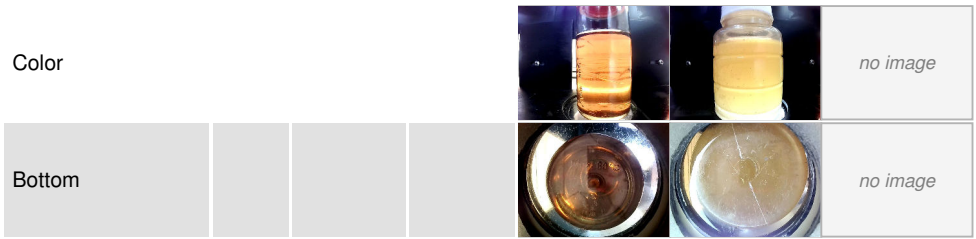

GRAPHS

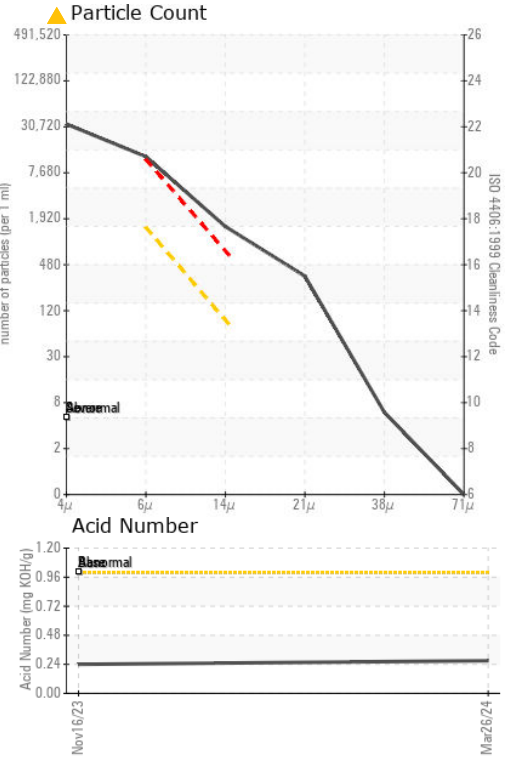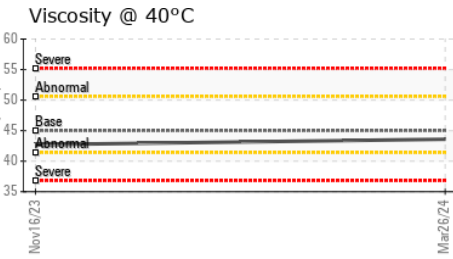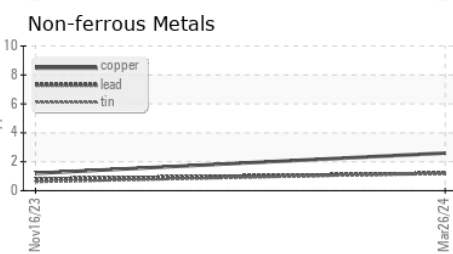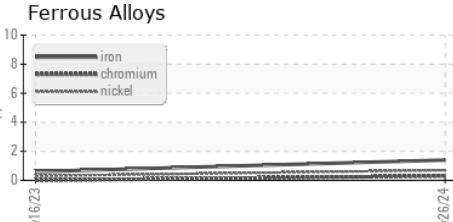

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA015977 **Received** : 01 Apr 2024
Lab Number : 06135637 **Tested** : 03 Apr 2024
Unique Number : 10955102 **Diagnosed** : 04 Apr 2024 - Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

TESLA INC
 48 INDUSTRIAL DR
 BOSTON, MA
 US 02110
 Contact: C. COTTER
 ccotter@tesla.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)