




# OIL ANALYSIS REPORT

Sample Rating Trend

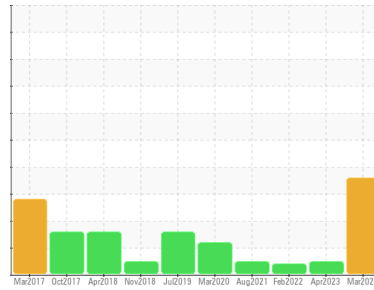

**WATER**



Machine Id  
**KAESER SFC 22T 4865447 (S/N 1018)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) M-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

The filter change at the time of sampling has been noted. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.

### Wear

All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil. There is a light concentration of water present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KCPA016394</b>	KCPA001299	KCP35183
Sample Date	Client Info			<b>26 Mar 2024</b>	06 Apr 2023	16 Feb 2022
Machine Age	hrs	Client Info		<b>25857</b>	23517	20650
Oil Age	hrs	Client Info		<b>2340</b>	0	1370
Oil Changed	Client Info			<b>Not Chngd</b>	N/A	Not Chngd
Sample Status				<b>ABNORMAL</b>	NORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>1</b>	<1	<1
Chromium	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m	>3	<b>&lt;1</b>	0	0
Titanium	ppm	ASTM D5185m	>3	<b>&lt;1</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>10	<b>2</b>	0	<1
Lead	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>9</b>	5	2
Tin	ppm	ASTM D5185m	>10	<b>1</b>	0	0
Antimony	ppm	ASTM D5185m		<b>---</b>	---	0
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	<b>0</b>	0	<1
Barium	ppm	ASTM D5185m	90	<b>0</b>	0	9
Molybdenum	ppm	ASTM D5185m	0	<b>1</b>	0	0
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m	100	<b>6</b>	19	60
Calcium	ppm	ASTM D5185m	0	<b>4</b>	<1	0
Phosphorus	ppm	ASTM D5185m	0	<b>&lt;1</b>	8	7
Zinc	ppm	ASTM D5185m	0	<b>46</b>	46	13
Sulfur	ppm	ASTM D5185m	23500	<b>22201</b>	19012	16936

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>&lt;1</b>	<1	<1
Sodium	ppm	ASTM D5185m		<b>5</b>	9	26
Potassium	ppm	ASTM D5185m	>20	<b>3</b>	2	0
Water	%	ASTM D6304	>0.05	<b>▲ 0.302</b>	0.013	0.013
ppm Water	ppm	ASTM D6304	>500	<b>▲ 3020</b>	132.8	136.3

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>2427</b>	1453	---
Particles >6µm		ASTM D7647	>1300	<b>▲ 1322</b>	359	---
Particles >14µm		ASTM D7647	>80	<b>▲ 225</b>	33	---
Particles >21µm		ASTM D7647	>20	<b>▲ 76</b>	13	---
Particles >38µm		ASTM D7647	>4	<b>▲ 12</b>	1	---
Particles >71µm		ASTM D7647	>3	<b>1</b>	0	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	<b>▲ 18/18/15</b>	18/16/12	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	<b>0.42</b>	0.37	0.35


# OIL ANALYSIS REPORT

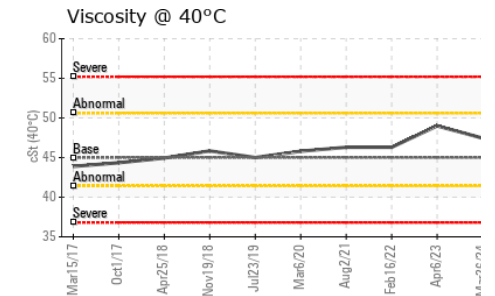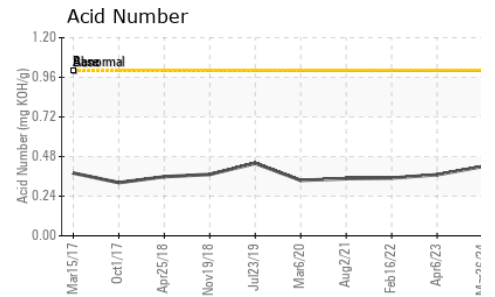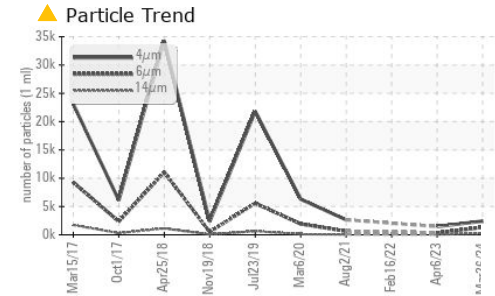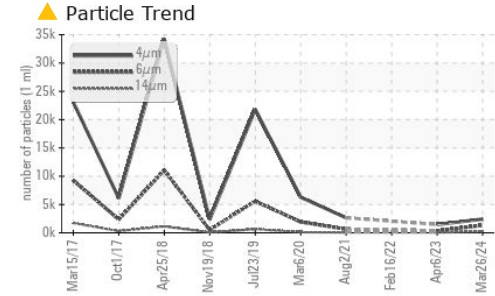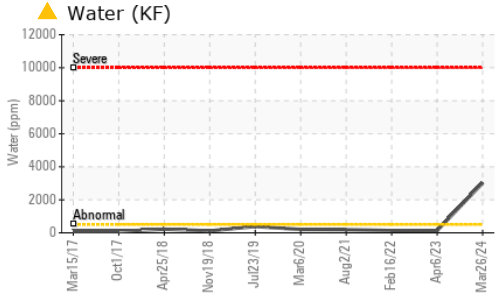




VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT ▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	0.2%	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	47.45	49.0

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

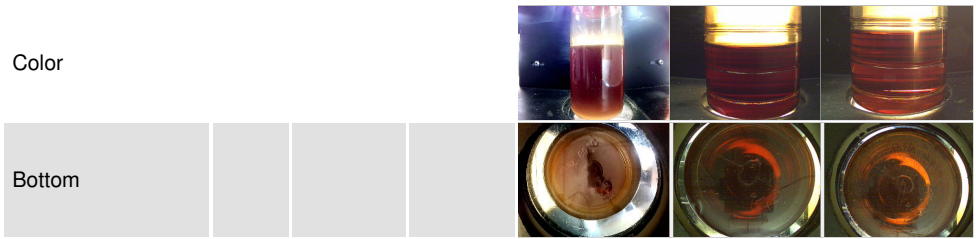

## GRAPHS

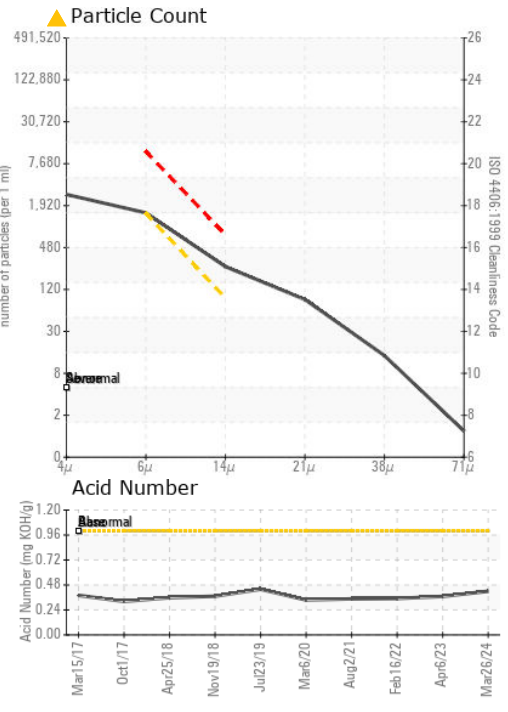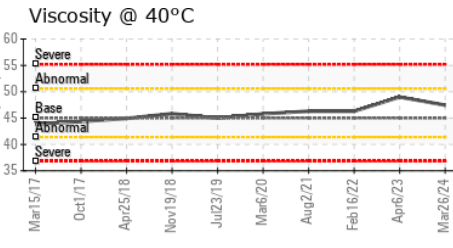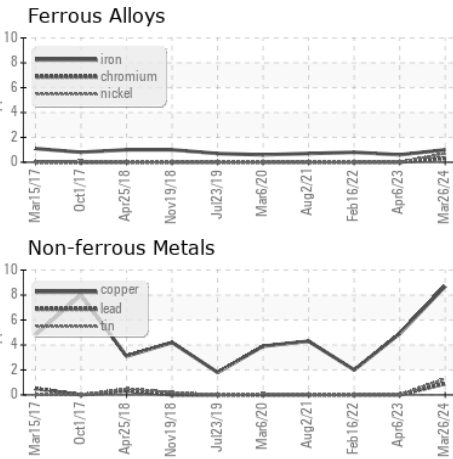

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA016394 **Received** : 01 Apr 2024  
**Lab Number** : 06135645 **Tested** : 08 Apr 2024  
**Unique Number** : 10955110 **Diagnosed** : 08 Apr 2024 - Jonathan Hester  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**OLD CASTLE PRECAST**  
 154 OLD FARMS RD  
 AVON, CT  
 US 06001  
 Contact: NICK MANOCCHIO  
 nick.manocchio@oldcastle.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)