




OIL ANALYSIS REPORT

Sample Rating Trend

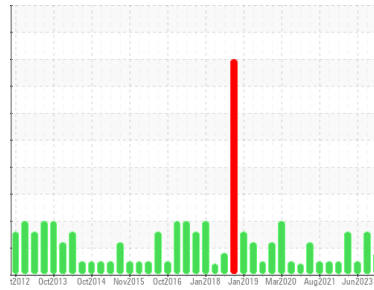

ISO



Machine Id
KAESER SFC 30ST 4358855 (S/N 1007)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) M-460 (--- QTS)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KCPA015025	KC98736	KCPA003175
Sample Date	Client Info		26 Mar 2024	14 Dec 2023	07 Jun 2023
Machine Age	hrs	Client Info	97566	95639	93631
Oil Age	hrs	Client Info	2000	2008	0
Oil Changed	Client Info		Not Chngd	Not Chngd	N/A
Sample Status			ATTENTION	ATTENTION	NORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	1	0	0
Chromium	ppm	ASTM D5185m >10	<1	0	0
Nickel	ppm	ASTM D5185m >3	<1	0	0
Titanium	ppm	ASTM D5185m >3	<1	<1	0
Silver	ppm	ASTM D5185m >2	<1	0	0
Aluminum	ppm	ASTM D5185m >10	2	0	0
Lead	ppm	ASTM D5185m >10	<1	0	0
Copper	ppm	ASTM D5185m >50	3	2	7
Tin	ppm	ASTM D5185m >10	1	<1	0
Vanadium	ppm	ASTM D5185m	<1	0	0
Cadmium	ppm	ASTM D5185m	<1	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	0	0	0
Barium	ppm	ASTM D5185m 90	31	22	0
Molybdenum	ppm	ASTM D5185m 0	1	0	0
Manganese	ppm	ASTM D5185m	<1	<1	<1
Magnesium	ppm	ASTM D5185m 100	46	29	0
Calcium	ppm	ASTM D5185m 0	5	0	0
Phosphorus	ppm	ASTM D5185m 0	6	0	3
Zinc	ppm	ASTM D5185m 0	6	0	0
Sulfur	ppm	ASTM D5185m 23500	19923	15054	19402

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<1	0	0
Sodium	ppm	ASTM D5185m	24	20	0
Potassium	ppm	ASTM D5185m >20	11	4	<1
Water	%	ASTM D6304 >0.05	0.013	0.015	0.006
ppm Water	ppm	ASTM D6304 >500	136	156	62.6






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		5334	8260	1192
Particles >6µm	ASTM D7647 >1300		1217	2419	334
Particles >14µm	ASTM D7647 >80		97	119	15
Particles >21µm	ASTM D7647 >20		20	25	2
Particles >38µm	ASTM D7647 >4		0	1	0
Particles >71µm	ASTM D7647 >3		0	0	0
Oil Cleanliness	ISO 4406 (c)	>--/17/13	20/17/14	20/18/14	17/16/11

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	0.37	0.33	0.49

OIL ANALYSIS REPORT

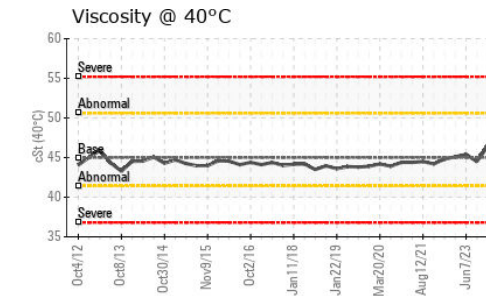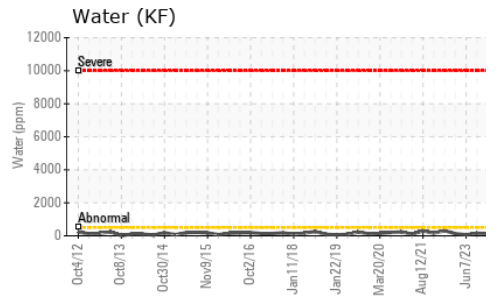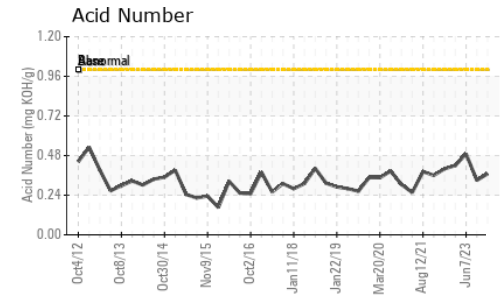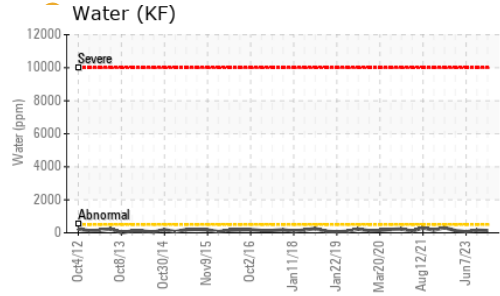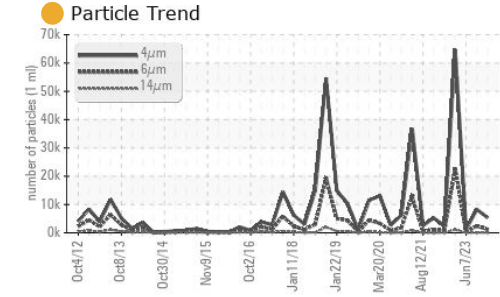






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	LIGHT
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	46.4	44.5

SAMPLE IMAGES

method	limit/base	current	history1	history2
Color				
Bottom				

GRAPHS

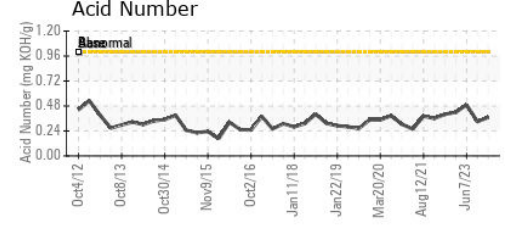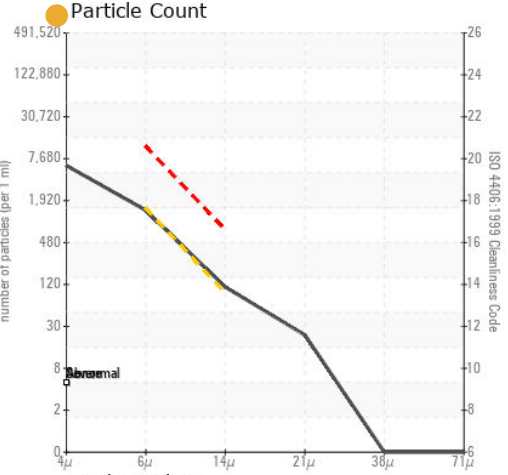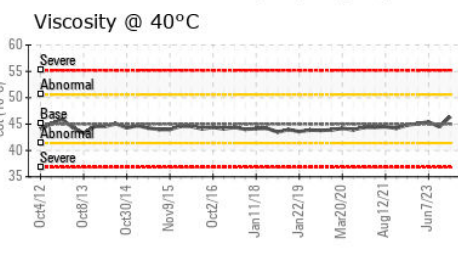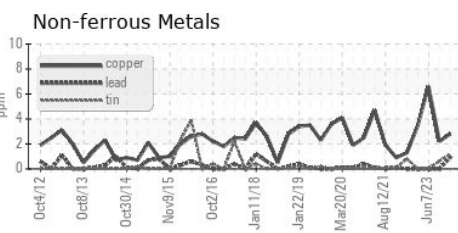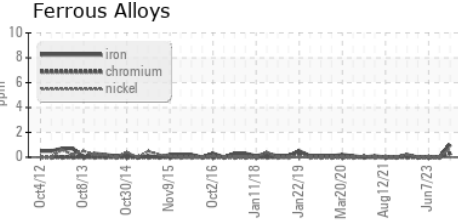

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA015025
Lab Number : 06135652
Unique Number : 10955117
Test Package : IND 2 (Additional Tests: KF, PrtCount)
Received : 01 Apr 2024
Tested : 03 Apr 2024
Diagnosed : 04 Apr 2024 - Don Baldrige

GC HANFORD MFG
 304 ONEIDA ST
 SYRACUSE, NY
 US 13201
 Contact: J FLEMING
 JFLEMING@HANFORD.COM

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)