


# **OIL ANALYSIS REPORT**

Sample Rating Trend

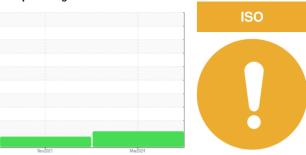

Machine Id

## **KAESER 7164940**

Component Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

## Contamination

There is a moderate amount of particulates present in the oil.


### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Nov2021	Mar2024		
SAMPLE INFORM	/ATION	method	limit/base	current	history1	history2
Sample Number	(11011	Client Info	mma bacc	KCPA016956	KCP94730	
Sample Date		Client Info		28 Mar 2024	11 Nov 2021	
Machine Age	hrs	Client Info		18930	9187	
Oil Age	hrs	Client Info		1187	2913	
Oil Changed	1110	Client Info		Not Changd	Changed	
Sample Status		Oliciti IIIIo		ATTENTION	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	<1	
Chromium	ppm		>10	<1	0	
Nickel	ppm	ASTM D5185m	>3	<1	0	
Titanium	ppm	ASTM D5185m		<1	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m		2	0	
Lead	ppm	ASTM D5185m	>10	1	0	
Copper	ppm	ASTM D5185m		3	3	
Tin		ASTM D5185m	>10	1	0	
Antimony	ppm	ASTM D5185m	>10		0	
Vanadium	ppm	ASTM D5185m		<1	0	
	ppm			<1	0	
Cadmium	ppm	ASTM D5185m		<1	U	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	15	
Barium	ppm	ASTM D5185m	90	24	0	
Molybdenum	ppm	ASTM D5185m		<1	0	
Manganese	ppm	ASTM D5185m		<1	0	
Magnesium	ppm	ASTM D5185m	90	77	35	
Calcium	ppm	ASTM D5185m	2	5	0	
Phosphorus	ppm	ASTM D5185m		0	4	
Zinc	ppm	ASTM D5185m		8	1	
Sulfur	ppm	ASTM D5185m		24845	16149	
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	1	0	
Sodium	ppm	ASTM D5185m		20	12	
Potassium	ppm	ASTM D5185m	>20	4	1	
Water	%	ASTM D6304	>0.05	0.013	0.016	
ppm Water	ppm	ASTM D6304	>500	136	161.2	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		745	2339	
Particles >6µm		ASTM D7647	>1300	237	1002	
Particles >14µm		ASTM D7647	>20	<b>28</b>	<b>△</b> 65	
Particles >21µm		ASTM D7647	>4	<u> </u>	<u>12</u>	
Particles >38µm		ASTM D7647	>3	0	0	
Particles >71µm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>17/11	<b>15/12</b>	<b>▲</b> 17/13	
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2



## **OIL ANALYSIS REPORT**

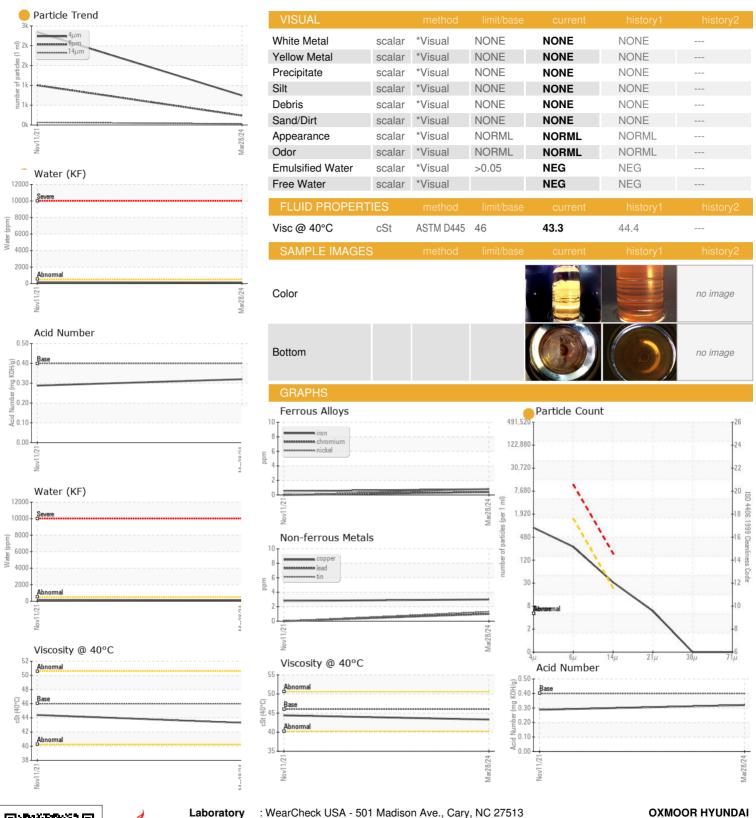





Laboratory Sample No.

Lab Number

: KCPA016956 : 06135665

Unique Number : 10955130

Received **Tested** Diagnosed

: 01 Apr 2024 : 03 Apr 2024

: 04 Apr 2024 - Don Baldridge

US 40222 Contact: Service Manager

8107 SHELBYVILLE RD

LOUISVILLE, KY

Test Package : IND 2 ( Additional Tests: KF, PrtCount ) Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact/Location: Service Manager - OXMLOUHYU

T:

F: