




# OIL ANALYSIS REPORT

Sample Rating Trend

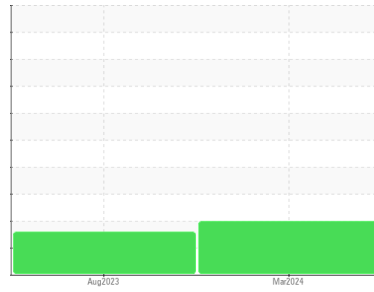

Machine Id  
**8473662 (S/N 1633)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) FG-460 (--- GAL)**

## DIAGNOSIS

**Recommendation**  
 No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

**Wear**  
 All component wear rates are normal.

**Contamination**  
 There is a high amount of particulates present in the oil.

**Fluid Condition**  
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>KC121624</b>	KC104043	---
Sample Date	Client Info	<b>21 Mar 2024</b>	31 Aug 2023	---
Machine Age	hrs	Client Info	<b>6997</b>	5137
Oil Age	hrs	Client Info	<b>0</b>	5137
Oil Changed	Client Info	<b>N/A</b>	Changed	---
Sample Status		<b>ABNORMAL</b>	ABNORMAL	---

## WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>10</b>	0
Chromium	ppm	ASTM D5185m >10	<b>&lt;1</b>	0
Nickel	ppm	ASTM D5185m >3	<b>&lt;1</b>	0
Titanium	ppm	ASTM D5185m >3	<b>&lt;1</b>	0
Silver	ppm	ASTM D5185m >2	<b>&lt;1</b>	0
Aluminum	ppm	ASTM D5185m >10	<b>2</b>	0
Lead	ppm	ASTM D5185m >10	<b>1</b>	0
Copper	ppm	ASTM D5185m >50	<b>14</b>	20
Tin	ppm	ASTM D5185m >10	<b>1</b>	0
Vanadium	ppm	ASTM D5185m	<b>&lt;1</b>	0
Cadmium	ppm	ASTM D5185m	<b>&lt;1</b>	0

## ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0
Barium	ppm	ASTM D5185m	<b>0</b>	0
Molybdenum	ppm	ASTM D5185m	<b>&lt;1</b>	0
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	0
Magnesium	ppm	ASTM D5185m	<b>&lt;1</b>	7
Calcium	ppm	ASTM D5185m	<b>3</b>	1
Phosphorus	ppm	ASTM D5185m 500	<b>146</b>	0
Zinc	ppm	ASTM D5185m	<b>129</b>	10

## CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>&lt;1</b>	0
Sodium	ppm	ASTM D5185m	<b>0</b>	2
Potassium	ppm	ASTM D5185m >20	<b>2</b>	<1
Water	%	ASTM D6304 >0.05	<b>0.005</b>	0.007
ppm Water	ppm	ASTM D6304 >500	<b>57</b>	73.6






## FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	<b>8803</b>	12695	---
Particles >6µm	ASTM D7647 >1300	<b>▲ 2402</b>	▲ 4343	---
Particles >14µm	ASTM D7647 >80	<b>▲ 337</b>	▲ 203	---
Particles >21µm	ASTM D7647 >20	<b>▲ 123</b>	▲ 36	---
Particles >38µm	ASTM D7647 >4	<b>▲ 8</b>	0	---
Particles >71µm	ASTM D7647 >3	<b>1</b>	0	---
Oil Cleanliness	ISO 4406 (c) >--/17/13	<b>▲ 20/18/16</b>	▲ 21/19/15	---

## FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.5	<b>0.60</b>	0.24


# OIL ANALYSIS REPORT

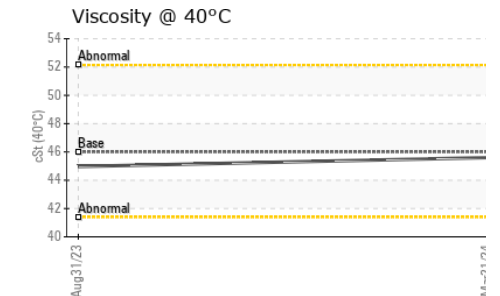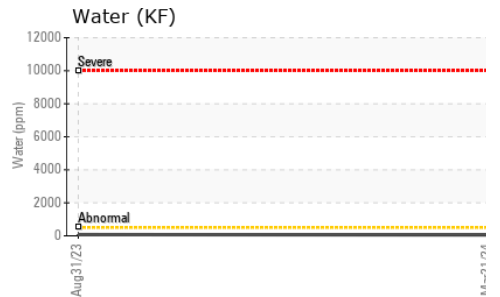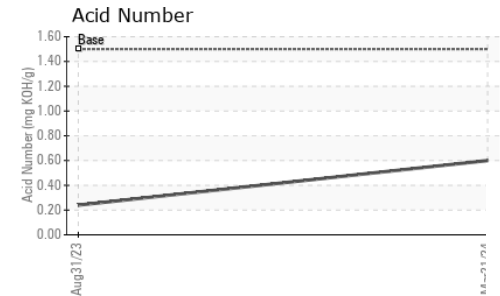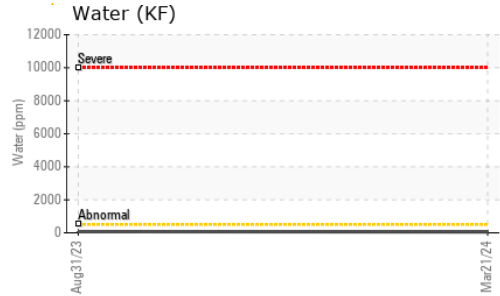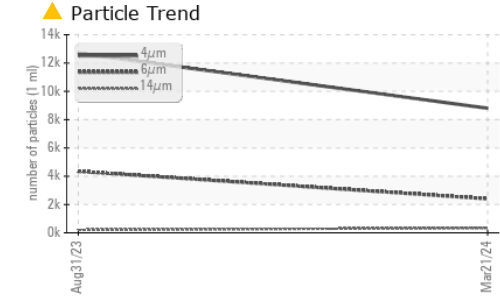






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	45.6	44.97	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

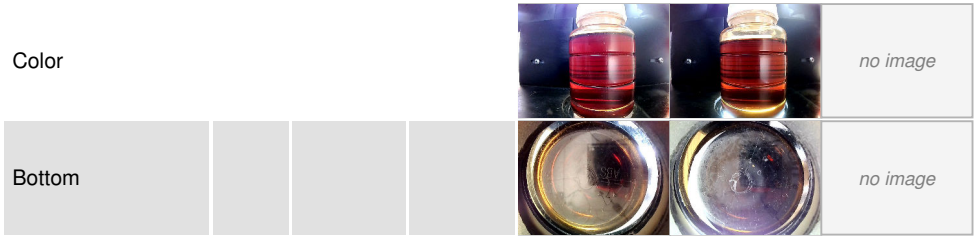

## GRAPHS

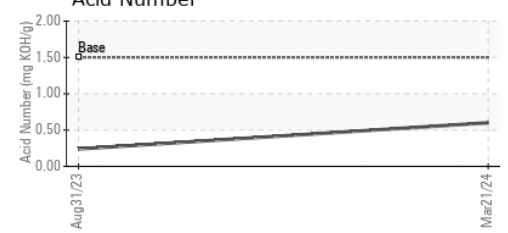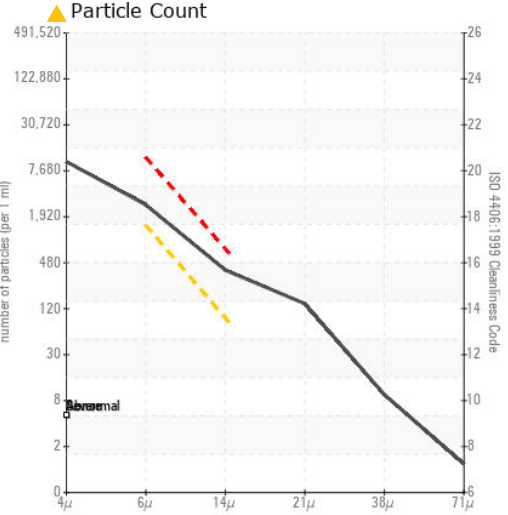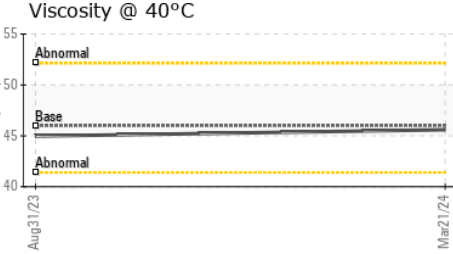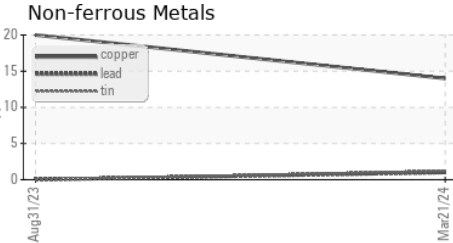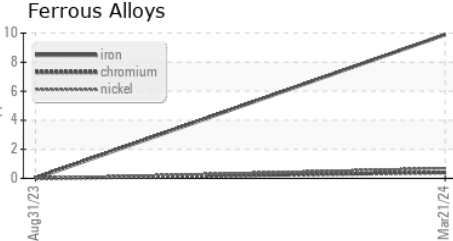

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KC121624  
**Lab Number** : 06135675  
**Unique Number** : 10955140  
**Test Package** : IND 2

**Received** : 01 Apr 2024  
**Tested** : 04 Apr 2024  
**Diagnosed** : 04 Apr 2024 - Don Baldrige

**CIGAR CITY BREWING**  
 3924 W SPRUCE ST  
 TAMPA, FL  
 US 33607  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)