




OIL ANALYSIS REPORT

Sample Rating Trend

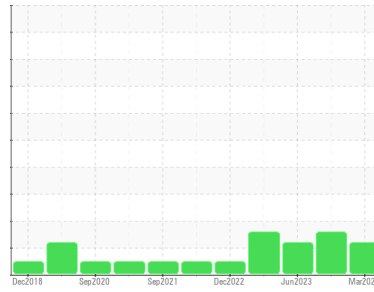

ISO



Machine Id
KAESER AIRCENTER SM 10 6063893 (S/N 2534)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KC123254	KC125776	KC110789
Sample Date	Client Info			22 Mar 2024	22 Sep 2023	23 Jun 2023
Machine Age	hrs	Client Info		28551	26415	25168
Oil Age	hrs	Client Info		0	0	2704
Oil Changed	Client Info			N/A	N/A	Not Changd
Sample Status				ATTENTION	ATTENTION	ATTENTION

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	2	0
Chromium	ppm	ASTM D5185m	>10	<1	<1	0
Nickel	ppm	ASTM D5185m	>3	<1	<1	0
Titanium	ppm	ASTM D5185m	>3	<1	0	<1
Silver	ppm	ASTM D5185m	>2	<1	0	0
Aluminum	ppm	ASTM D5185m	>10	2	1	<1
Lead	ppm	ASTM D5185m	>10	1	0	0
Copper	ppm	ASTM D5185m	>50	2	3	2
Tin	ppm	ASTM D5185m	>10	1	0	0
Vanadium	ppm	ASTM D5185m		<1	<1	0
Cadmium	ppm	ASTM D5185m		<1	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	44	14	24
Molybdenum	ppm	ASTM D5185m		<1	0	0
Manganese	ppm	ASTM D5185m		<1	0	0
Magnesium	ppm	ASTM D5185m	90	71	19	62
Calcium	ppm	ASTM D5185m	2	6	3	0
Phosphorus	ppm	ASTM D5185m		3	3	8
Zinc	ppm	ASTM D5185m		4	2	20

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	0
Sodium	ppm	ASTM D5185m		18	10	18
Potassium	ppm	ASTM D5185m	>20	4	1	2
Water	%	ASTM D6304	>0.05	0.022	0.024	0.024
ppm Water	ppm	ASTM D6304	>500	224	248.3	245.6

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		2679	8128	3538
Particles >6µm		ASTM D7647	>1300	928	2107	1265
Particles >14µm		ASTM D7647	>80	120	125	151
Particles >21µm		ASTM D7647	>20	41	30	35
Particles >38µm		ASTM D7647	>4	2	1	1
Particles >71µm		ASTM D7647	>3	0	1	0
Oil Cleanliness		ISO 4406 (c)	>17/13	17/14	18/14	17/14

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.43	0.34	0.32


OIL ANALYSIS REPORT

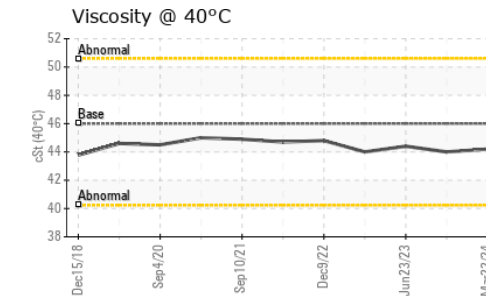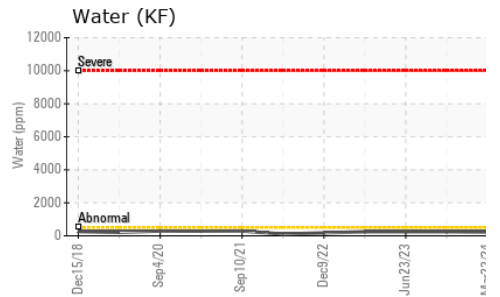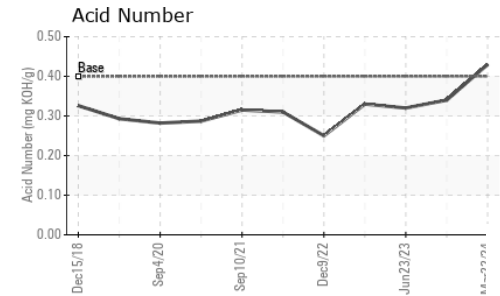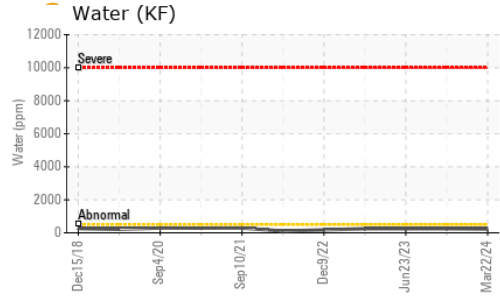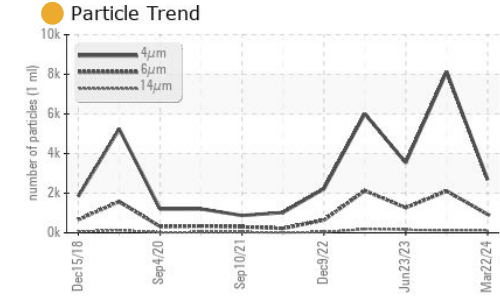





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	44.2	44.0	44.4

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

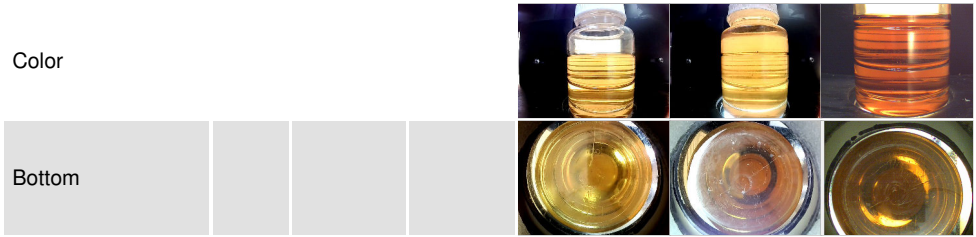

GRAPHS

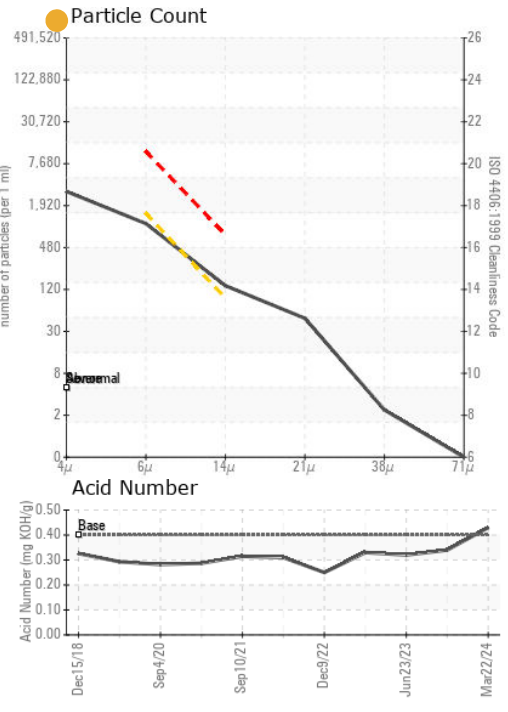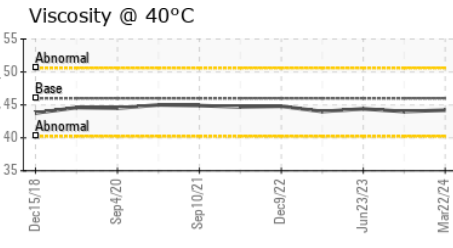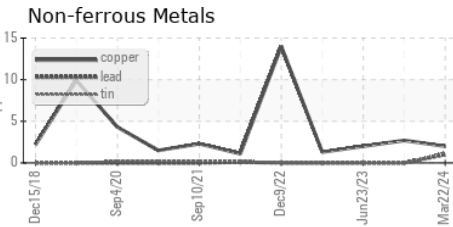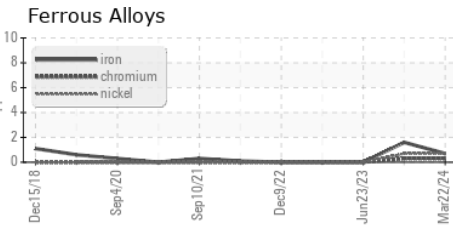

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC123254
Lab Number : 06135677
Unique Number : 10955142
Test Package : IND 2
Received : 01 Apr 2024
Tested : 03 Apr 2024
Diagnosed : 04 Apr 2024 - Don Baldrige

ENDO-THERAPEUTICS INC
 15251 ROOSEVELT BLVD
 CLEARWATER, FL
 US 33760
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)