

OIL ANALYSIS REPORT

Sample Rating Trend ISO

Machine Id

KAESER 8978315

Component Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

						\
			,	Mar2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC123268		
Sample Date		Client Info		14 Mar 2024		
Machine Age	hrs	Client Info		278		
Oil Age	hrs	Client Info		0		
Oil Changed	1115	Client Info		N/A		
Sample Status		Client iiilo		ABNORMAL		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	2		
Chromium	ppm	ASTM D5185m	>10	<1		
Nickel	ppm	ASTM D5185m	>3	<1		
Titanium	ppm	ASTM D5185m	>3	<1		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	2		
Lead	ppm	ASTM D5185m	>10	1		
Copper	ppm	ASTM D5185m	>50	1		
Tin	ppm	ASTM D5185m	>10	1		
Vanadium	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		<1		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m		<1		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	90	2		
Calcium	ppm	ASTM D5185m	2	3		
Phosphorus	ppm	ASTM D5185m	_	64		
Zinc	ppm	ASTM D5185m		32		
CONTAMINANTS		method	limit/base	current	historya	history2
					history1	History2
Silicon	ppm		>25	1		
Sodium	ppm	ASTM D5185m		0		
Potassium	ppm	ASTM D5185m	>20	2		
Water	%	ASTM D6304	>0.05	0.003		
ppm Water	ppm	ASTM D6304	>500	34		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		81864		
Particles >6µm		ASTM D7647	>1300	<u>42181</u>		
Particles >14µm		ASTM D7647	>80	1307		
Particles >21µm		ASTM D7647	>20	4 3		
Particles >38µm		ASTM D7647	>4	0		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>4</u> 24/23/18		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
A	1/011/	10711 00015	0.4			


Acid Number (AN)

mg KOH/g ASTM D8045 0.4

0.19



OIL ANALYSIS REPORT

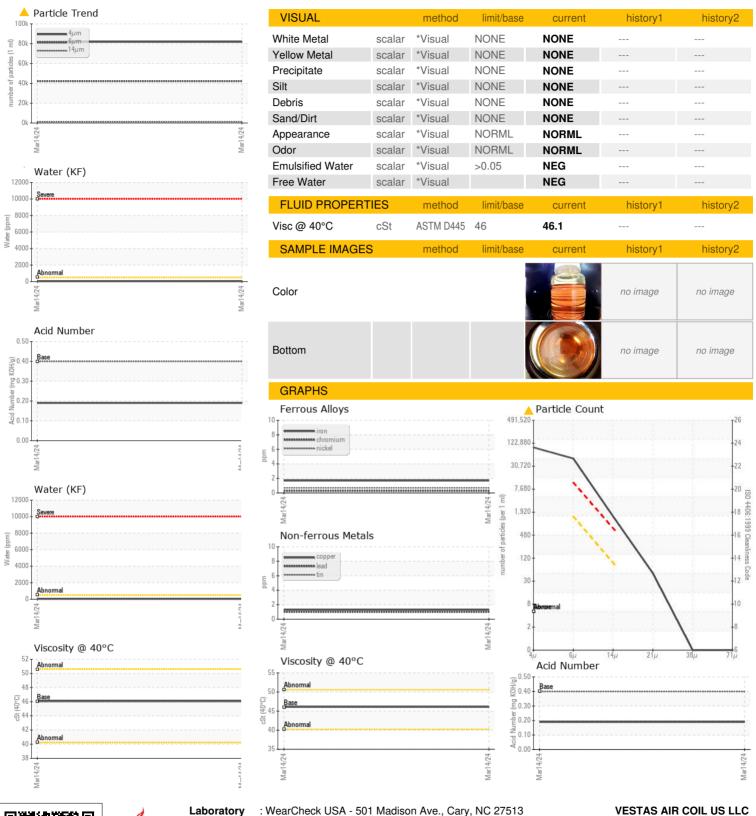



Certificate 12367

Laboratory Sample No. : KC123268 Lab Number : 06135678 Unique Number : 10955143

Received Tested Diagnosed Test Package : IND 2

: 01 Apr 2024 : 04 Apr 2024 : 04 Apr 2024 - Don Baldridge

28261 WOODLAWN PUNTA GORDA, FL US 33982 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

 st - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: