




# OIL ANALYSIS REPORT

Sample Rating Trend

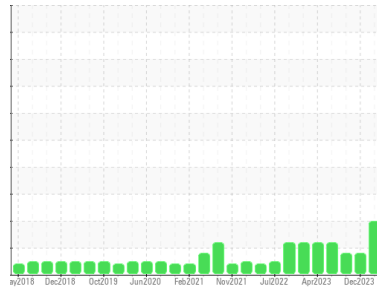

ISO



Area  
**ENGINE ROOM**  
Machine Id  
**C-7 (S/N 08732-002-1-01-01)**  
Component  
**Refrigeration Compressor**  
Fluid  
**USPI 1009-68 SC (35 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a moderate amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>USP0008168</b>	USP0005200	USP243640
Sample Date	Client Info		<b>28 Mar 2024</b>	27 Dec 2023	15 Oct 2023
Machine Age	hrs	Client Info	<b>25387</b>	29387	25386
Oil Age	hrs	Client Info	<b>12042</b>	29387	25386
Oil Changed	Client Info		<b>N/A</b>	N/A	Not Changd
Sample Status			<b>ATTENTION</b>	ATTENTION	ATTENTION

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >8	<b>3</b>	<1	1
Chromium	ppm	ASTM D5185m >2	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m	<b>&lt;1</b>	0	<1
Titanium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >3	<b>0</b>	0	0
Lead	ppm	ASTM D5185m >2	<b>&lt;1</b>	0	<1
Copper	ppm	ASTM D5185m >8	<b>&lt;1</b>	0	<1
Tin	ppm	ASTM D5185m >4	<b>1</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Magnesium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Calcium	ppm	ASTM D5185m	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m	<b>0</b>	0	0
Zinc	ppm	ASTM D5185m	<b>0</b>	0	2
Sulfur	ppm	ASTM D5185m 50	<b>0</b>	0	0

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<b>2</b>	<1	2
Sodium	ppm	ASTM D5185m	<b>0</b>	0	0
Potassium	ppm	ASTM D5185m >20	<b>1</b>	0	<1
Water	%	ASTM D6304 >0.01	<b>0.002</b>	0.002	0.003
ppm Water	ppm	ASTM D6304 >100	<b>24</b>	25	25.1

## FLUID CLEANLINESS






	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	<b>18647</b>	12671	17509
Particles >6µm	ASTM D7647	>2500	<b>4849</b>	1470	2342
Particles >14µm	ASTM D7647	>320	<b>374</b>	19	50
Particles >21µm	ASTM D7647	>80	<b>113</b>	5	15
Particles >38µm	ASTM D7647	>20	<b>4</b>	0	0
Particles >71µm	ASTM D7647	>4	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>20/18/15	<b>21/19/16</b>	21/18/11	21/18/13

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974 0.005	<b>0.014</b>	0.014	0.015




# OIL ANALYSIS REPORT

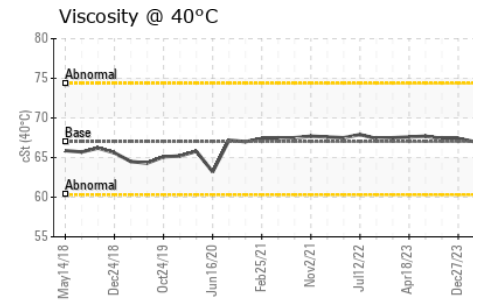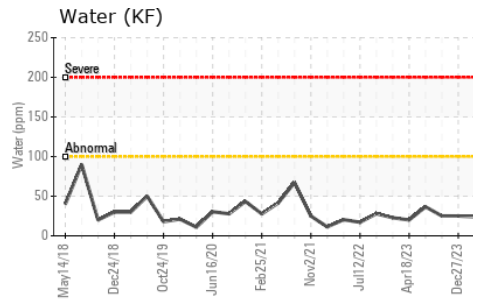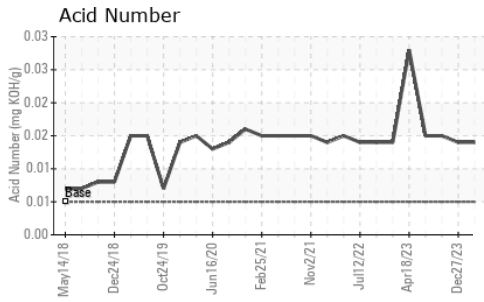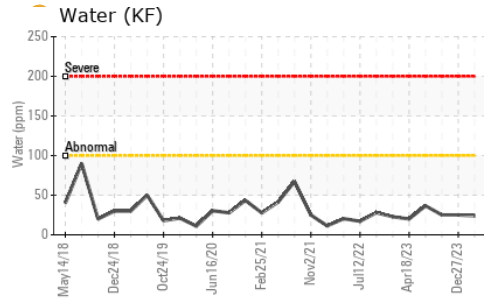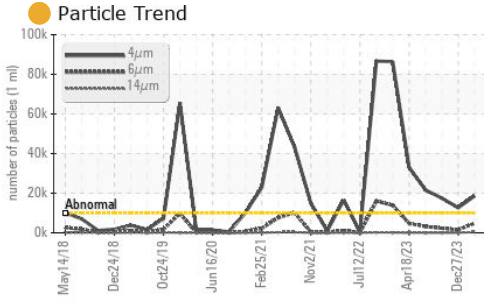






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	67	67.4	67.4

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

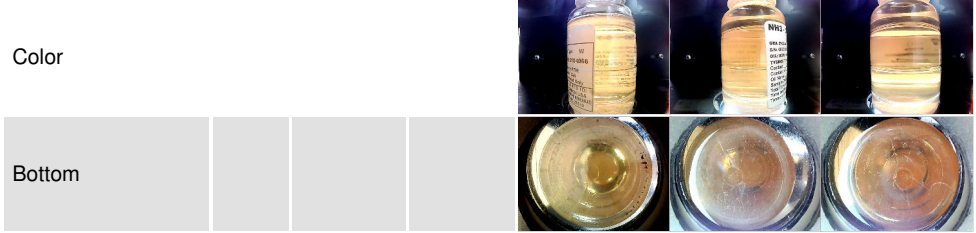

## GRAPHS

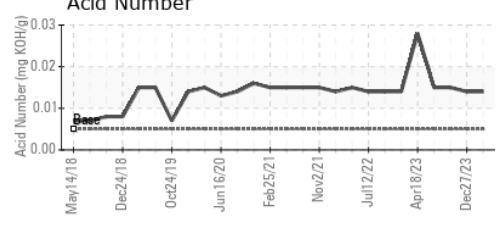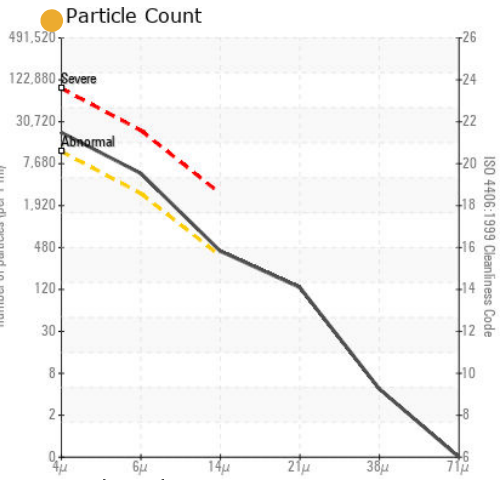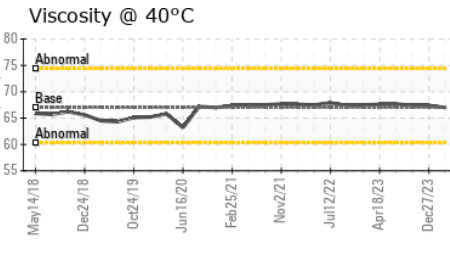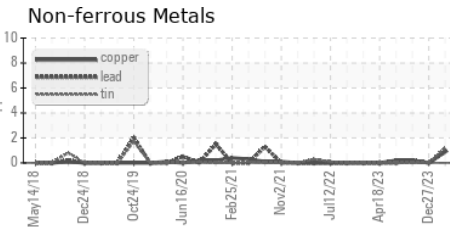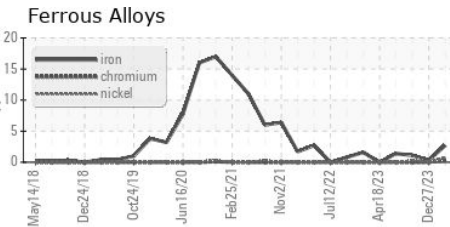

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : USP0008168  
**Lab Number** : 06135707  
**Unique Number** : 10955172  
**Test Package** : IND 2  
**Received** : 01 Apr 2024  
**Tested** : 04 Apr 2024  
**Diagnosed** : 04 Apr 2024 - Doug Bogart

**TYSON - ROCHELLE**  
 ROCHELLE, IL  
 US 61068  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)