




OIL ANALYSIS REPORT

Sample Rating Trend

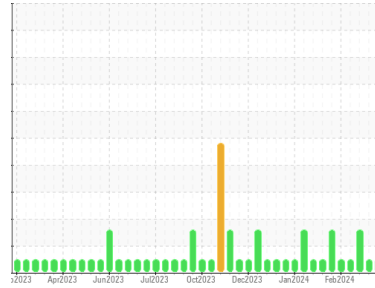

NORMAL



Machine Id

LGS00181

Component

Middle Biogas Engine

Fluid

CITGO PACEMAKER GAS ENGINE LFG LA 40 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0803408	WC0803409	WC0803404
Sample Date	Client Info		25 Mar 2024	19 Mar 2024	11 Mar 2024
Machine Age	hrs	Client Info	66383	66246	66058
Oil Age	hrs	Client Info	163	26	411
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			NORMAL	NORMAL	ABNORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>4.0	<1.0	<1.0	<1.0
Water	WC Method	>0.1	NEG	NEG	NEG
Glycol	WC Method		NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m	>45	8	2	9
Chromium	ppm	ASTM D5185m	>2	<1	0	<1
Nickel	ppm	ASTM D5185m	>2	1	0	0
Titanium	ppm	ASTM D5185m		<1	0	<1
Silver	ppm	ASTM D5185m	>5	0	0	0
Aluminum	ppm	ASTM D5185m	>10	2	<1	3
Lead	ppm	ASTM D5185m	>5	1	0	<1
Copper	ppm	ASTM D5185m	>14	3	<1	2
Tin	ppm	ASTM D5185m	>13	4	1	4
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		<1	0	0

ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m		3	1	<1
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		8	2	4
Manganese	ppm	ASTM D5185m		<1	<1	0
Magnesium	ppm	ASTM D5185m		26	24	44
Calcium	ppm	ASTM D5185m		1464	1411	1494
Phosphorus	ppm	ASTM D5185m		322	302	350
Zinc	ppm	ASTM D5185m		368	351	396
Sulfur	ppm	ASTM D5185m		3150	2789	3308

CONTAMINANTS

	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>200	136	49	▲ 257
Sodium	ppm	ASTM D5185m		<1	<1	0
Potassium	ppm	ASTM D5185m	>20	2	0	1

INFRA-RED





	method	limit/base	current	history1	history2	
Soot %	%	*ASTM D7844		0	0	0
Nitration	Abs/cm	*ASTM D7624	>20	3.3	3.0	3.4
Sulfation	Abs/.1mm	*ASTM D7415	>30	15.9	15.0	17.1

FLUID DEGRADATION

	method	limit/base	current	history1	history2	
Oxidation	Abs/.1mm	*ASTM D7414	>25	7.1	6.8	7.3
Acid Number (AN)	mg KOH/g	ASTM D8045	1.16	1.16	1.159	1.02
Base Number (BN)	mg KOH/g	ASTM D2896	5	3.50	4.18	3.22











OIL ANALYSIS REPORT

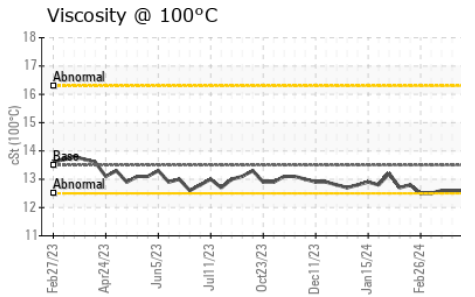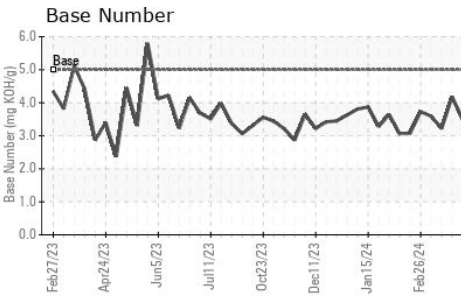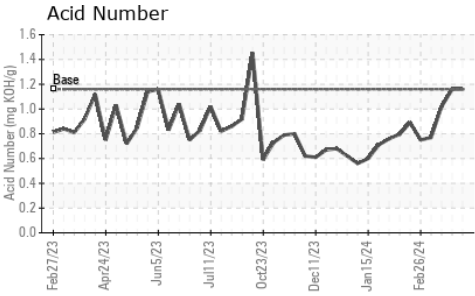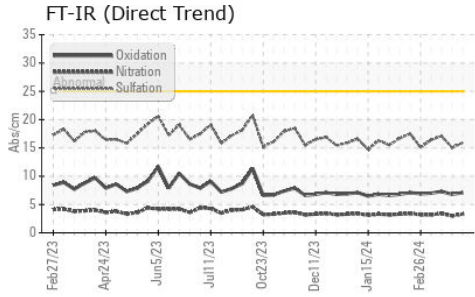

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 100°C	cSt	ASTM D445	13.5	12.6	12.6	12.6

GRAPHS

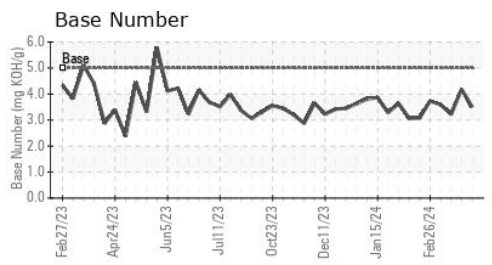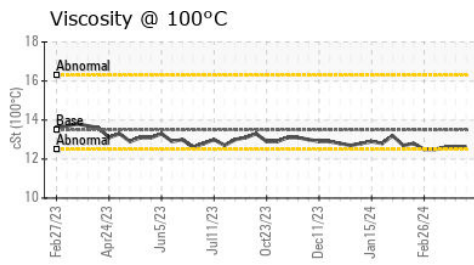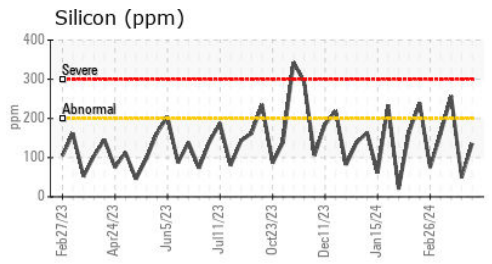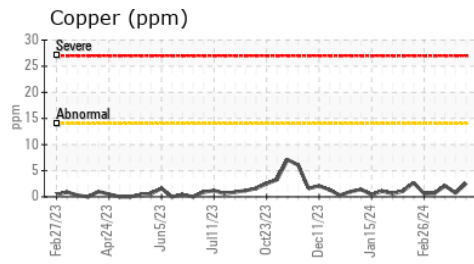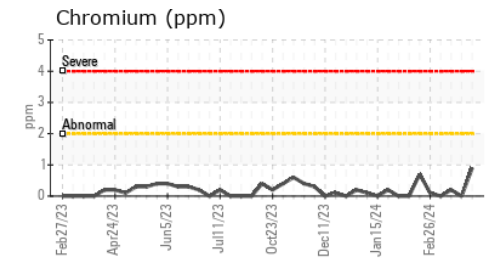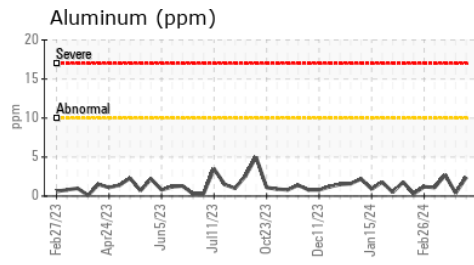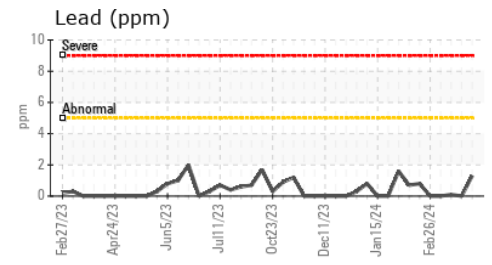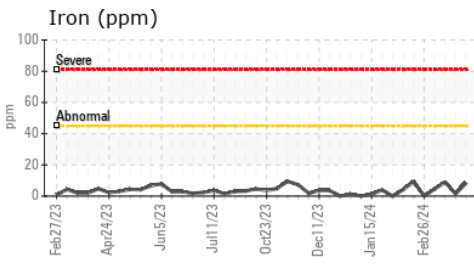

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0803408
Lab Number : 06135741
Unique Number : 10955206
Test Package : MOB 2

Received : 02 Apr 2024
Tested : 03 Apr 2024
Diagnosed : 04 Apr 2024 - Sean Felton

BLACK OAK
 5054 HWY HH
 HARTVILLE, MO
 US 65667

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact: CHIP MATHEWS
 chip.matthews@cubedistrictenergy.com