


COOLANT REPORT

Area

THUNDER SPIRIT [200009532] 25WEA84002 - CONVERTER (S/N EWP00587)

Component

EXTENDED LIFE COOLANT (--- QTS)





DIAGNOSIS

Recommendation

The fluid is suitable for further service.

Corrosion

All metal levels are normal indicating no corrosion in the cooling system.

Contaminants

There is no indication of any contamination in the coolant.

Coolant Condition

Glycol and nitrite levels are acceptable. The pH level of this fluid is within the acceptable limits.


| | | Ар | 2022 | Sep2022 Mar2l | 124 | |
|------------------------|------------|-------------|------------|---------------|-------------|-------------|
| SAMPLE INFORM | MATION | method | limit/base | current | history1 | history2 |
| Sample Number | | Client Info | | NX015504 | NX011171 | NX011189 |
| Sample Date | | Client Info | | 20 Mar 2024 | 26 Sep 2022 | 07 Apr 2022 |
| Machine Age | hrs | Client Info | | 58277 | 48890 | 0 |
| Oil Age | hrs | Client Info | | 0 | 0 | 0 |
| Oil Changed | | Client Info | | N/A | N/A | N/A |
| Sample Status | | | | NORMAL | NORMAL | NORMAL |
| PHYSICAL TEST R | RESULTS | method | limit/base | current | history1 | history2 |
| Glycol Type | | FT-IR | | | | |
| Specific Gravity | | *ASTM D1298 | | 1.078 | 1.072 | 1.079 |
| pH | Scale 0-14 | ASTM D1287 | | 7.89 | 8.12 | 7.80 |
| Nitrites | ppm | AP-053:2009 | | 976 | 1012 | 524 |
| Reserve Alkalinity | Scale 0-20 | *ASTM D1121 | | | | |
| Percentage Glycol | % | ASTM D3321 | | 59.1 | 53.5 | 59.7 |
| Freezing Point | °F | ASTM D3321 | | -56 | -43 | -56 |
| Total Dissolved Solids | | | | 328.0 | 164.0 | 310.0 |
| Carboxylate | | | | n/a | fail | n/a |
| CORROSION INH | IBITORS | method | limit/base | current | history1 | history2 |
| Silicon | ppm | ASTM D6130 | | 11 | 35 | 16 |
| Phosphorus | ppm | ASTM D6130 | | 1494 | 877 | 1041 |
| Boron | ppm | ASTM D6130 | | 273 | 194 | 425 |
| Molybdenum | ppm | ASTM D6130 | | 2 | 111 | 3 |
| CORROSION | | method | limit/base | current | history1 | history2 |
| Iron | ppm | ASTM D6130 | >15 | 3 | 14 | 0 |
| Aluminum | ppm | ASTM D6130 | >10 | <1 | 5 | 0 |
| Copper | ppm | ASTM D6130 | >10 | 0 | 3 | <1 |
| Lead | ppm | ASTM D6130 | >10 | 0 | <1 | 0 |
| Tin | ppm | ASTM D6130 | >10 | 0 | <1 | 0 |
| Zinc | ppm | ASTM D6130 | | 0 | 4 | 0 |
| CONTAMINANTS | | method | limit/base | current | history1 | history2 |
| Chlorine | ppm | ASTM D6130 | | 18 | 18 | 0 |
| CARRIER SALTS | | method | limit/base | current | history1 | history2 |
| Sodium | ppm | ASTM D6130 | | 361 | 248 | 330 |
| Potassium | ppm | ASTM D6130 | | 4843 | 3108 | 2349 |
| SCALE POTENTI | AL | method | limit/base | current | history1 | history2 |
| Calcium | ppm | ASTM D6130 | >100 | 0 | 4 | 0 |
| Magnesium | ppm | ASTM D6130 | >40 | 0 | <1 | <1 |
| I I a malar a a a | | #1 In a | 75 | ^ | | |


Hardness


mg/L CaCO3 *In-house <75



COOLANT REPORT



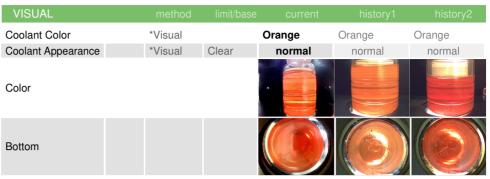

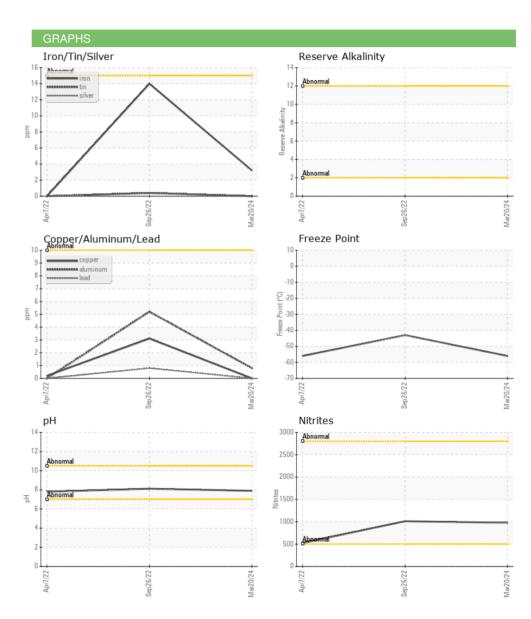



Laboratory Sample No.

: NX015504 Lab Number : 06135984 Unique Number : 10955449

: WearCheck USA - 501 Madison Ave., Cary, NC 27513

Received **Tested** Diagnosed : 05 Apr 2024 - Jonathan Hester

: 01 Apr 2024 : 05 Apr 2024

NORDEX USA - Chicago 300 SOUTH WACKER DRIVE, SUITE 1500

CHICAGO, IL US 60606 Contact: DEVIN LINEHAN

Test Package : COOL (Additional Tests: GlycolType) Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

DLinehan@nordex-online.com T: (312)386-4124

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: (312)386-7102

Report Id: NORDEX [WUSCAR] 06135984 (Generated: 04/05/2024 21:31:47) Rev: 1

Contact/Location: DEVIN LINEHAN - NORDEX