




# OIL ANALYSIS REPORT

Sample Rating Trend

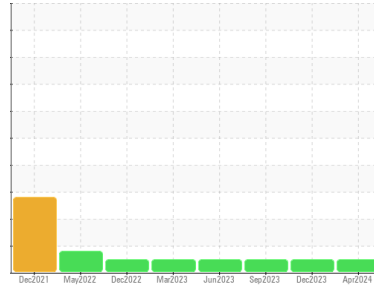

**NORMAL**



Area  
**[W0150819]**  
 Machine Id  
**3005914343**  
 Component  
**Diesel Engine**  
 Fluid  
**RED STAR 15W40 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor. Please specify the component make and model with your next sample.

### Wear

Metal levels are typical for a new component breaking in.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WC0911435</b>	WC0797290	WC0812704
Sample Date	Client Info			<b>01 Apr 2024</b>	14 Dec 2023	11 Sep 2023
Machine Age	hrs	Client Info		<b>57</b>	56	54
Oil Age	hrs	Client Info		<b>57</b>	0	0
Oil Changed	Client Info			<b>Changed</b>	N/A	N/A
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Fuel	WC Method	>5		<b>&lt;1.0</b>	<1.0	<1.0
Water	WC Method	>0.2		<b>NEG</b>	NEG	NEG
Glycol	WC Method			<b>NEG</b>	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>100	<b>&lt;1</b>	0	2
Chromium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m	>4	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m		<b>28</b>	27	25
Silver	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>20	<b>2</b>	2	3
Lead	ppm	ASTM D5185m	>40	<b>0</b>	<1	1
Copper	ppm	ASTM D5185m	>330	<b>1</b>	2	2
Tin	ppm	ASTM D5185m	>15	<b>&lt;1</b>	0	<1
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	<1	<1
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>113</b>	101	109
Barium	ppm	ASTM D5185m		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>55</b>	51	54
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Magnesium	ppm	ASTM D5185m		<b>194</b>	187	230
Calcium	ppm	ASTM D5185m		<b>1989</b>	1830	1939
Phosphorus	ppm	ASTM D5185m		<b>1030</b>	1059	1050
Zinc	ppm	ASTM D5185m		<b>1185</b>	1197	1246
Sulfur	ppm	ASTM D5185m		<b>4255</b>	3859	4180



CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>15</b>	13	16
Sodium	ppm	ASTM D5185m		<b>1</b>	1	1
Potassium	ppm	ASTM D5185m	>20	<b>2</b>	<1	2

INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	>3	<b>0.1</b>	0	0
Nitration	Abs/cm	*ASTM D7624	>20	<b>6.8</b>	6.6	6.6
Sulfation	Abs/.1mm	*ASTM D7415	>30	<b>17.5</b>	17.9	18.1

FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	>25	<b>13.6</b>	13.4	13.9
Base Number (BN)	mg KOH/g	ASTM D2896		<b>7.9</b>	8.1	8.4











# OIL ANALYSIS REPORT

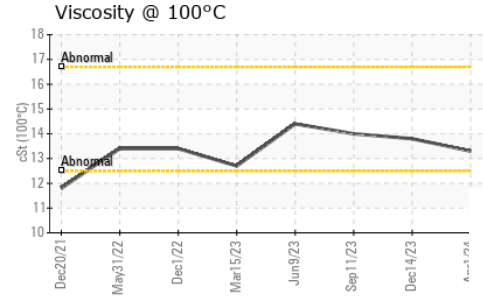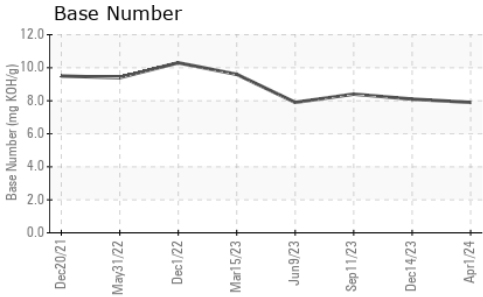

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	<b>13.3</b>	13.8	14.0

## GRAPHS

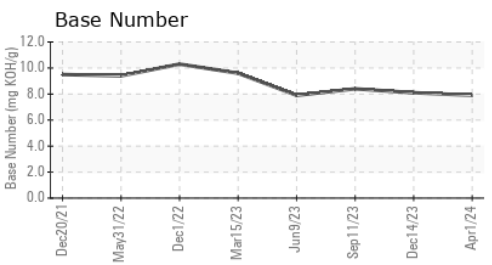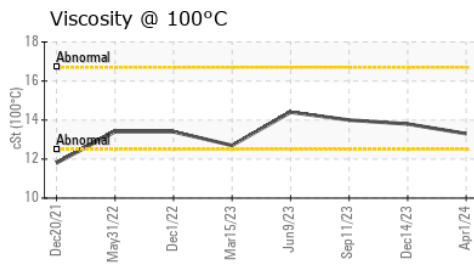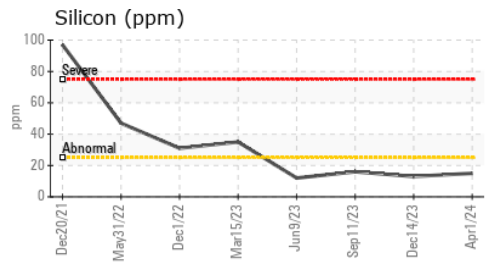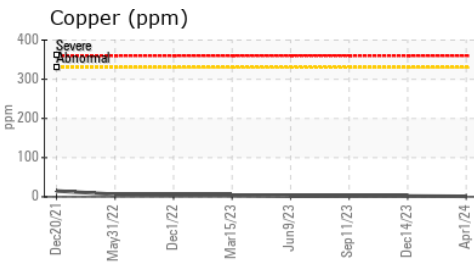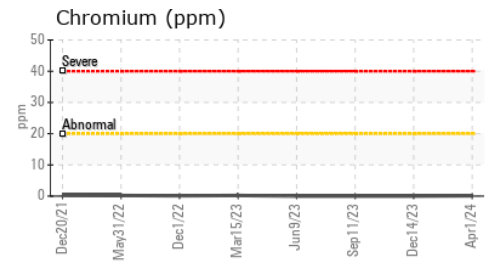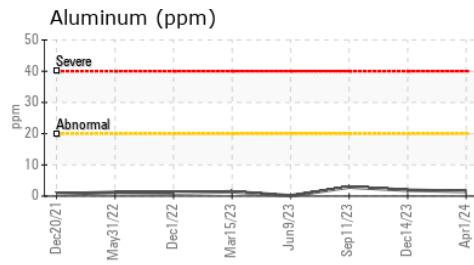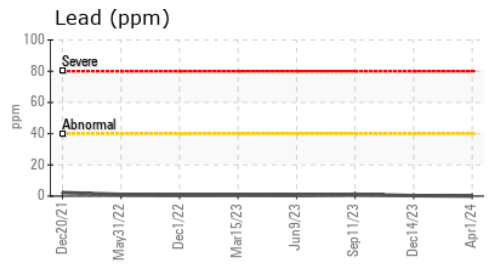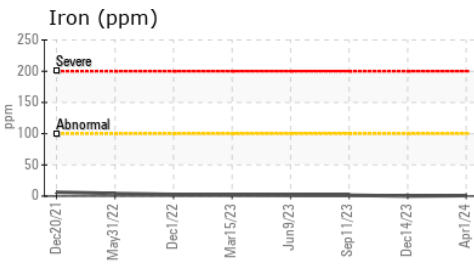

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0911435 **Received** : 02 Apr 2024  
**Lab Number** : **06136054** **Tested** : 03 Apr 2024  
**Unique Number** : 10955519 **Diagnosed** : 03 Apr 2024 - Wes Davis  
**Test Package** : MOB 1 ( Additional Tests: TBN )

**NATIONAL POWER CORP**  
 4541 PRESLYN DR  
 RALEIGH, NC  
 US 27616  
 Contact: BRANDON RICE  
 brandon.rice@natpow.com  
 T:  
 F: (919)790-9714

Certificate L2367  
 To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)