




# OIL ANALYSIS REPORT

Sample Rating Trend

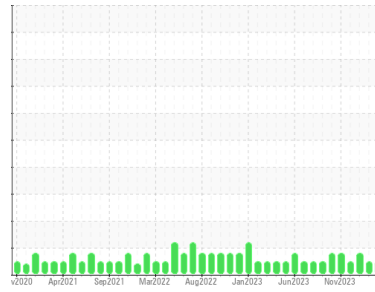

**NORMAL**



Area  
**Environmental**  
 Machine Id  
**RTO 1 RESERVOIR (S/N EN212)**  
 Component  
**Hydraulic System**  
 Fluid  
**DEXRON III (--- GAL)**

## DIAGNOSIS

**Recommendation**  
 Resample at the next service interval to monitor.

**Wear**  
 All component wear rates are normal.

**Contamination**  
 The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable.

**Fluid Condition**  
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WC0895012</b>	WC0895035	WC0834630
Sample Date	Client Info			<b>28 Mar 2024</b>	29 Feb 2024	22 Jan 2024
Machine Age	mths	Client Info		<b>0</b>	0	0
Oil Age	mths	Client Info		<b>0</b>	0	0
Oil Changed	Client Info			<b>N/A</b>	N/A	N/A
Sample Status				<b>NORMAL</b>	NORMAL	ATTENTION

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.05	<b>NEG</b>	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>20	<b>18</b>	17	18
Chromium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m	>20	<b>&lt;1</b>	0	0
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Silver	ppm	ASTM D5185m		<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>20	<b>3</b>	3	3
Lead	ppm	ASTM D5185m	>20	<b>1</b>	3	<1
Copper	ppm	ASTM D5185m	>20	<b>28</b>	24	27
Tin	ppm	ASTM D5185m	>20	<b>2</b>	0	<1
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>95</b>	89	92
Barium	ppm	ASTM D5185m		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	0	<1
Magnesium	ppm	ASTM D5185m		<b>1</b>	<1	<1
Calcium	ppm	ASTM D5185m		<b>86</b>	77	79
Phosphorus	ppm	ASTM D5185m		<b>257</b>	216	206
Zinc	ppm	ASTM D5185m		<b>7</b>	0	11
Sulfur	ppm	ASTM D5185m		<b>897</b>	795	712





CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<b>3</b>	1	2
Sodium	ppm	ASTM D5185m		<b>2</b>	3	4
Potassium	ppm	ASTM D5185m	>20	<b>2</b>	0	0

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>2500	<b>2013</b>	2073	● 2988
Particles >6µm		ASTM D7647	>640	<b>107</b>	8	347
Particles >14µm		ASTM D7647	>80	<b>9</b>	1	20
Particles >21µm		ASTM D7647	>20	<b>3</b>	0	6
Particles >38µm		ASTM D7647	>4	<b>0</b>	0	1
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>18/16/13	<b>18/14/10</b>	18/10/7	● 19/16/11

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.87</b>	0.86	0.77




# OIL ANALYSIS REPORT

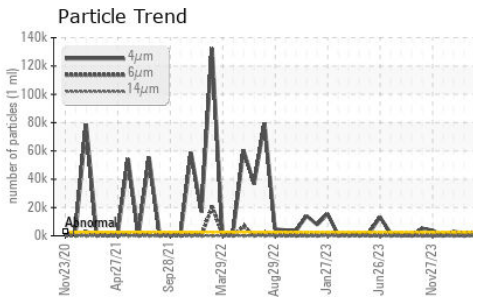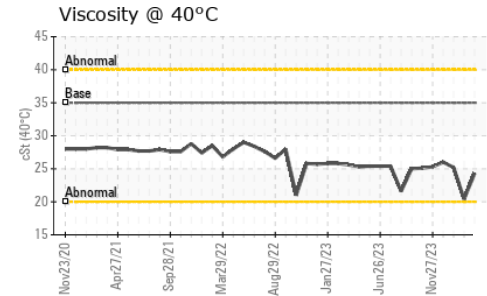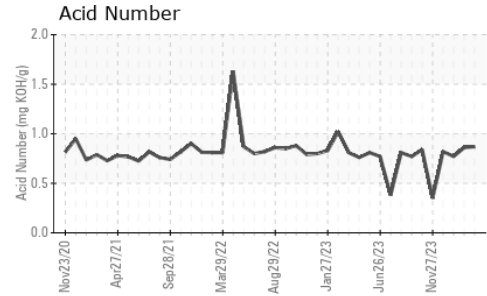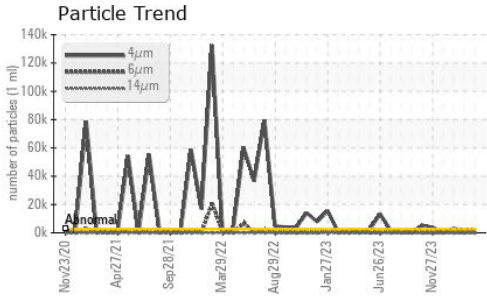






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	35.0	24.3	20.4

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

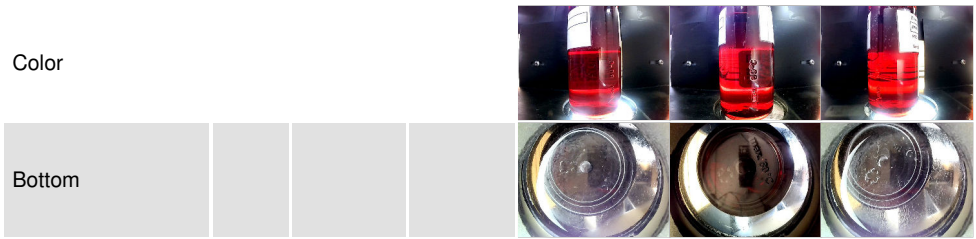

## GRAPHS

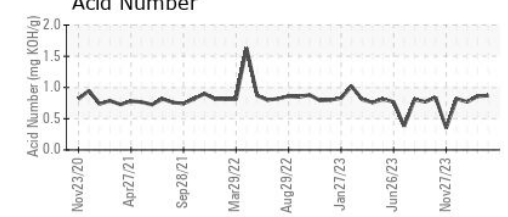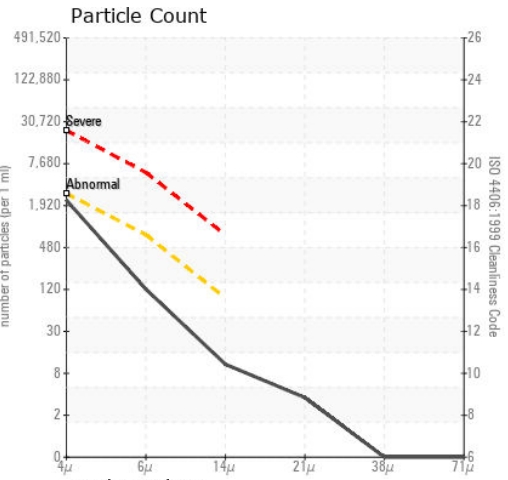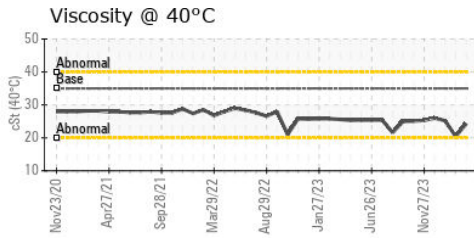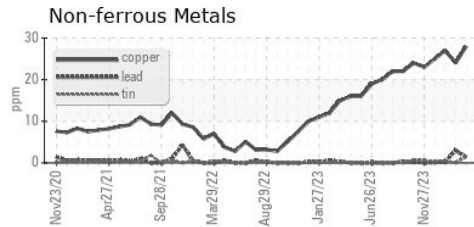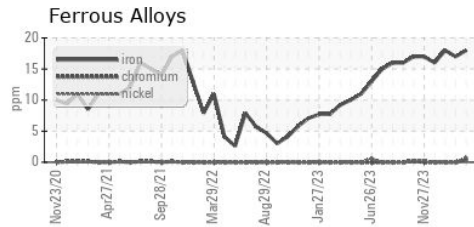

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0895012  
**Lab Number** : 06136314  
**Unique Number** : 10955779  
**Test Package** : IND 2  
**Received** : 02 Apr 2024  
**Tested** : 03 Apr 2024  
**Diagnosed** : 04 Apr 2024 - Don Baldrige

**J.M. Huber Corporation**  
 PO BOX 38  
 CRYSTAL HILL, VA  
 US 24539  
 Contact: Ted Hudson  
 ted.hudson@huber.com  
 T: (434)476-6628  
 F: (434)476-8133

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)