



# OIL ANALYSIS REPORT

Sample Rating Trend



ISO



Machine Id

## U1 FD FAN 1A

Component

### Outboard Blower

Fluid

### CHEVRON GST OIL ISO 68 (--- LTR)

#### DIAGNOSIS

##### ▲ Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

##### Wear

All component wear rates are normal.

##### ▲ Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil.

##### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

| SAMPLE INFORMATION |             | method      | limit/base | current            | history1 | history2 |
|--------------------|-------------|-------------|------------|--------------------|----------|----------|
| Sample Number      | Client Info |             |            | <b>WC0915200</b>   | ---      | ---      |
| Sample Date        | Client Info |             |            | <b>01 Apr 2024</b> | ---      | ---      |
| Machine Age        | hrs         | Client Info |            | <b>0</b>           | ---      | ---      |
| Oil Age            | hrs         | Client Info |            | <b>0</b>           | ---      | ---      |
| Oil Changed        | Client Info |             |            | <b>N/A</b>         | ---      | ---      |
| Sample Status      |             |             |            | <b>ABNORMAL</b>    | ---      | ---      |

| WEAR METALS |     | method      | limit/base | current      | history1 | history2 |
|-------------|-----|-------------|------------|--------------|----------|----------|
| PQ          |     | ASTM D8184  |            | <b>15</b>    | ---      | ---      |
| Iron        | ppm | ASTM D5185m | >20        | <b>1</b>     | ---      | ---      |
| Chromium    | ppm | ASTM D5185m | >20        | <b>&lt;1</b> | ---      | ---      |
| Nickel      | ppm | ASTM D5185m | >20        | <b>0</b>     | ---      | ---      |
| Titanium    | ppm | ASTM D5185m |            | <b>&lt;1</b> | ---      | ---      |
| Silver      | ppm | ASTM D5185m |            | <b>0</b>     | ---      | ---      |
| Aluminum    | ppm | ASTM D5185m | >20        | <b>3</b>     | ---      | ---      |
| Lead        | ppm | ASTM D5185m | >20        | <b>3</b>     | ---      | ---      |
| Copper      | ppm | ASTM D5185m | >20        | <b>1</b>     | ---      | ---      |
| Tin         | ppm | ASTM D5185m | >20        | <b>&lt;1</b> | ---      | ---      |
| Vanadium    | ppm | ASTM D5185m |            | <b>0</b>     | ---      | ---      |
| Cadmium     | ppm | ASTM D5185m |            | <b>0</b>     | ---      | ---      |

| ADDITIVES  |     | method      | limit/base | current      | history1 | history2 |
|------------|-----|-------------|------------|--------------|----------|----------|
| Boron      | ppm | ASTM D5185m |            | <b>0</b>     | ---      | ---      |
| Barium     | ppm | ASTM D5185m |            | <b>0</b>     | ---      | ---      |
| Molybdenum | ppm | ASTM D5185m |            | <b>0</b>     | ---      | ---      |
| Manganese  | ppm | ASTM D5185m |            | <b>0</b>     | ---      | ---      |
| Magnesium  | ppm | ASTM D5185m |            | <b>&lt;1</b> | ---      | ---      |
| Calcium    | ppm | ASTM D5185m |            | <b>3</b>     | ---      | ---      |
| Phosphorus | ppm | ASTM D5185m |            | <b>&lt;1</b> | ---      | ---      |
| Zinc       | ppm | ASTM D5185m |            | <b>0</b>     | ---      | ---      |
| Sulfur     | ppm | ASTM D5185m |            | <b>861</b>   | ---      | ---      |

| CONTAMINANTS |     | method      | limit/base | current      | history1 | history2 |
|--------------|-----|-------------|------------|--------------|----------|----------|
| Silicon      | ppm | ASTM D5185m | >15        | <b>10</b>    | ---      | ---      |
| Sodium       | ppm | ASTM D5185m |            | <b>0</b>     | ---      | ---      |
| Potassium    | ppm | ASTM D5185m | >20        | <b>2</b>     | ---      | ---      |
| Water        | %   | ASTM D6304  |            | <b>0.002</b> | ---      | ---      |
| ppm Water    | ppm | ASTM D6304  |            | <b>16</b>    | ---      | ---      |


| FLUID CLEANLINESS |  | method       | limit/base | current           | history1 | history2 |
|-------------------|--|--------------|------------|-------------------|----------|----------|
| Particles >4µm    |  | ASTM D7647   | >2500      | ▲ <b>6449</b>     | ---      | ---      |
| Particles >6µm    |  | ASTM D7647   | >640       | <b>415</b>        | ---      | ---      |
| Particles >14µm   |  | ASTM D7647   | >80        | <b>25</b>         | ---      | ---      |
| Particles >21µm   |  | ASTM D7647   | >20        | <b>5</b>          | ---      | ---      |
| Particles >38µm   |  | ASTM D7647   | >4         | <b>0</b>          | ---      | ---      |
| Particles >71µm   |  | ASTM D7647   | >3         | <b>0</b>          | ---      | ---      |
| Oil Cleanliness   |  | ISO 4406 (c) | >18/16/13  | ▲ <b>20/16/12</b> | ---      | ---      |

| FLUID DEGRADATION |          | method     | limit/base | current      | history1 | history2 |
|-------------------|----------|------------|------------|--------------|----------|----------|
| Acid Number (AN)  | mg KOH/g | ASTM D8045 |            | <b>0.075</b> | ---      | ---      |



# OIL ANALYSIS REPORT


### ▲ Particle Trend

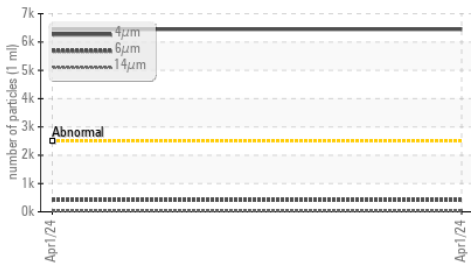

### Water (KF)




### PQ

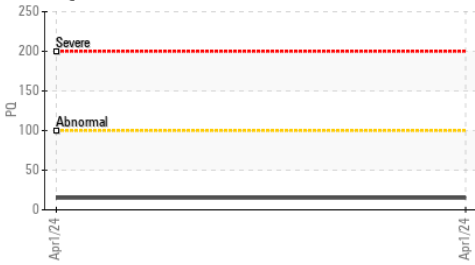

### Water (KF)



### Viscosity @ 40°C

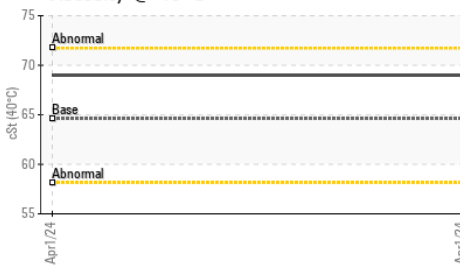






| VISUAL           | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| White Metal      | scalar | *Visual    | NONE    | NONE     | ---      |
| Yellow Metal     | scalar | *Visual    | NONE    | NONE     | ---      |
| Precipitate      | scalar | *Visual    | NONE    | NONE     | ---      |
| Silt             | scalar | *Visual    | NONE    | NONE     | ---      |
| Debris           | scalar | *Visual    | NONE    | NONE     | ---      |
| Sand/Dirt        | scalar | *Visual    | NONE    | NONE     | ---      |
| Appearance       | scalar | *Visual    | NORML   | NORML    | ---      |
| Odor             | scalar | *Visual    | NORML   | NORML    | ---      |
| Emulsified Water | scalar | *Visual    | NEG     | ---      | ---      |
| Free Water       | scalar | *Visual    | NEG     | ---      | ---      |

| FLUID PROPERTIES | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| Visc @ 40°C      | cSt    | ASTM D445  | 64.6    | 69.0     | ---      |

| SAMPLE IMAGES | method | limit/base | current | history1 | history2 |
|---------------|--------|------------|---------|----------|----------|
|---------------|--------|------------|---------|----------|----------|

|        |  |  |  |          |          |
|--------|--|--|--|----------|----------|
| Color  |  |  |  | no image | no image |
| Bottom |  |  |  | no image | no image |

### GRAPHS

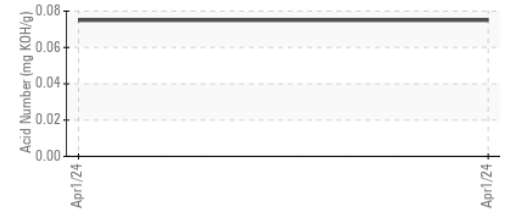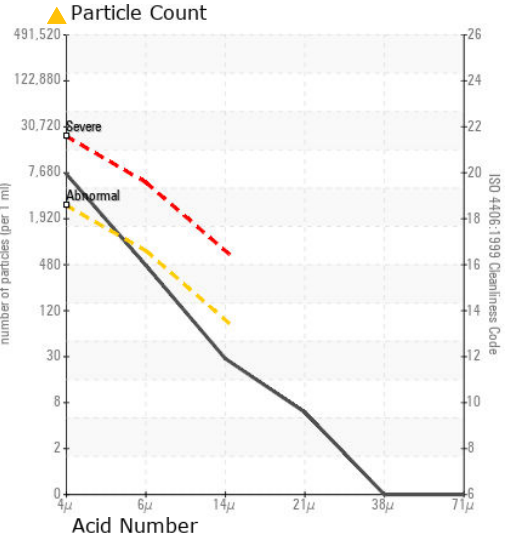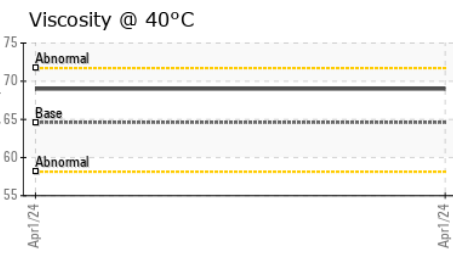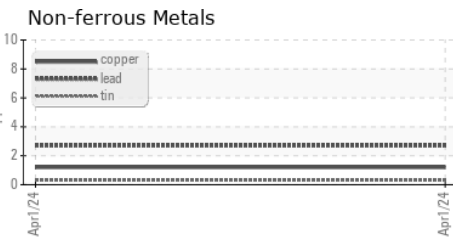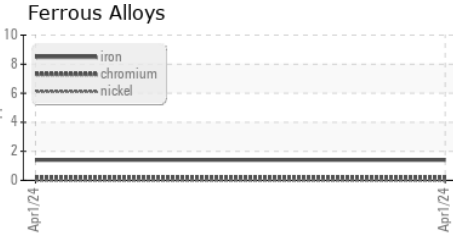

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0915200      **Received** : 02 Apr 2024  
**Lab Number** : **06136356**      **Tested** : 03 Apr 2024  
**Unique Number** : 10955821      **Diagnosed** : 04 Apr 2024 - Don Baldrige  
**Test Package** : PLANT

**SALT RIVER PROJECT**  
 7302 W NORTHERN AVE  
 GLENDALE, AZ  
 US 85303  
 Contact: NEAL HANCOCK  
 neal.hancockjr@srpnet.com  
 T: (602)236-3238  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)