



# OIL ANALYSIS REPORT

Sample Rating Trend



ISO



Machine Id

## U1 FD FAN MOTOR 1B

Component

### Outboard Blower

Fluid

### CHEVRON GST OIL ISO 68 (--- LTR)

#### DIAGNOSIS

##### Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

##### Wear

All component wear rates are normal.

##### Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

##### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WC0915206</b>	---	---
Sample Date	Client Info			<b>01 Apr 2024</b>	---	---
Machine Age	hrs	Client Info		<b>0</b>	---	---
Oil Age	hrs	Client Info		<b>0</b>	---	---
Oil Changed	Client Info			<b>N/A</b>	---	---
Sample Status				<b>ATTENTION</b>	---	---

WEAR METALS		method	limit/base	current	history1	history2
PQ		ASTM D8184		<b>15</b>	---	---
Iron	ppm	ASTM D5185m	>20	<b>&lt;1</b>	---	---
Chromium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	---	---
Nickel	ppm	ASTM D5185m	>20	<b>0</b>	---	---
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Silver	ppm	ASTM D5185m		<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m	>20	<b>3</b>	---	---
Lead	ppm	ASTM D5185m	>20	<b>14</b>	---	---
Copper	ppm	ASTM D5185m	>20	<b>2</b>	---	---
Tin	ppm	ASTM D5185m	>20	<b>&lt;1</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	---	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	---	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	---	---
Barium	ppm	ASTM D5185m		<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185m		<b>0</b>	---	---
Manganese	ppm	ASTM D5185m		<b>0</b>	---	---
Magnesium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Calcium	ppm	ASTM D5185m		<b>3</b>	---	---
Phosphorus	ppm	ASTM D5185m		<b>2</b>	---	---
Zinc	ppm	ASTM D5185m		<b>0</b>	---	---
Sulfur	ppm	ASTM D5185m		<b>819</b>	---	---





CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<b>&lt;1</b>	---	---
Sodium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Potassium	ppm	ASTM D5185m	>20	<b>3</b>	---	---
Water	%	ASTM D6304		<b>0.002</b>	---	---
ppm Water	ppm	ASTM D6304		<b>18</b>	---	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>2500	<b>3448</b>	---	---
Particles >6µm		ASTM D7647	>640	<b>203</b>	---	---
Particles >14µm		ASTM D7647	>80	<b>14</b>	---	---
Particles >21µm		ASTM D7647	>20	<b>2</b>	---	---
Particles >38µm		ASTM D7647	>4	<b>0</b>	---	---
Particles >71µm		ASTM D7647	>3	<b>0</b>	---	---
Oil Cleanliness		ISO 4406 (c)	>18/16/13	<b>19/15/11</b>	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.085</b>	---	---



# OIL ANALYSIS REPORT

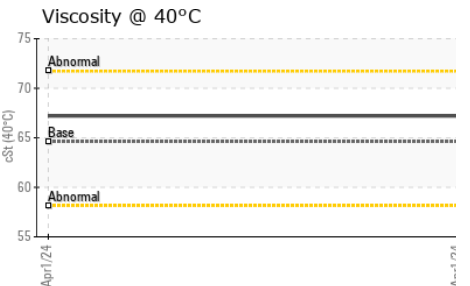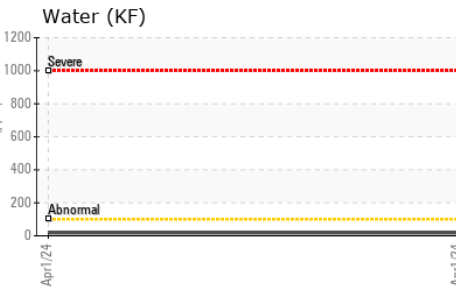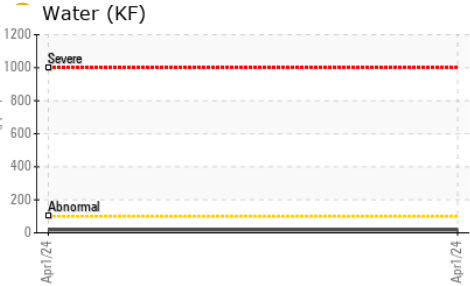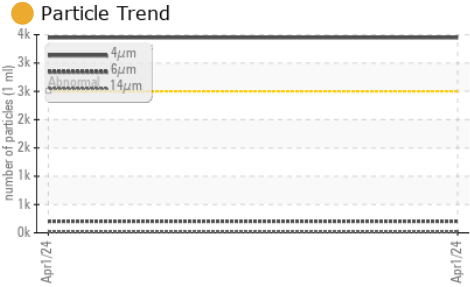





VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---
Precipitate	scalar	*Visual	NONE	NONE	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	NONE	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	NEG	---	---	
Free Water	scalar	*Visual	NEG	---	---	

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	64.6	67.2	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color				no image	no image
Bottom				no image	no image

### GRAPHS

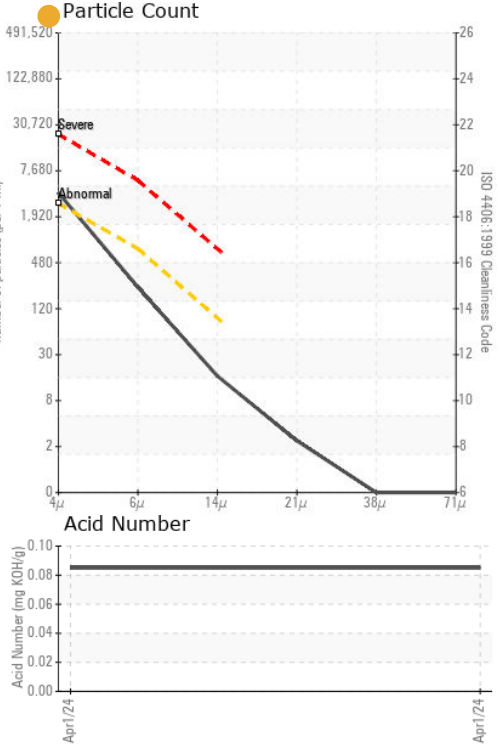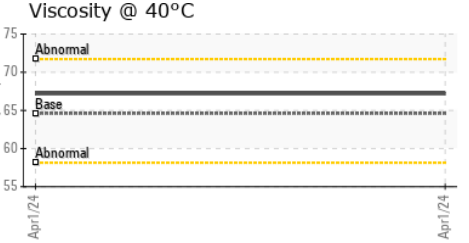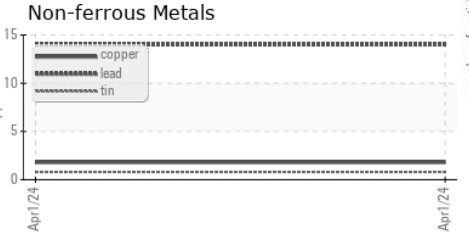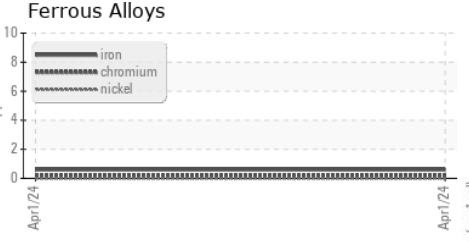

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0915206      **Received** : 02 Apr 2024  
**Lab Number** : 06136359      **Tested** : 03 Apr 2024  
**Unique Number** : 10955824      **Diagnosed** : 04 Apr 2024 - Don Baldrige  
**Test Package** : PLANT

**SALT RIVER PROJECT**  
 7302 W NORTHERN AVE  
 GLENDALE, AZ  
 US 85303  
 Contact: NEAL HANCOCK  
 neal.hancockjr@srpnet.com  
 T: (602)236-3238  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)