




# OIL ANALYSIS REPORT

Sample Rating Trend

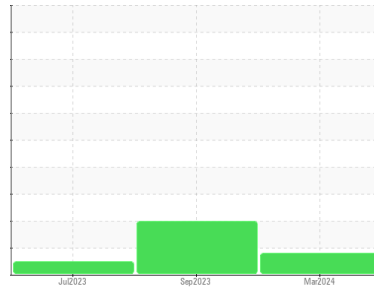

Machine Id  
**KAESER ESD 300 8488022 (S/N 1136)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

## DIAGNOSIS

**Recommendation**  
 No corrective action is recommended at this time. Resample at the next service interval to monitor.

**Wear**  
 All component wear rates are normal.

**Contamination**  
 There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

**Fluid Condition**  
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>KC06136388</b>	KC124460	KC109122
Sample Date	Client Info		<b>15 Mar 2024</b>	21 Sep 2023	27 Jul 2023
Machine Age	hrs	Client Info	<b>17355</b>	8853	7544
Oil Age	hrs	Client Info	<b>0</b>	0	5400
Oil Changed	Client Info		<b>N/A</b>	N/A	Changed
Sample Status			<b>ATTENTION</b>	ABNORMAL	NORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m >10	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m >3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m >3	<b>&lt;1</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >10	<b>3</b>	0	<1
Lead	ppm	ASTM D5185m >10	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >50	<b>5</b>	6	12
Tin	ppm	ASTM D5185m >10	<b>&lt;1</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 90	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	0	<1
Magnesium	ppm	ASTM D5185m 90	<b>1</b>	17	0
Calcium	ppm	ASTM D5185m 2	<b>3</b>	0	0
Phosphorus	ppm	ASTM D5185m	<b>2</b>	3	<1
Zinc	ppm	ASTM D5185m	<b>&lt;1</b>	12	0

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>&lt;1</b>	<1	0
Sodium	ppm	ASTM D5185m	<b>0</b>	13	0
Potassium	ppm	ASTM D5185m >20	<b>2</b>	6	0
Water	%	ASTM D6304 >0.05	<b>0.005</b>	0.015	0.007
ppm Water	ppm	ASTM D6304 >500	<b>60</b>	154.5	79.4






## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>5455</b>	6634	273
Particles >6µm	ASTM D7647 >1300		<b>2300</b>	3031	96
Particles >14µm	ASTM D7647 >80		<b>46</b>	591	23
Particles >21µm	ASTM D7647 >20		<b>10</b>	202	9
Particles >38µm	ASTM D7647 >4		<b>0</b>	8	1
Particles >71µm	ASTM D7647 >3		<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c) >--/17/13		<b>20/18/13</b>	20/19/16	15/14/12

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	<b>0.41</b>	0.33	0.37


# OIL ANALYSIS REPORT

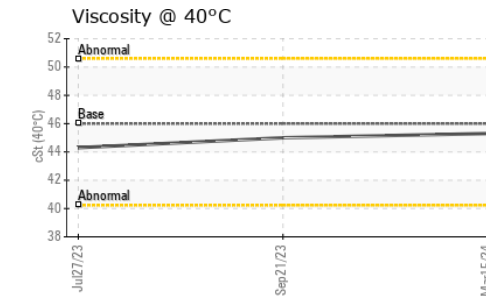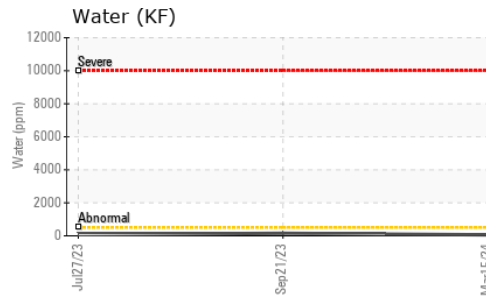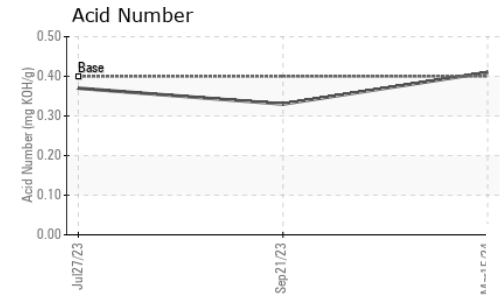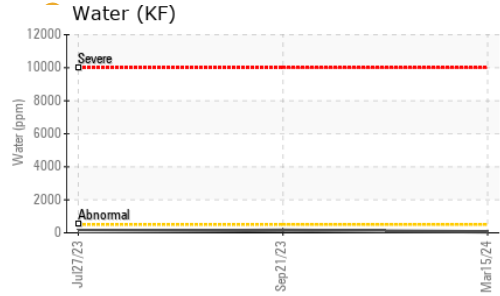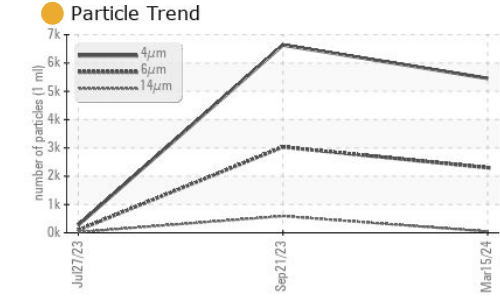





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	45.3	45.0	44.3

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

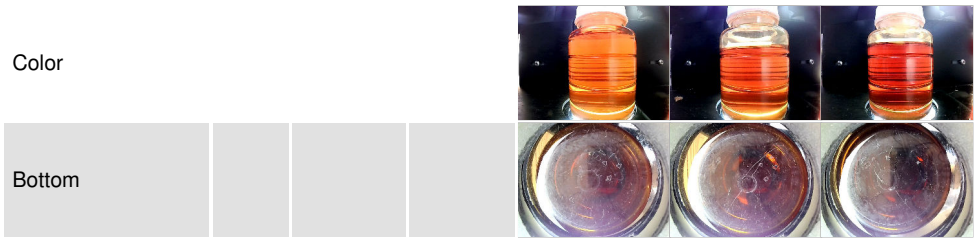

## GRAPHS

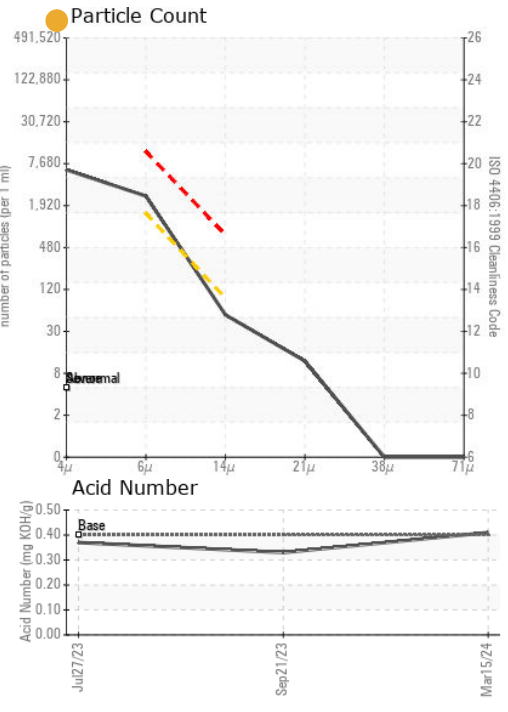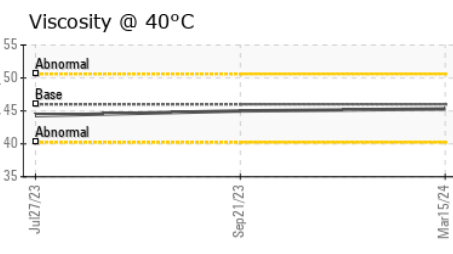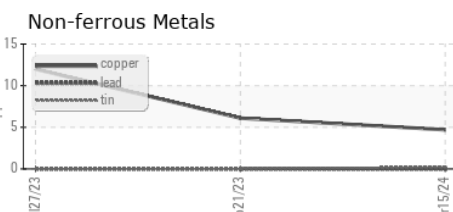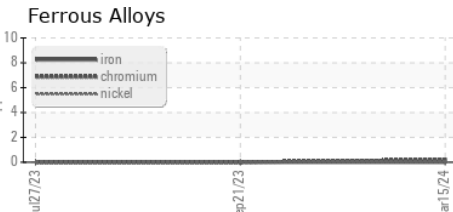

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KC06136388  
**Lab Number** : 06136388  
**Unique Number** : 10955853  
**Test Package** : IND 2  
**Received** : 02 Apr 2024  
**Tested** : 03 Apr 2024  
**Diagnosed** : 04 Apr 2024 - Don Baldrige

**HYDRO PRECISION TUBING USA, LL**  
 100 GUS HIPP BLVD  
 ROCKLEDGE, FL  
 US 32955  
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)