




# OIL ANALYSIS REPORT

Sample Rating Trend

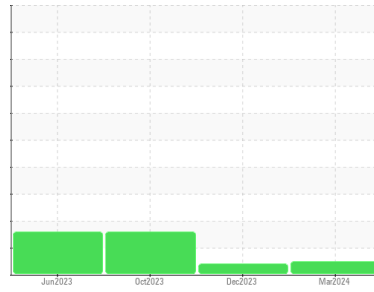

Machine Id  
**KAESER SK 15T 8687556 (S/N 1513)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) S-460 (--- QTS)**

## DIAGNOSIS

**Recommendation**  
 Resample at the next service interval to monitor.

**Wear**  
 All component wear rates are normal.

**Contamination**  
 The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

**Fluid Condition**  
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KC125378</b>	KC121977	KC107041
Sample Date	Client Info			<b>13 Mar 2024</b>	28 Dec 2023	10 Oct 2023
Machine Age	hrs	Client Info		<b>4651</b>	4090	3454
Oil Age	hrs	Client Info		<b>0</b>	0	3454
Oil Changed	Client Info			<b>N/A</b>	N/A	Changed
Sample Status				<b>NORMAL</b>	ABNORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>&lt;1</b>	<1	0
Chromium	ppm	ASTM D5185m	>10	<b>&lt;1</b>	<1	0
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	<1
Titanium	ppm	ASTM D5185m	>3	<b>&lt;1</b>	<1	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>10	<b>3</b>	2	<1
Lead	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>6</b>	4	10
Tin	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	<1
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m	90	<b>6</b>	15	0
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>0</b>	0	<1
Magnesium	ppm	ASTM D5185m	90	<b>44</b>	72	20
Calcium	ppm	ASTM D5185m	2	<b>4</b>	<1	1
Phosphorus	ppm	ASTM D5185m		<b>&lt;1</b>	21	<1
Zinc	ppm	ASTM D5185m		<b>11</b>	0	23

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>&lt;1</b>	0	2
Sodium	ppm	ASTM D5185m		<b>14</b>	15	2
Potassium	ppm	ASTM D5185m	>20	<b>7</b>	10	6
Water	%	ASTM D6304	>0.05	<b>0.021</b>	0.028	0.013
ppm Water	ppm	ASTM D6304	>500	<b>218</b>	286	138.7

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>464</b>	1528	25166
Particles >6µm		ASTM D7647	>1300	<b>137</b>	408	▲ 12500
Particles >14µm		ASTM D7647	>80	<b>16</b>	28	▲ 481
Particles >21µm		ASTM D7647	>20	<b>3</b>	9	▲ 56
Particles >38µm		ASTM D7647	>4	<b>0</b>	0	2
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	<b>16/14/11</b>	18/16/12	▲ 22/21/16

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	<b>0.34</b>	0.32	0.31


# OIL ANALYSIS REPORT

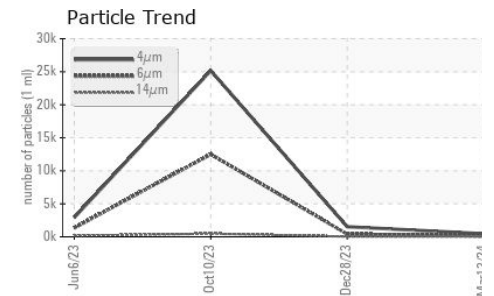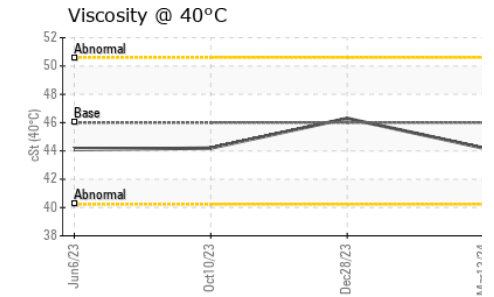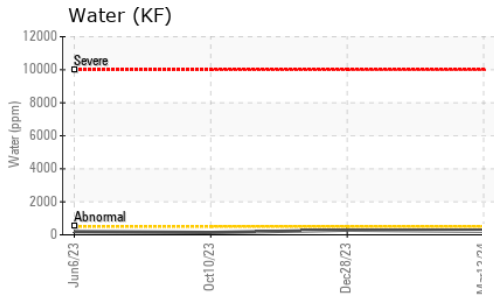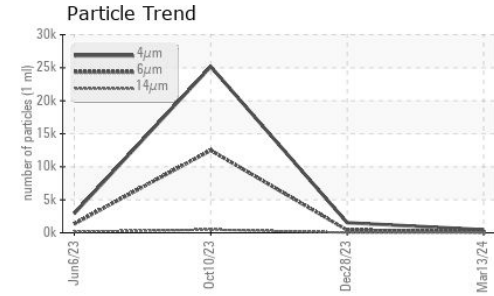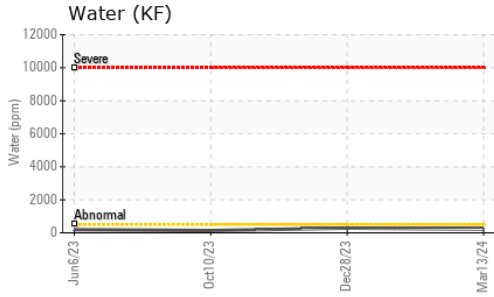






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	▲ HEAVY
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	44.2	46.3	44.2

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

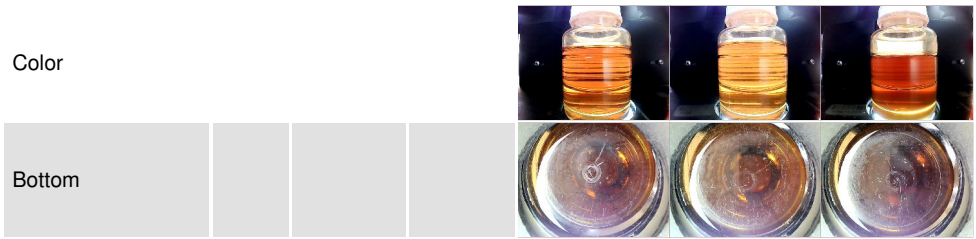

## GRAPHS

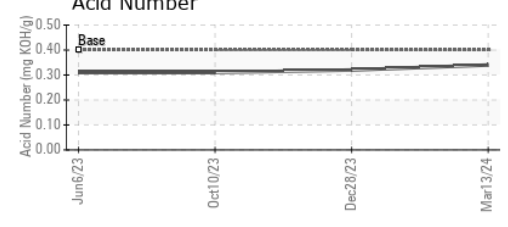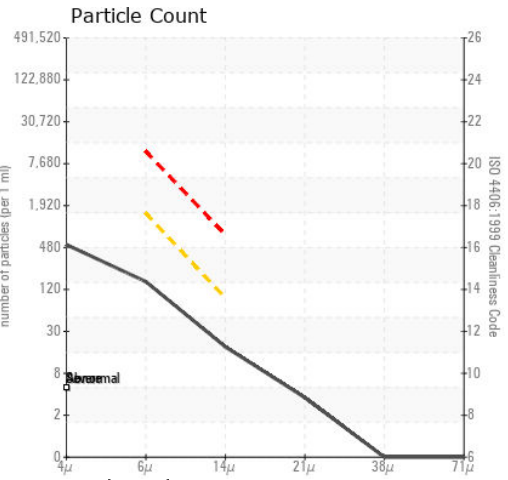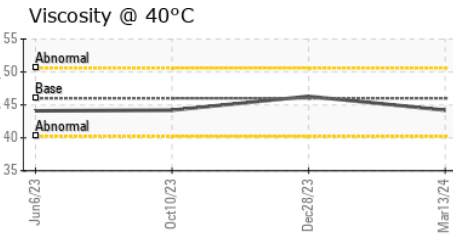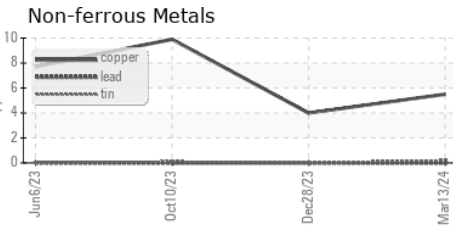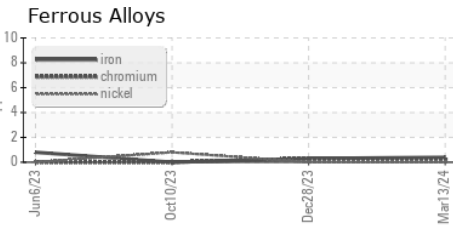

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KC125378  
**Lab Number** : 06136392  
**Unique Number** : 10955857  
**Test Package** : IND 2  
**Received** : 02 Apr 2024  
**Tested** : 03 Apr 2024  
**Diagnosed** : 04 Apr 2024 - Don Baldrige

**SAWSTREET**  
 6450 KINGSPORTE PKWY  
 ORLANDO, FL  
 US 32819  
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)