

# **OIL ANALYSIS REPORT**

Sample Rating Trend



Machine Id

# KAESER SK15T 8429799 (S/N 1457)

Component Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Mar2023	Mar2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC110214	KC104101	
Sample Date		Client Info		20 Mar 2024	01 Mar 2023	
Machine Age	hrs	Client Info		662	396	
Oil Age	hrs	Client Info		300	396	
Oil Changed		Client Info		Changed	Changed	
Sample Status				NORMAL	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	0	
Chromium	ppm	ASTM D5185m	>10	<1	<1	
Nickel	ppm	ASTM D5185m	>3	0	<1	
Titanium	ppm	ASTM D5185m	>3	<1	<1	
Silver	ppm	ASTM D5185m	>2	0	<1	
Aluminum	ppm	ASTM D5185m	>10	3	0	
Lead	ppm	ASTM D5185m	>10	0	0	
Copper	ppm	ASTM D5185m	>50	2	4	
Tin	ppm	ASTM D5185m	>10	<1	0	
Vanadium	ppm	ASTM D5185m		0	<1	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m	90	0	0	
Molybdenum	ppm	ASTM D5185m		0	0	
Manganese	ppm	ASTM D5185m		0	1	
Magnesium	ppm	ASTM D5185m	90	44	49	
Calcium	ppm	ASTM D5185m	2	4	<1	
Phosphorus	ppm	ASTM D5185m		2	2	
Zinc	ppm	ASTM D5185m		5	0	
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	
Sodium	ppm	ASTM D5185m		13	9	
Potassium	ppm	ASTM D5185m	>20	9	12	
Water	%	ASTM D6304	>0.05	0.025	0.017	
ppm Water	ppm	ASTM D6304	>500	251	171.3	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		1912	5130	
Particles >6µm		ASTM D7647	>1300	467	<b>△</b> 2990	
Particles >14µm		ASTM D7647	>80	24	<b>△</b> 622	
Particles >21µm		ASTM D7647	>20	4	<u>^</u> 211	
Particles >38µm		ASTM D7647	>4	0	6	
Particles >71μm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	18/16/12	<u>△</u> 20/19/16	
FLUID DEGRADA	TIO <u>N</u>	method	limit/base	current	history1	history2
A sial Niveshau (ANI)		4.OTM D00.45	0.4	0.00	0.00	<u> </u>

Acid Number (AN)


mg KOH/g ASTM D8045 0.4

0.30

0.32



## **OIL ANALYSIS REPORT**

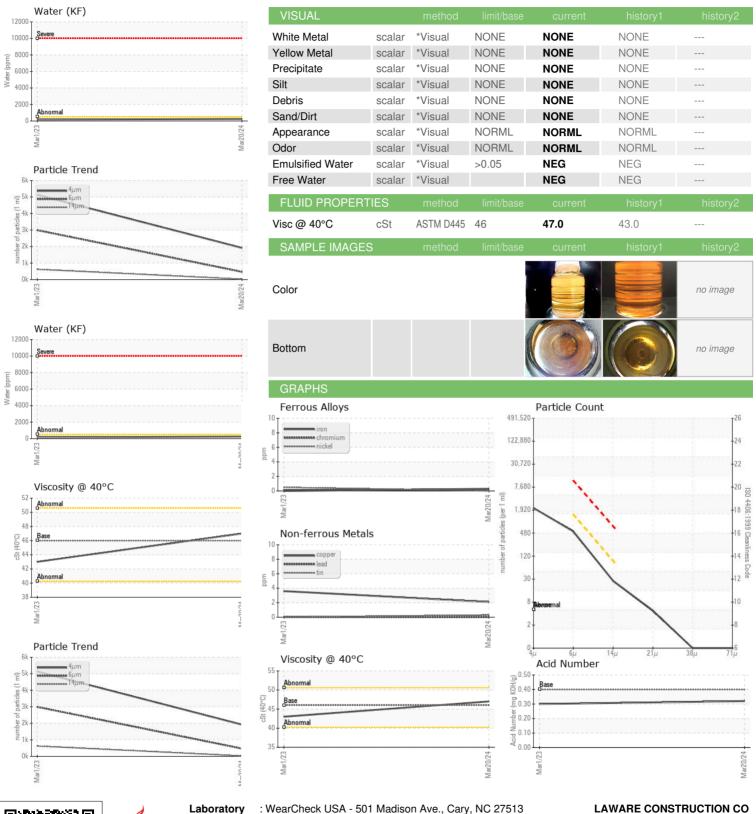





Certificate 12367

Laboratory Sample No. : KC110214 Lab Number : 06136393 Unique Number : 10955858

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 02 Apr 2024 **Tested** : 03 Apr 2024 Diagnosed : 04 Apr 2024 - Don Baldridge

Test Package : IND 2 To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F:

997 COMMERLE ST

Contact: Service Manager

LEESBURG, FL

US 34748