




OIL ANALYSIS REPORT

Sample Rating Trend

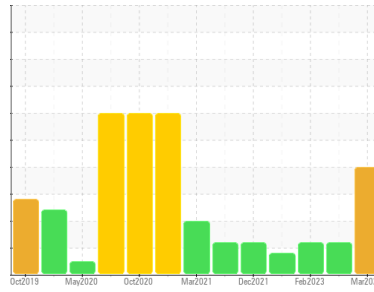

WATER



Machine Id
KAESER CSD 75 6592344 (S/N 1515)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

The filter change at the time of sampling has been noted. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.

Wear

The tin level is abnormal. All other component wear rates are normal.

Contamination

There is a moderate amount of particulates present in the oil. There is a light concentration of water present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KCPA016134	KC124522	KCP55134
Sample Date	Client Info			25 Mar 2024	12 Sep 2023	14 Feb 2023
Machine Age	hrs	Client Info		33486	29400	25000
Oil Age	hrs	Client Info		1085	0	4500
Oil Changed	Client Info			Not Chngd	N/A	Not Chngd
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	0
Chromium	ppm	ASTM D5185m	>10	<1	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	<1	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	3	1	3
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	14	5	17
Tin	ppm	ASTM D5185m	>10	▲ 62	▲ 68	▲ 33
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	0	0	<1
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m	90	<1	1	<1
Calcium	ppm	ASTM D5185m	2	3	0	0
Phosphorus	ppm	ASTM D5185m		<1	0	0
Zinc	ppm	ASTM D5185m		0	0	3
Sulfur	ppm	ASTM D5185m		16268	8760	15621

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	0
Sodium	ppm	ASTM D5185m		0	0	<1
Potassium	ppm	ASTM D5185m	>20	2	<1	0
Water	%	ASTM D6304	>0.05	▲ 0.203	0.006	0.00
ppm Water	ppm	ASTM D6304	>500	▲ 2030	62.0	0.00

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		1549	---	---
Particles >6µm		ASTM D7647	>1300	844	---	---
Particles >14µm		ASTM D7647	>80	● 144	---	---
Particles >21µm		ASTM D7647	>20	● 48	---	---
Particles >38µm		ASTM D7647	>4	● 7	---	---
Particles >71µm		ASTM D7647	>3	● 1	---	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	● 18/17/14	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.45	0.42	0.41

OIL ANALYSIS REPORT

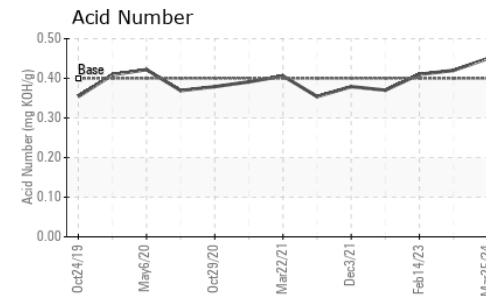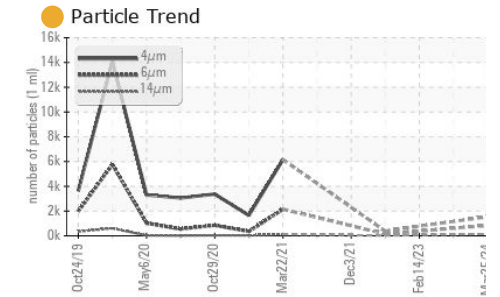
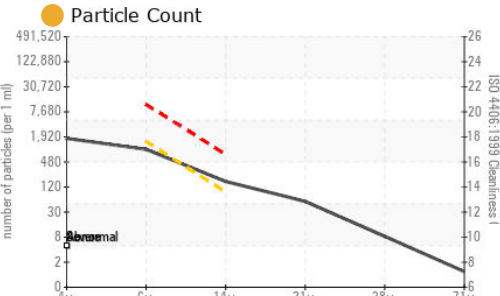
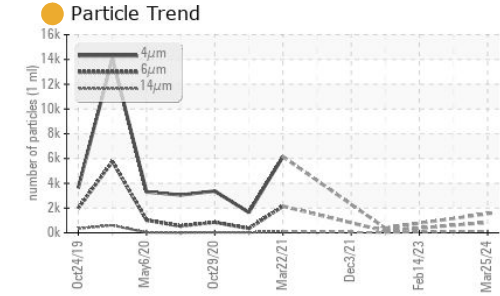
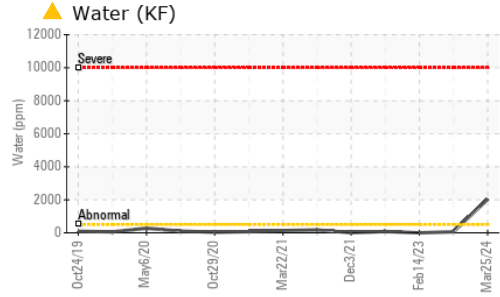


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	▲ MODER
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	0.2%	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	44.9	44.5

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

GRAPHS

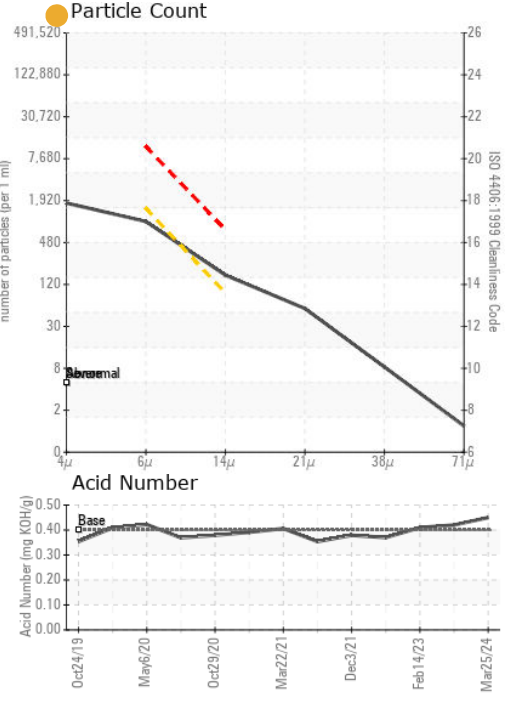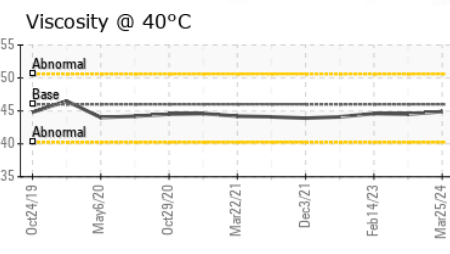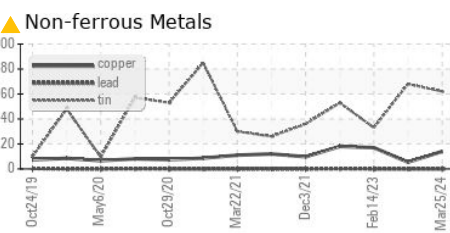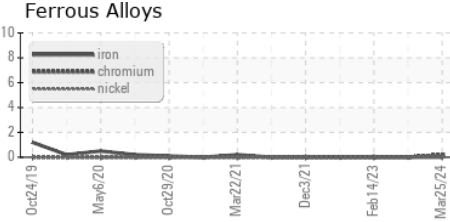

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA016134 **Received** : 02 Apr 2024
Lab Number : 06136402 **Tested** : 09 Apr 2024
Unique Number : 10955867 **Diagnosed** : 09 Apr 2024 - Jonathan Hester
Test Package : IND 2 (Additional Tests: KF, PrtCount)

CRESLINE PLASTIC PIPE
 3801 E HWY 31
 CORSICANA, TX
 US 75109
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)