




# OIL ANALYSIS REPORT

Sample Rating Trend

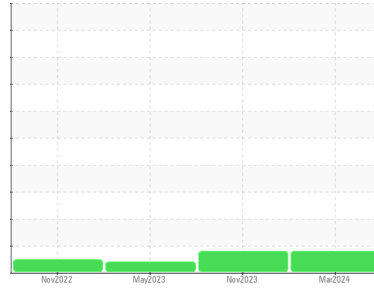

ISO



Machine Id

**KAESER 8229784**

Component

**Compressor**

Fluid

**KAESER SIGMA (OEM) M-460 (--- QTS)**

## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KCPA015971</b>	KCPA006970	KCP52907
Sample Date	Client Info			<b>25 Mar 2024</b>	09 Nov 2023	09 May 2023
Machine Age	hrs	Client Info		<b>9495</b>	8225	6813
Oil Age	hrs	Client Info		<b>1270</b>	0	1277
Oil Changed		Client Info		<b>Not Chngd</b>	N/A	Not Chngd
Sample Status				<b>ATTENTION</b>	ATTENTION	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	>3	<b>&lt;1</b>	0	<1
Silver	ppm	ASTM D5185m	>2	<b>&lt;1</b>	0	<1
Aluminum	ppm	ASTM D5185m	>10	<b>3</b>	<1	2
Lead	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>17</b>	24	13
Tin	ppm	ASTM D5185m	>10	<b>2</b>	0	<1
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	90	<b>0</b>	6	0
Molybdenum	ppm	ASTM D5185m	0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>0</b>	0	<1
Magnesium	ppm	ASTM D5185m	100	<b>1</b>	<1	19
Calcium	ppm	ASTM D5185m	0	<b>3</b>	0	0
Phosphorus	ppm	ASTM D5185m	0	<b>&lt;1</b>	17	0
Zinc	ppm	ASTM D5185m	0	<b>0</b>	0	7
Sulfur	ppm	ASTM D5185m	23500	<b>23337</b>	20178	20704

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>&lt;1</b>	0	2
Sodium	ppm	ASTM D5185m		<b>0</b>	0	6
Potassium	ppm	ASTM D5185m	>20	<b>2</b>	<1	<1
Water	%	ASTM D6304	>0.05	<b>0.007</b>	0.012	0.016
ppm Water	ppm	ASTM D6304	>500	<b>77</b>	123.2	165.8

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>6284</b>	4664	---
Particles >6µm		ASTM D7647	>1300	<b>1628</b>	1809	---
Particles >14µm		ASTM D7647	>80	<b>33</b>	42	---
Particles >21µm		ASTM D7647	>20	<b>6</b>	6	---
Particles >38µm		ASTM D7647	>4	<b>1</b>	0	---
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	<b>20/18/12</b>	19/18/13	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	<b>0.46</b>	0.42	0.39


# OIL ANALYSIS REPORT

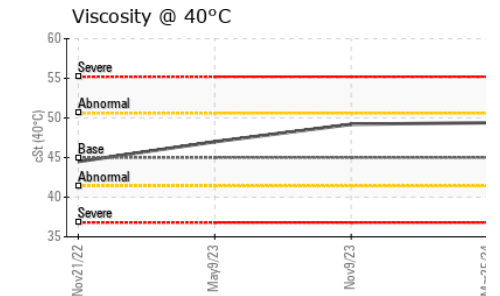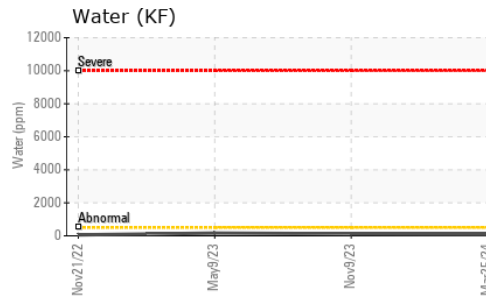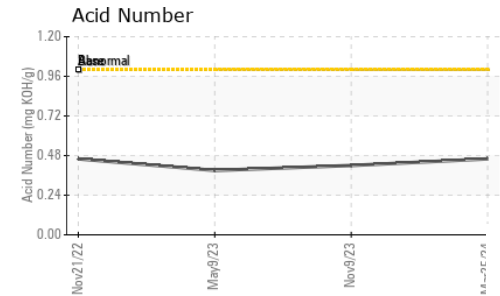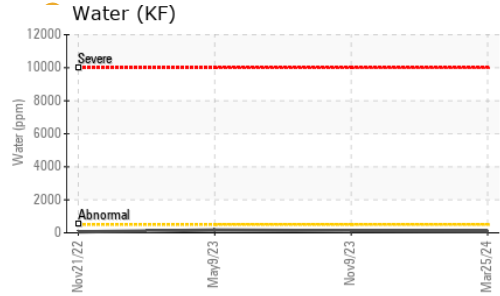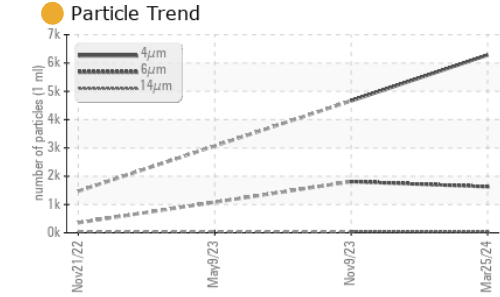





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	LIGHT
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	49.4	49.2

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

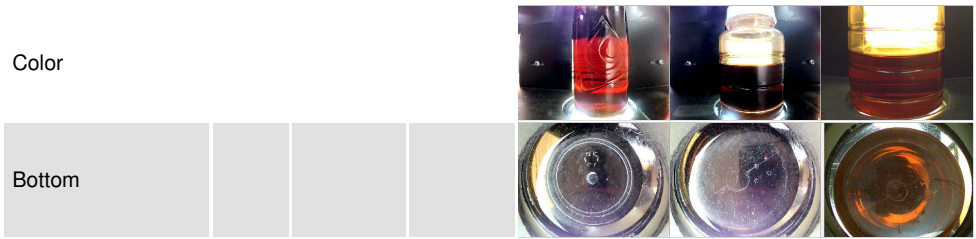

## GRAPHS

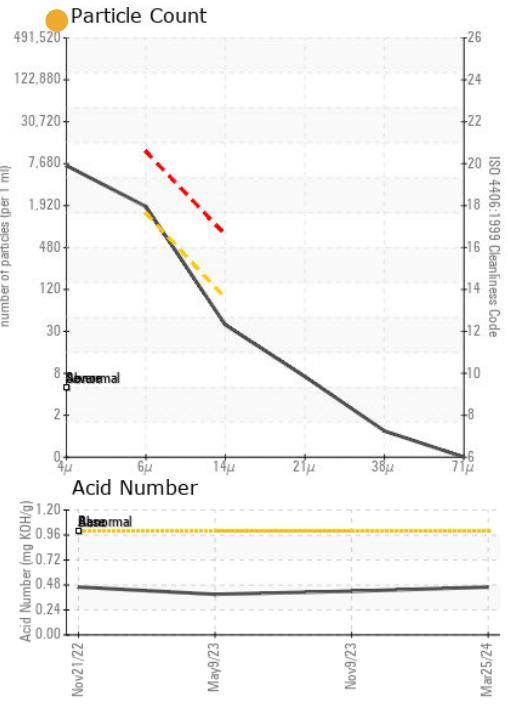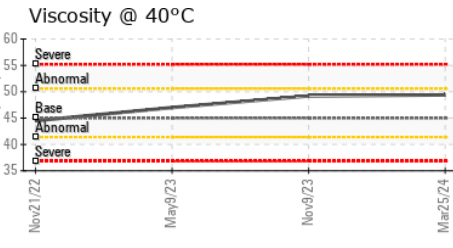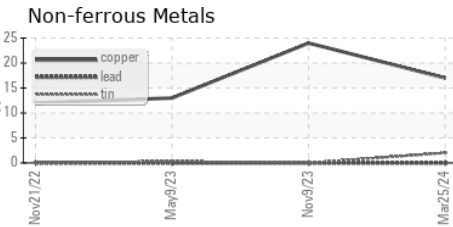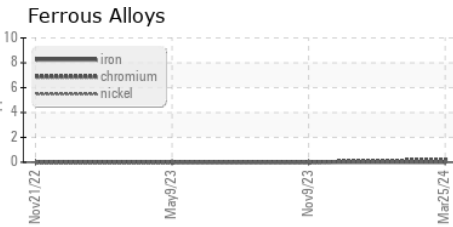

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA015971 **Received** : 02 Apr 2024  
**Lab Number** : 06136403 **Tested** : 03 Apr 2024  
**Unique Number** : 10955868 **Diagnosed** : 04 Apr 2024 - Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**AAON COIL**  
 203 GUM SPRINGS RD  
 LONGVIEW, TX  
 US 75602  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)