




# OIL ANALYSIS REPORT

Sample Rating Trend

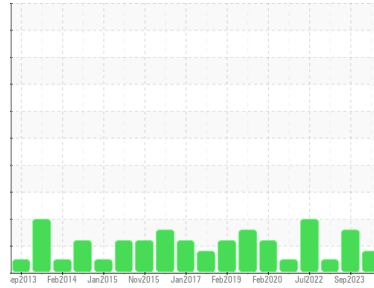

ISO



Machine Id  
**KAESER SFC 75S 4620239 (S/N 1020)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KC129315</b>	KC05964631	KC108419
Sample Date	Client Info			<b>27 Mar 2024</b>	19 Sep 2023	01 Mar 2023
Machine Age	hrs	Client Info		<b>62526</b>	60287	57442
Oil Age	hrs	Client Info		<b>2500</b>	0	3200
Oil Changed	Client Info			<b>Not Chngd</b>	N/A	Not Chngd
Sample Status				<b>ATTENTION</b>	ATTENTION	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	0	<1
Chromium	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	<1
Titanium	ppm	ASTM D5185m	>3	<b>&lt;1</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>10	<b>3</b>	0	<1
Lead	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>2</b>	5	3
Tin	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m	90	<b>36</b>	<1	9
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m	90	<b>58</b>	17	49
Calcium	ppm	ASTM D5185m	2	<b>5</b>	2	<1
Phosphorus	ppm	ASTM D5185m		<b>&lt;1</b>	2	0
Zinc	ppm	ASTM D5185m		<b>8</b>	18	13

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>&lt;1</b>	0	0
Sodium	ppm	ASTM D5185m		<b>23</b>	5	19
Potassium	ppm	ASTM D5185m	>20	<b>6</b>	0	4
Water	%	ASTM D6304	>0.05	<b>0.047</b>	0.003	0.017
ppm Water	ppm	ASTM D6304	>500	<b>474</b>	39.3	172.7

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>9820</b>	5251	2975
Particles >6µm		ASTM D7647	>1300	<b>1704</b>	1392	749
Particles >14µm		ASTM D7647	>80	<b>66</b>	80	31
Particles >21µm		ASTM D7647	>20	<b>18</b>	21	6
Particles >38µm		ASTM D7647	>4	<b>1</b>	1	1
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	<b>20/18/13</b>	20/18/13	19/17/12

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	<b>0.42</b>	0.38	0.37

# OIL ANALYSIS REPORT

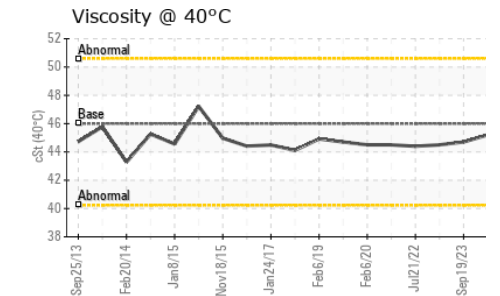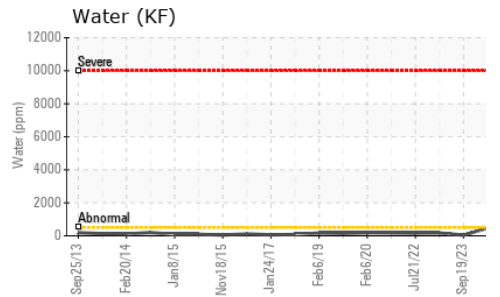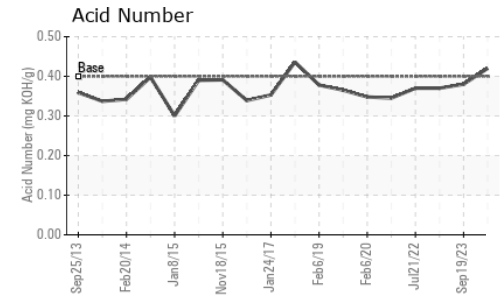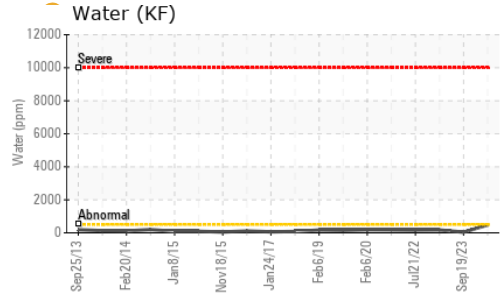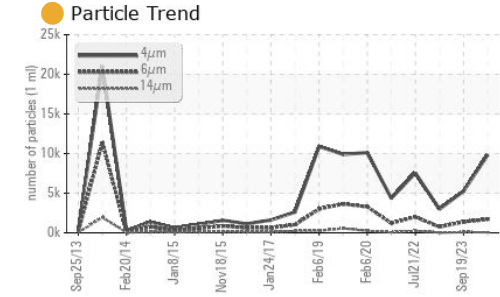

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	45.2	44.7	44.5

**SAMPLE IMAGES**

method	limit/base	current	history1	history2
Color				
Bottom				

**GRAPHS**

**Ferrous Alloys**

**Non-ferrous Metals**

**Particle Count**

ISO 4406:1999 Cleanliness Code

**Viscosity @ 40°C**

**Acid Number**



**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KC129315  
**Lab Number** : 06136420  
**Unique Number** : 10955885  
**Test Package** : IND 2

**Received** : 02 Apr 2024  
**Tested** : 03 Apr 2024  
**Diagnosed** : 04 Apr 2024 - Don Baldrige

**TRIB TOTAL MEDIA**  
 202 FALCON LN  
 TARENTUM, PA  
 US 15084  
 Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)