


OIL ANALYSIS REPORT

DEER CREEK [C-7 MSB SOUTH] NH3 - RECYCLED (S/N REC DISTILLER 87DA)

Refrigeration Compressor

USPI ALT-68 SC (--- GAL)

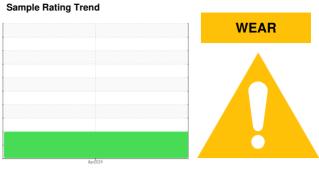

DIAGNOSIS

Recommendation

This is a baseline read-out on the submitted sample. C-7 MSB SOUTH

The iron level is abnormal.

Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USP0008157		
Sample Date		Client Info		01 Apr 2024		
Machine Age	hrs	Client Info		0		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	45		
Chromium	ppm	ASTM D5185m	>2	<1		
Nickel	ppm	ASTM D5185m		0		
Titanium	ppm	ASTM D5185m		<1		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>3	0		
Lead	ppm	ASTM D5185m	>2	0		
Copper	ppm	ASTM D5185m	>8	<1		
Tin	ppm	ASTM D5185m	>4	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m		<1		
Calcium	ppm	ASTM D5185m		0		
Phosphorus	ppm	ASTM D5185m		0		
Zinc	ppm	ASTM D5185m		0		
Sulfur	ppm	ASTM D5185m	50	171		
CONTAMINANTS	3	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	2		
Sodium	ppm	ASTM D5185m		0		
Potassium	ppm	ASTM D5185m	>20	2		
Water	%	ASTM D6304	>0.01	0.004		
ppm Water	ppm	ASTM D6304	>100	46		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	<u> </u>		
Particles >6µm		ASTM D7647	>2500	<u> </u>		
Particles >14μm		ASTM D7647	>320	42		
Particles >21µm		ASTM D7647	>80	4		
Particles >38µm		ASTM D7647	>20	0		
Particles >71µm		ASTM D7647	>4	0		
Oil Cleanliness		ISO 4406 (c)	>20/18/15	23/20/13		
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	0.005	0.027		



OIL ANALYSIS REPORT

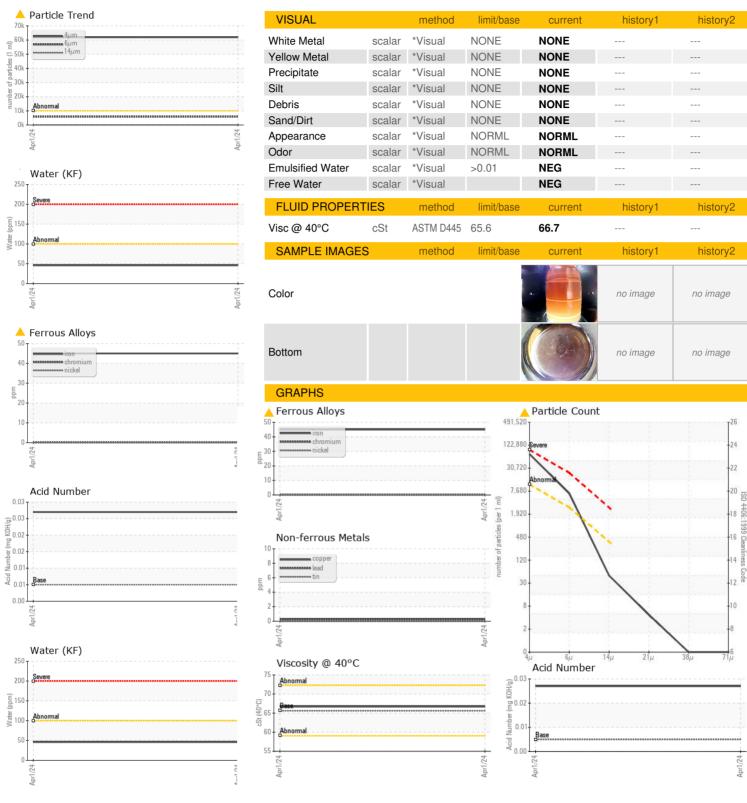





Certificate 12367

Laboratory

Sample No. Lab Number : 06136445

: USP0008157

Unique Number : 10955910 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 02 Apr 2024

Tested : 04 Apr 2024 Diagnosed

: 04 Apr 2024 - Doug Bogart

RESERS FINE FOODS INC - DEER 3215 SE 6TH ST TOPEKA, KS

US 66607

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact/Location: Service Manager - RESTOPDEE

T:

F: