

# **OIL ANALYSIS REPORT**

Sample Rating Trend

WATER

Machine Id

# GEA RC-2 (S/N 02244012)

Refrigeration Compressor

Fluid

**DH-POE-HMC-68 (--- GAL)** 

## DIAGNOSIS

## Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

## Contamination

There is a light concentration of water present in the oil

## **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

|               |        |             | Aug2023    | Mar2024        |             |          |
|---------------|--------|-------------|------------|----------------|-------------|----------|
| SAMPLE INFORM | IATION | method      | limit/base | current        | history1    | history2 |
| Sample Number |        | Client Info |            | WC0908561      | WC0816755   |          |
| Sample Date   |        | Client Info |            | 26 Mar 2024    | 10 Aug 2023 |          |
| Machine Age   | hrs    | Client Info |            | 113004         | 112667      |          |
| Oil Age       | hrs    | Client Info |            | 7500           | 112667      |          |
| Oil Changed   |        | Client Info |            | N/A            | Not Changd  |          |
| Sample Status |        |             |            | ABNORMAL       | NORMAL      |          |
| WEAR METALS   |        | method      | limit/base | current        | history1    | history2 |
| Iron          | ppm    | ASTM D5185m | >8         | 0              | 5           |          |
| Chromium      | ppm    | ASTM D5185m | >2         | 0              | 0           |          |
| Nickel        | ppm    | ASTM D5185m |            | 0              | 0           |          |
| Titanium      | ppm    | ASTM D5185m |            | 0              | 0           |          |
| Silver        | ppm    | ASTM D5185m | >2         | 0              | 0           |          |
| Aluminum      | ppm    | ASTM D5185m | >3         | 0              | 0           |          |
| Lead          | ppm    | ASTM D5185m | >2         | 0              | <1          |          |
| Copper        | ppm    | ASTM D5185m | >8         | 0              | <1          |          |
| Tin           | ppm    | ASTM D5185m | >4         | 3              | 4           |          |
| Vanadium      | ppm    | ASTM D5185m |            | 0              | 0           |          |
| Cadmium       | ppm    | ASTM D5185m |            | 0              | 0           |          |
| ADDITIVES     |        | method      | limit/base | current        | history1    | history2 |
| Boron         | ppm    | ASTM D5185m |            | 0              | 0           |          |
| Barium        | ppm    | ASTM D5185m |            | 0              | 0           |          |
| Molybdenum    | ppm    | ASTM D5185m |            | 0              | 0           |          |
| Manganese     | ppm    | ASTM D5185m |            | 0              | 0           |          |
| Magnesium     | ppm    | ASTM D5185m |            | 0              | <1          |          |
| Calcium       | ppm    | ASTM D5185m |            | 0              | 2           |          |
| Phosphorus    | ppm    | ASTM D5185m |            | 39             | 33          |          |
| Zinc          | ppm    | ASTM D5185m |            | 0              | <1          |          |
| Sulfur        | ppm    | ASTM D5185m |            | 34             | 35          |          |
| CONTAMINANTS  |        | method      | limit/base | current        | history1    | history2 |
| Silicon       | ppm    | ASTM D5185m | >15        | 2              | 4           |          |
| Sodium        | ppm    | ASTM D5185m |            | 3              | 6           |          |
| Potassium     | ppm    | ASTM D5185m | >20        | 0              | 0           |          |
| Water         | %      | ASTM D6304  | >0.01      | <b>△</b> 0.028 | 0.079       |          |
| ppm Water     | ppm    | ASTM D6304  | >100       | <b>286</b>     | 790.3       |          |
| FLUID DEGRADA | TION   | method      | limit/base | current        | history1    | history2 |
| A             | 1/011/ | A OTL A DOT |            |                | 0.010       |          |

0.11


Acid Number (AN)

mg KOH/g ASTM D974

0.042



## **OIL ANALYSIS REPORT**

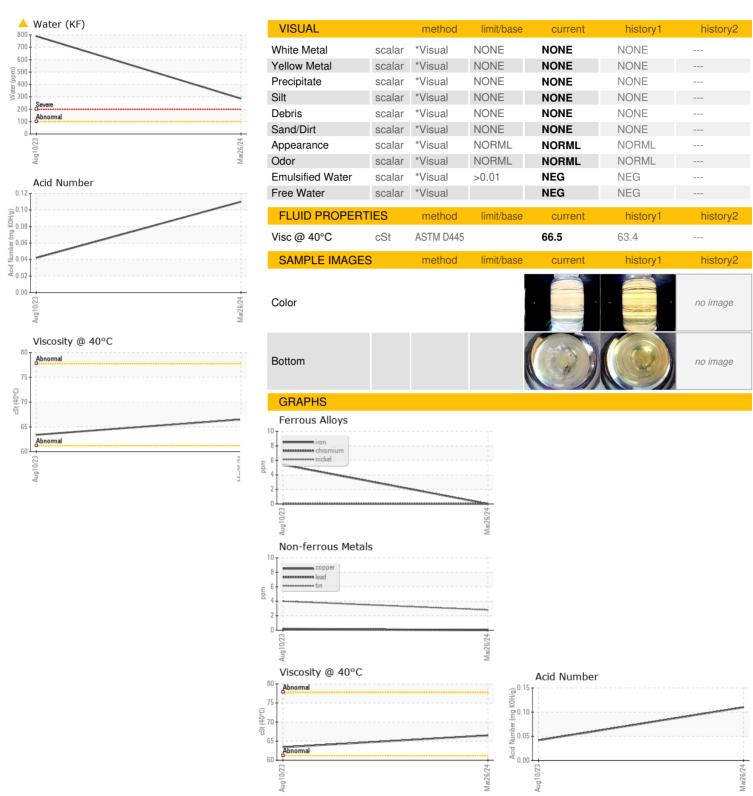





Certificate L2367

Laboratory

Sample No.

Lab Number : 06136473 Unique Number: 10955938 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : WC0908561 Received : 02 Apr 2024 **Tested** 

Diagnosed

: 03 Apr 2024 : 04 Apr 2024 - Don Baldridge

**REAL GOOD FOODS** 525 W CROSSROADS PKWY BOLINGBROOK, IL

US 60440

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: