


OIL ANALYSIS REPORT

Area **S-460** [9158] **KAESER 1547 - CFI TIRE**

Component Compressor

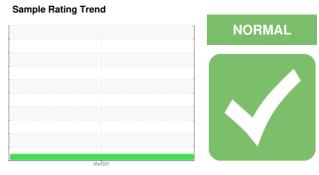

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UDI06136501		
Sample Date		Client Info		27 Mar 2024		
Machine Age	hrs	Client Info		7650		
Oil Age	hrs	Client Info		4509		
Oil Changed		Client Info		Changed		
Sample Status				NORMAL		
CONTAMINATION	1	method	limit/base	current	history1	history2
Water		WC Method	>0.05	NEG		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	0		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	16		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	90	0		
Calcium	ppm	ASTM D5185m	2	0		
Phosphorus	ppm	ASTM D5185m		0		
Zinc	ppm	ASTM D5185m		0		
Sulfur	ppm	ASTM D5185m		19532		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0		
Sodium	ppm	ASTM D5185m		<1		
Potassium	ppm	ASTM D5185m	>20	0		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2

0.29

Acid Number (AN) mg KOH/g ASTM D8045 0.4





OIL ANALYSIS REPORT

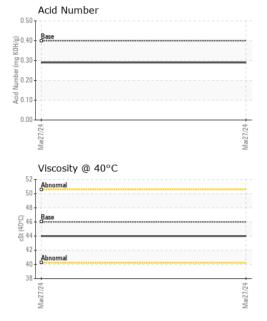





Color no image no image **Bottom** no image no image **GRAPHS**













Certificate 12367

Laboratory Sample No.

Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : UDI06136501 Lab Number : 06136501

To discuss this sample report, contact Customer Service at 1-800-237-1369.

Unique Number : 10955966

Received **Tested** Diagnosed

: 02 Apr 2024 : 03 Apr 2024 : 04 Apr 2024 - Don Baldridge

6540 4TH ST SW UNIT A CEDAR RAPIDS, IA US 52404

Contact: MICHAEL FERRIS wearcheck@deltaind.net T: (319)862-2500

DELTA INDUSTRIES - CEDAR RAPIDS

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: UCDELCED [WUSCAR] 06136501 (Generated: 04/04/2024 20:46:18) Rev: 1

Contact/Location: MICHAEL FERRIS - UCDELCED

F: (319)862-2501