




OIL ANALYSIS REPORT



Machine Id
HANM02BE (S/N 3RC00182)
 Component
Biogas Engine
 Fluid
CHEVRON HDAX 9500 GAS ENGINE OIL 40 (95 GAL)

Sample Rating Trend

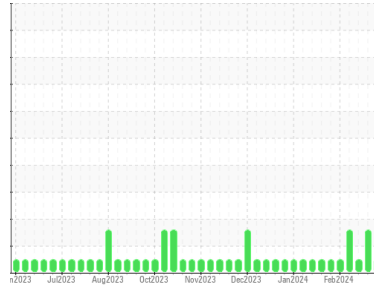

NORMAL



DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

| SAMPLE INFORMATION | | method | limit/base | current | history1 | history2 |
|--------------------|-------------|-------------|------------|--------------------|-------------|-------------|
| Sample Number | Client Info | | | WC0898122 | WC0898127 | WC0898134 |
| Sample Date | Client Info | | | 29 Mar 2024 | 19 Mar 2024 | 13 Mar 2024 |
| Machine Age | hrs | Client Info | | 72384 | 72150 | 72006 |
| Oil Age | hrs | Client Info | | 234 | 1115 | 971 |
| Oil Changed | Client Info | | | Not Changed | Changed | Not Changed |
| Sample Status | | | | NORMAL | ABNORMAL | NORMAL |

| CONTAMINATION | | method | limit/base | current | history1 | history2 |
|---------------|-----------|--------|------------|----------------|----------|----------|
| Fuel | WC Method | >4.0 | | <1.0 | <1.0 | <1.0 |
| Water | WC Method | >.11 | | NEG | NEG | NEG |
| Glycol | WC Method | | | NEG | NEG | NEG |

| WEAR METALS | | method | limit/base | current | history1 | history2 |
|-------------|-----|-------------|------------|--------------|----------|----------|
| Iron | ppm | ASTM D5185m | >15 | 0 | 3 | 3 |
| Chromium | ppm | ASTM D5185m | >4 | 0 | <1 | <1 |
| Nickel | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Titanium | ppm | ASTM D5185m | | 0 | <1 | 0 |
| Silver | ppm | ASTM D5185m | | 0 | <1 | 0 |
| Aluminum | ppm | ASTM D5185m | >6 | 2 | 3 | 2 |
| Lead | ppm | ASTM D5185m | >9 | 0 | 2 | <1 |
| Copper | ppm | ASTM D5185m | >6 | <1 | 2 | 2 |
| Tin | ppm | ASTM D5185m | >4 | 4 | 7 | 6 |
| Vanadium | ppm | ASTM D5185m | | 0 | <1 | 0 |
| Cadmium | ppm | ASTM D5185m | | 0 | 0 | 0 |

| ADDITIVES | | method | limit/base | current | history1 | history2 |
|------------|-----|-------------|------------|--------------|----------|----------|
| Boron | ppm | ASTM D5185m | | 10 | 12 | 15 |
| Barium | ppm | ASTM D5185m | | 0 | 1 | 0 |
| Molybdenum | ppm | ASTM D5185m | | 0 | 4 | 5 |
| Manganese | ppm | ASTM D5185m | | <1 | <1 | 0 |
| Magnesium | ppm | ASTM D5185m | | 8 | 21 | 32 |
| Calcium | ppm | ASTM D5185m | | 1786 | 2213 | 1996 |
| Phosphorus | ppm | ASTM D5185m | | 290 | 326 | 333 |
| Zinc | ppm | ASTM D5185m | | 343 | 440 | 424 |
| Sulfur | ppm | ASTM D5185m | | 2586 | 2870 | 2623 |

| CONTAMINANTS | | method | limit/base | current | history1 | history2 |
|--------------|-----|-------------|------------|--------------|----------|----------|
| Silicon | ppm | ASTM D5185m | >181 | 87 | ▲ 181 | 169 |
| Sodium | ppm | ASTM D5185m | >21 | <1 | 0 | 0 |
| Potassium | ppm | ASTM D5185m | >20 | <1 | 3 | 2 |


| INFRA-RED | | method | limit/base | current | history1 | history2 |
|-----------|----------|-------------|------------|-------------|----------|----------|
| Soot % | % | *ASTM D7844 | | 0 | 0.1 | 0.1 |
| Nitration | Abs/cm | *ASTM D7624 | | 6.3 | 7.9 | 7.7 |
| Sulfation | Abs/.1mm | *ASTM D7415 | | 18.1 | 23.0 | 22.1 |

| FLUID DEGRADATION | | method | limit/base | current | history1 | history2 |
|-------------------|----------|-------------|------------|-------------|----------|----------|
| Oxidation | Abs/.1mm | *ASTM D7414 | | 12.0 | 19.8 | 18.3 |
| Acid Number (AN) | mg KOH/g | ASTM D8045 | 1.0 | 0.72 | 2.03 | 1.86 |
| Base Number (BN) | mg KOH/g | ASTM D2896 | 5.4 | 4.13 | 3.79 | 3.67 |




OIL ANALYSIS REPORT


FT-IR (Direct Trend)

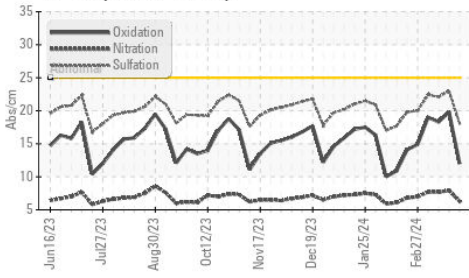


Acid Number

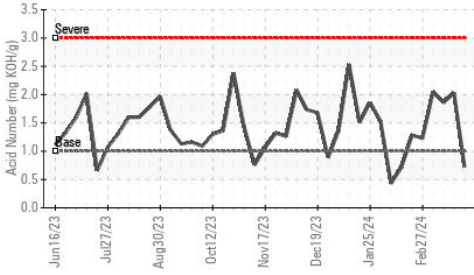

Base Number

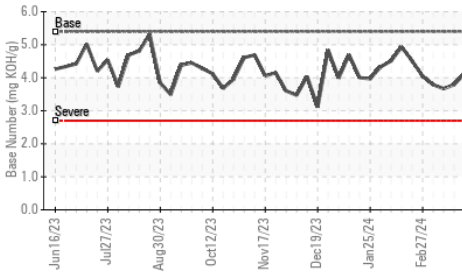









Viscosity @ 100°C

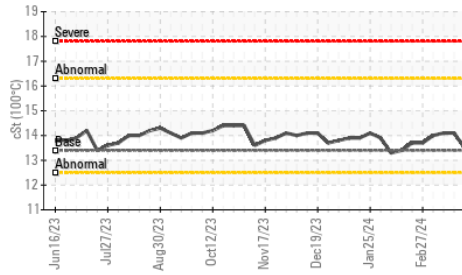

| VISUAL | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| White Metal | scalar | *Visual | NONE | NONE | NONE |
| Yellow Metal | scalar | *Visual | NONE | NONE | NONE |
| Precipitate | scalar | *Visual | NONE | NONE | NONE |
| Silt | scalar | *Visual | NONE | NONE | NONE |
| Debris | scalar | *Visual | NONE | NONE | NONE |
| Sand/Dirt | scalar | *Visual | NONE | NONE | NONE |
| Appearance | scalar | *Visual | NORML | NORML | NORML |
| Odor | scalar | *Visual | NORML | NORML | NORML |
| Emulsified Water | scalar | *Visual | >.11 | NEG | NEG |
| Free Water | scalar | *Visual | | NEG | NEG |

| FLUID PROPERTIES | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| Visc @ 100°C | cSt | ASTM D445 | 13.4 | 13.5 | 14.1 |

GRAPHS

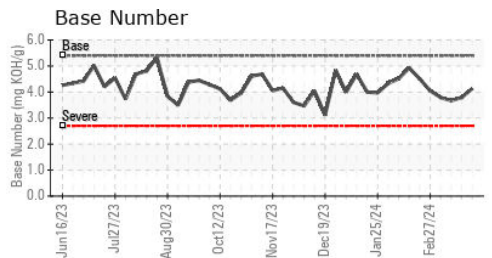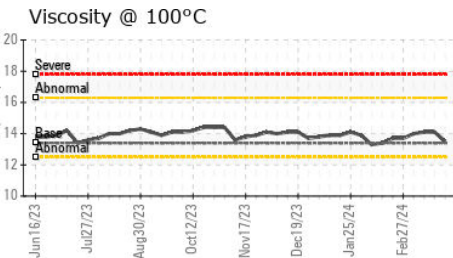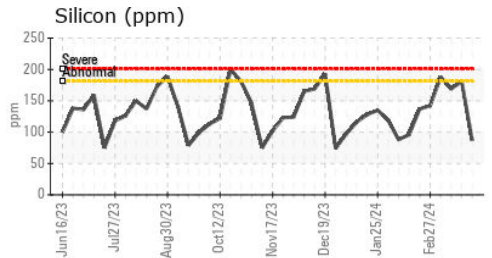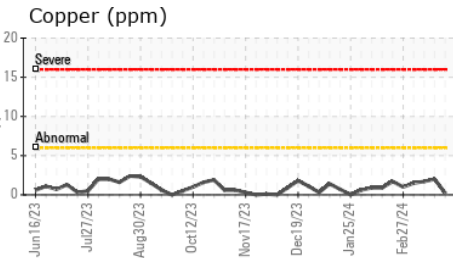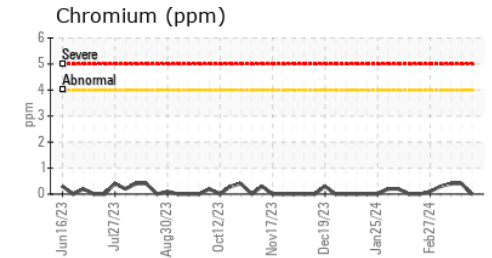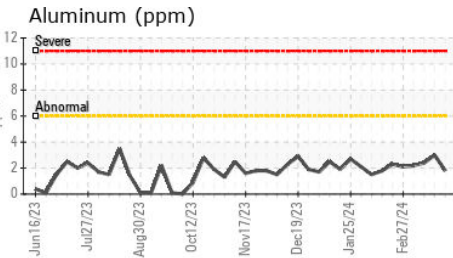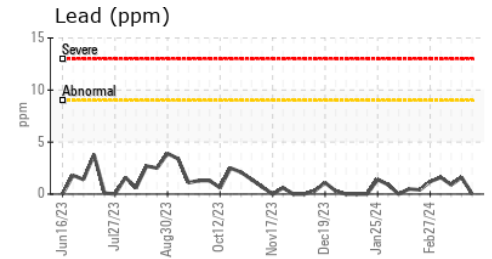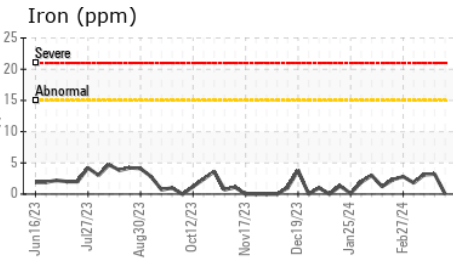

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
 Sample No. : WC0898122
 Lab Number : 06136542
 Unique Number : 10956007
 Test Package : MOB 2

Received : 02 Apr 2024
 Tested : 03 Apr 2024
 Diagnosed : 04 Apr 2024 - Sean Felton

EDL NA Recips-Hancock County
 HANCOCK COUNTY POWER STATION, 3574 TOWNSHIP ROAD 142
 FINDLAY, OH
 US 45840
 Contact: TIM CUSICK
 tim.cusick@edlenergy.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: